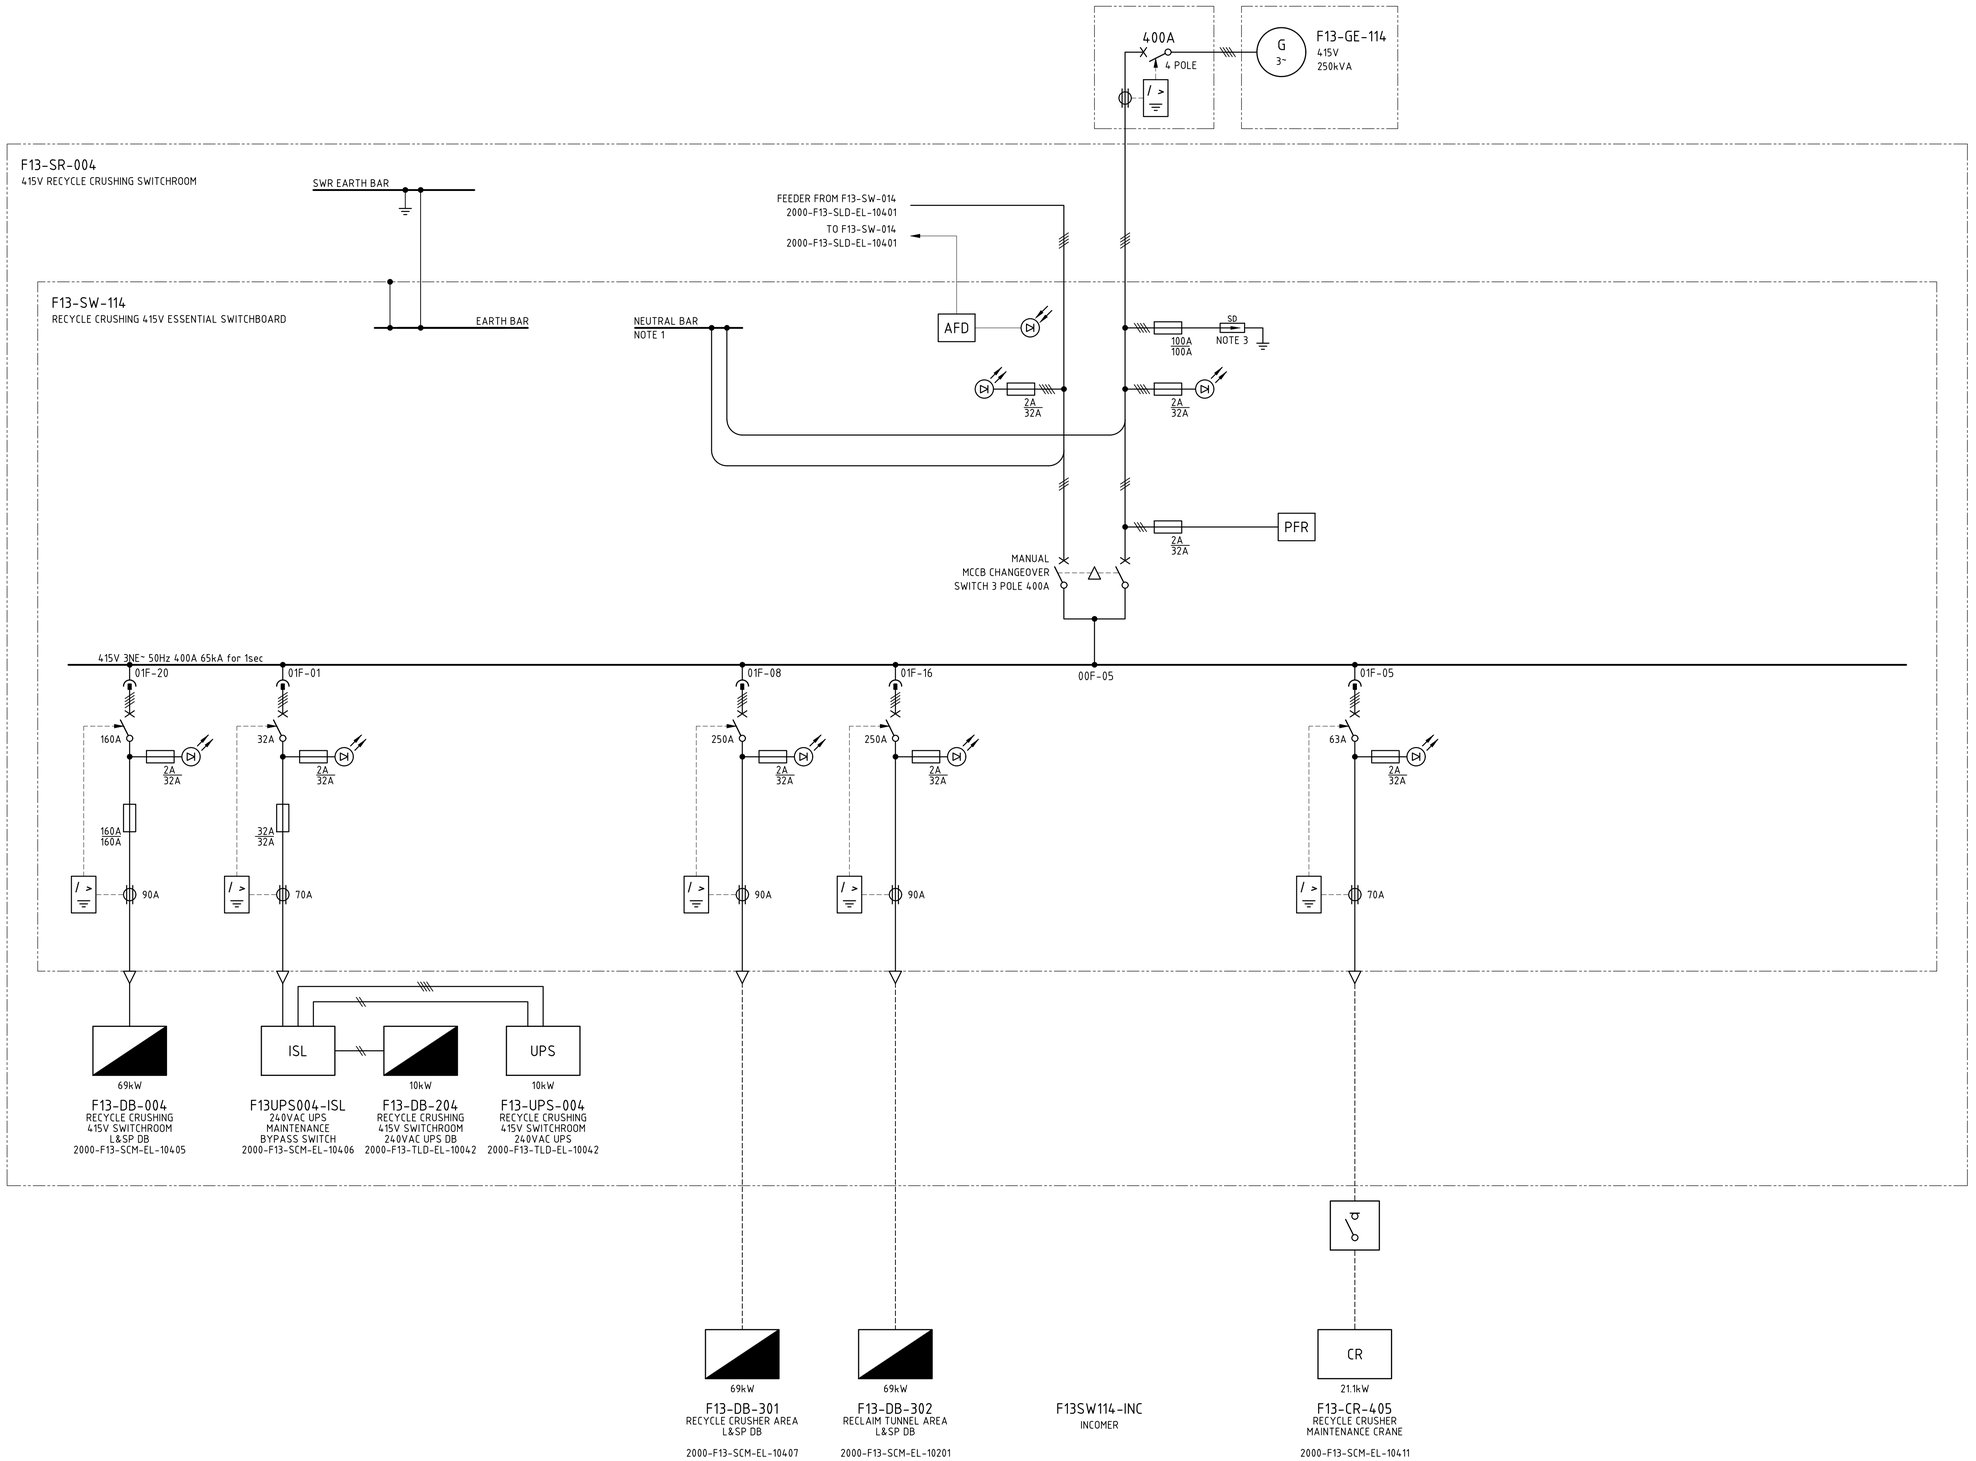



## NOTES

1. EARTH-NEUTRAL LINK INSTALLED IN UPSTREAM F13-SW-014 INCOMER TIER. SIGNAGE SHALL BE PLACED ON F13-SW-114 SWITCHBOARD AND ON GENERATOR READING "M.E.N. LINK LOCATED IN F13-SW-014 INCOMER TIER"
2. SWITCHBOARD SHALL BE EXTENSIBLE AND BE PROVIDED WITH THE FACILITY TO EXTEND THE MAIN BUSBAR AND APPEND ADDITIONAL TIERS AT ONE END WITHOUT MAJOR STRUCTURAL DISASSEMBLY.
3. SURGE DIVERTERS SHALL PROVIDE FEEDBACK TO DCS VIA VOLT-FREE CONTACTS. SURGE DIVERTER FUSES SHALL BE SIZED BY VENDOR TO SUIT DUTY.
4. MINIATURE CIRCUIT BREAKERS SHALL BE SIZED AND RATED TO SUIT ACB AND INCOMER REQUIREMENTS.
5. CIRCUIT BREAKER TO BE SUBSTITUTED FOR FUSED-SWITCH WHERE REQUIRED BY EQUIPMENT MANUFACTURERS GUIDELINES.

## LEGEND

| | |
|---|---|
| PFR | PHASE FAILURE RELAY |
| / > | EARTH LEAKAGE RELAY |
| xxxA / xxxA | ST TRIP SET POINT / CB SIZE |
| AFD | ARC FLASH DETECTION |
| ECR | EARTH CONTINUITY RELAY |

# 2000-F13-SLD-EL-10411_Rev2

F13-SW-114 415V essential switchboard - single line diagram