
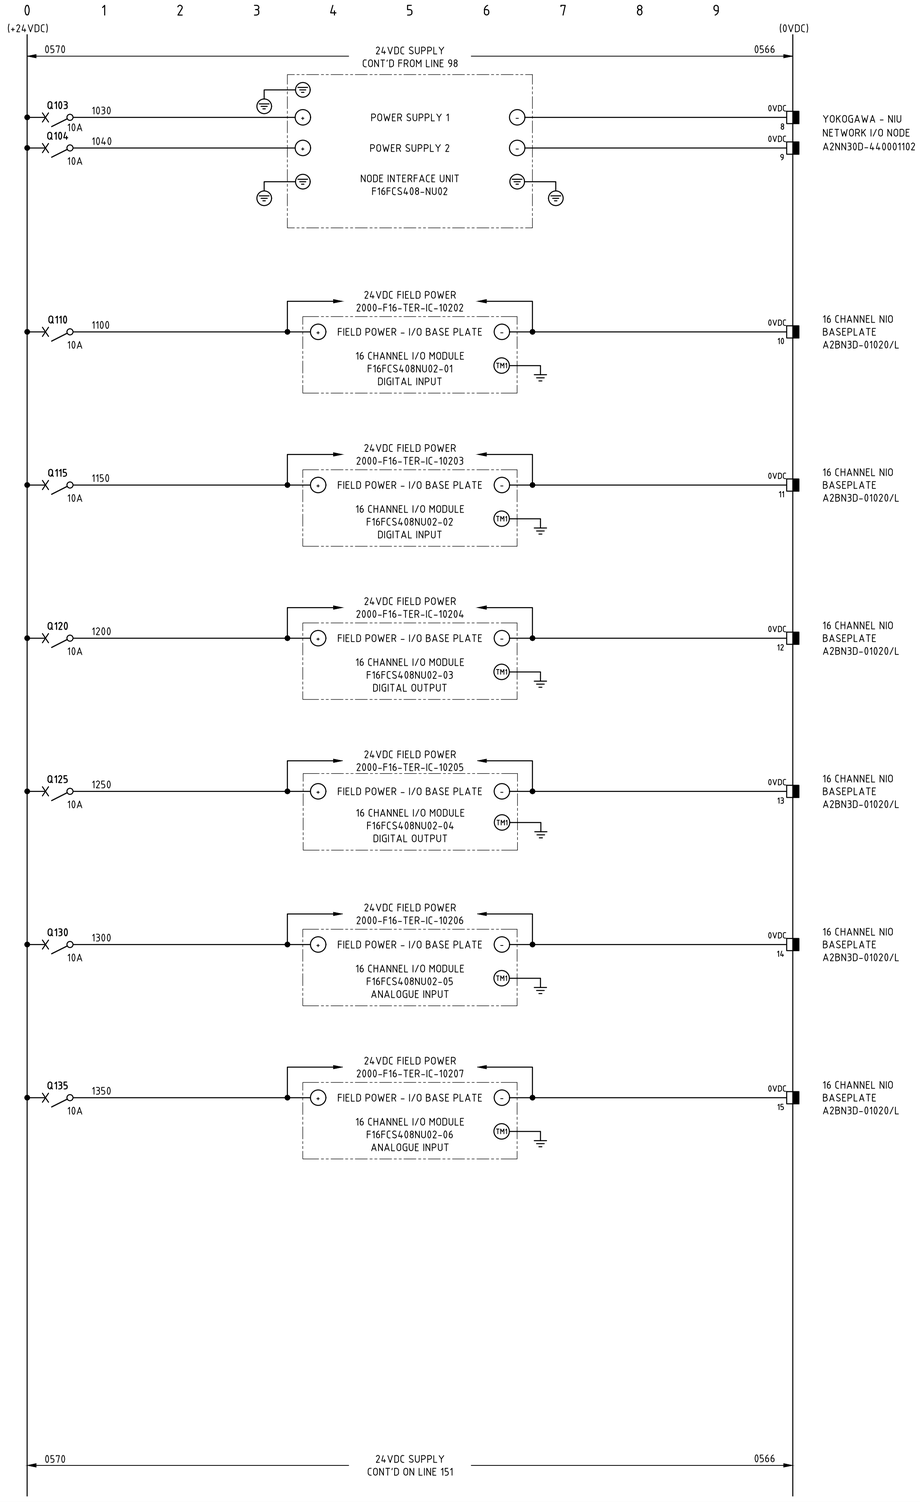


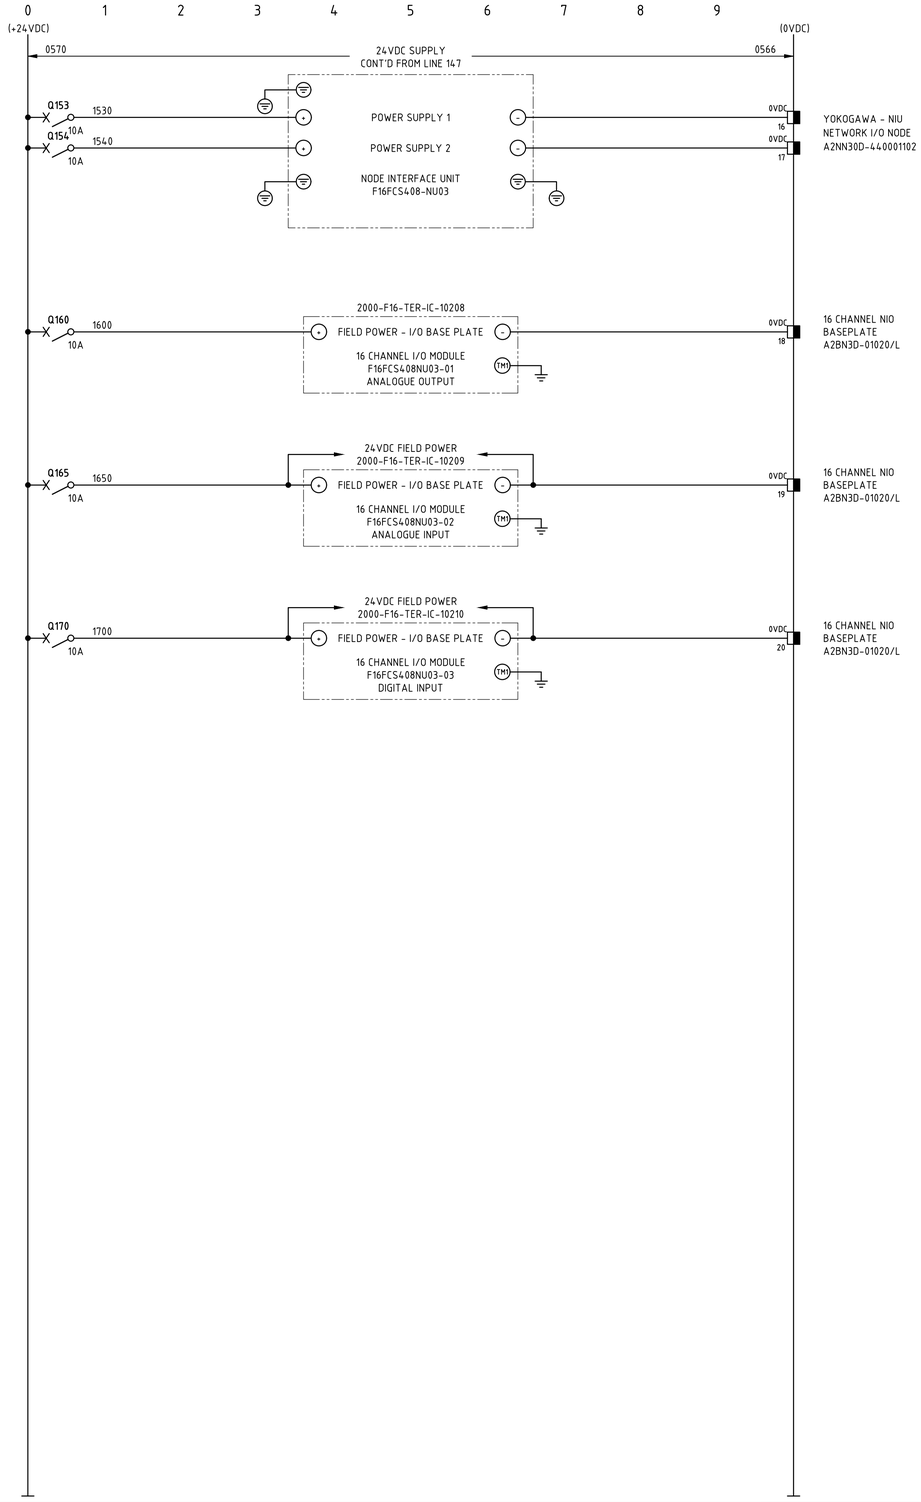

NOTES

1. TERMINALS ON TERMINAL STRIPS ABOVE 50VAC SHALL HAVE A SEPARATE PERSPEX SHROUD AND SHALL BE LABELLED "DANGER xxxVAC".
2. WIRE NUMBER FERRULES ON TERMINAL STRIP SHALL BE PREFIXED WITH EQUIPMENT NUMBER e.g. F16RIO001-xxxx.
3. EACH WIRE SHALL BE IDENTIFIED AT BOTH ENDS WITH FERRULES.
4. FOR NETWORK CONNECTION & BUS CABLING DETAILS REFER TO RIO PANEL COMMUNICATIONS TERMINATION DIAGRAMS.
5. INSTRUMENT EARTH BAR TO BE BONDED TO MAIN EARTH BAR WITH SOLID COPPER LINK.

LEGEND

- FIELD TERMINAL
- DCS OR I/O TERMINAL
- MARSHALLING TERMINAL
- DEVICE TERMINAL
- EARTH BAR
- INSTRUMENT EARTH BAR

NIO BASEPLATE

F16FCS408NU02-01

- NETWORKED INPUT/OUTPUT (N-IO) BASEPLATE
- NODE INTERFACE UNIT (N-IU)
- FIELD CONTROL UNIT

NORTHERN STAR RESOURCES

Comments ☐

No Comments ☒

Signed [redacted] Date 26/02/25

ACCEPTANCE DOES NOT RELIEVE THE SUPPLIER / CONTRACTOR OF ITS RESPONSIBILITY OR LIABILITIES UNDER THE PURCHASE ORDER / CONTRACT

2000-F16-SCM-IC-10202_Rev0

Rougher & scavenger flotation F16-RIO-001 rougher & scavenger field n-io panel schematic diagram sheet 2

O:\CAD PROJECTS\235 NORTHERN STAR RESOURCES LTD\235157 KCGM GROWTH PROJECT\03 DELIVERABLES\C\F16 - ROUGHER & SCAVENGER FLOTATION\2000-F16-SCM-IC-10202.DWG 19FEB25 2:11PM MARIECRIS.SANTOS