



F175UPS701-ISL
240VAC UPS
MAINTENANCE BYPASS SWITCH
10kW

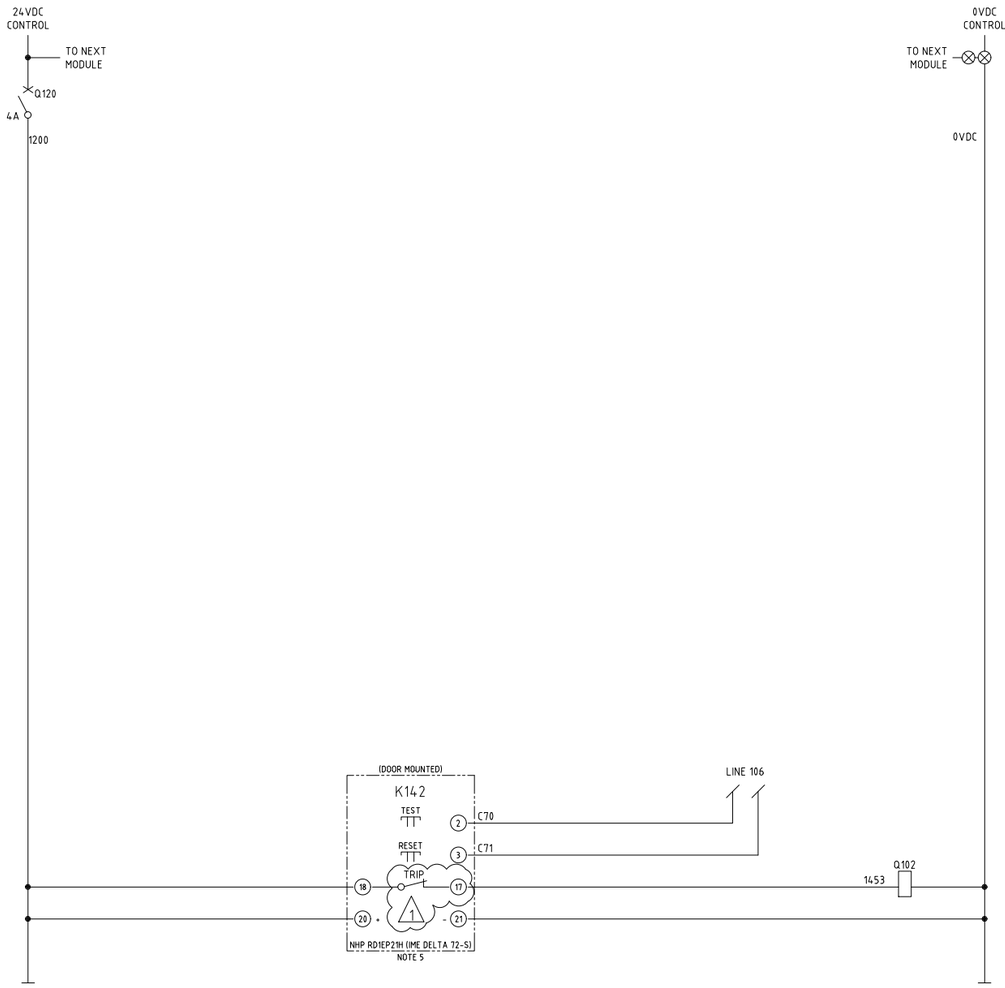

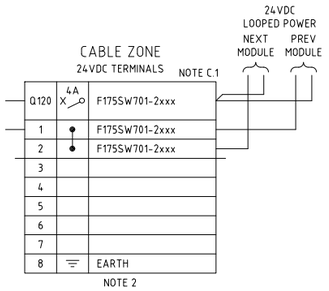

NOTES

1. TERMINALS ON TERMINAL STRIPS ABOVE 50VAC SHALL HAVE A SEPARATE PERSPEX SHROUD AND SHALL BE LABELLED "DANGER xxxVAC".
2. WIRE NUMBER FERRULES ON TERMINAL STRIP SHALL BE PREFIXED WITH EQUIPMENT NUMBER e.g. F175UPS701-ISL.
3. EACH WIRE SHALL BE IDENTIFIED AT BOTH ENDS WITH FERRULES.
4. NHP TDG×2 TOROID TO SUIT CABLE DIAMETER (TOROID MIN. 30mA).
5. EARTH LEAKAGE RELAY USER INTERFACE TO BE MOUNTED ON MCC MODULE DOOR.
   RELAY SETTINGS SET TO:
   IΔn ="1A".
   DELAY = "100ms".
   RANGES = "x1".
   FAILSAFE MODE = "Ne".
   RESET = "MAN".
6. REFER TO CABLE SCHEDULE 2000-F175-LST-EL-40003.


LEGEND

00/01/00	DCS DIGITAL INPUT
00/02/00	DCS DIGITAL OUTPUT
⊗	MCC TERMINAL
◓	VSD TERMINAL
◒	FIELD TERMINAL
◑	DCS OR I/O TERMINAL
◨	MARSHALLING TERMINAL
(x)	DEVICE TERMINAL
⊗ cc	INDICATION LAMP cc = COLOUR

CONSTRUCTION NOTES

C.1 TO BE DETERMINED BY MCC VENDOR

TERMINATION LEGEND

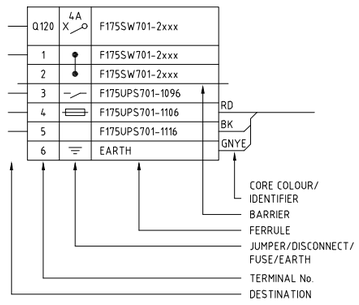

APPROVED FOR CONSTRUCTION

2000-F175-SCM-EL-40014_Rev1

Southlakes booster station f175UPS701-isl 240VAC UPS maint. bypass switch control schematic diagram