

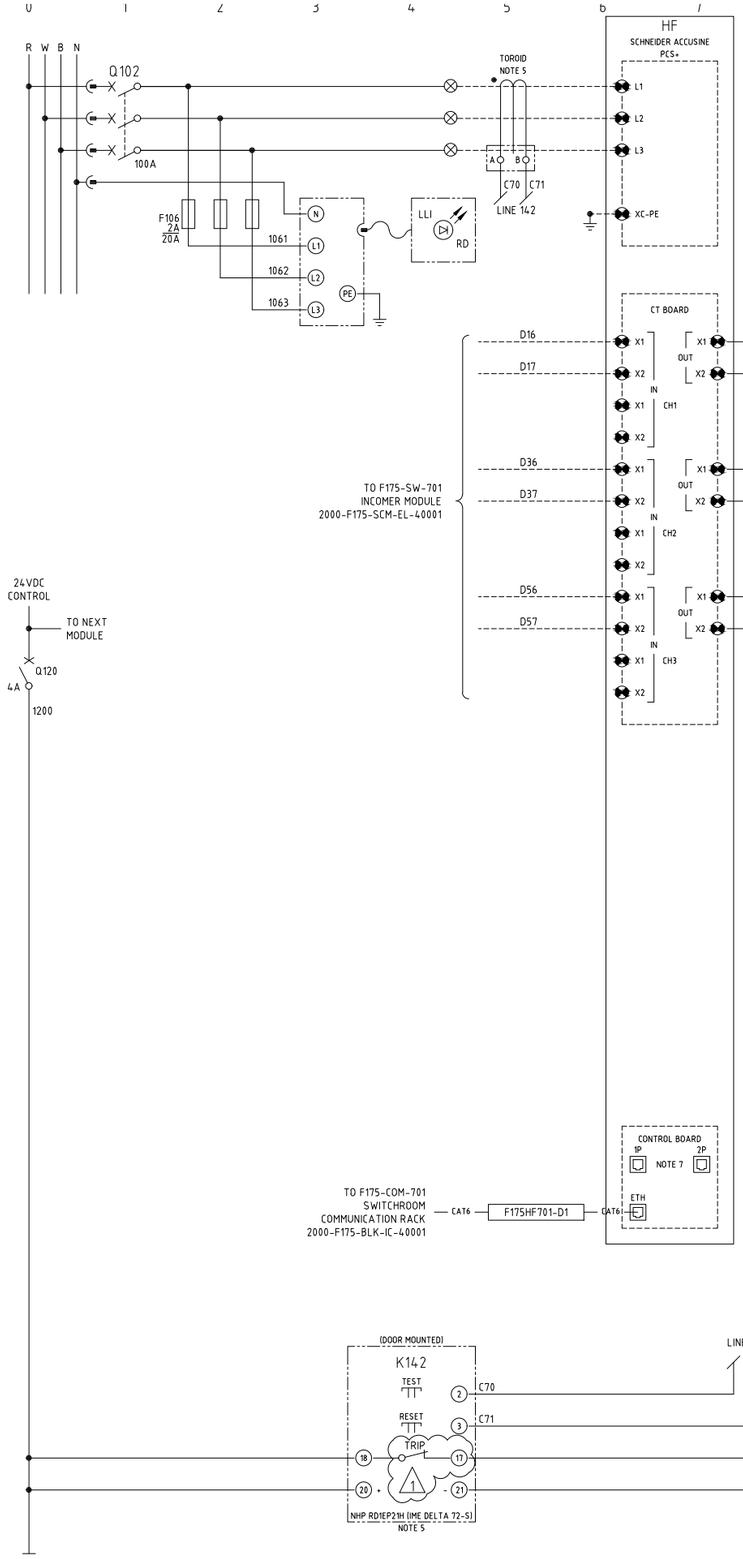


F175-HF-701

SOUTHLAKES BOOSTER STATION
LV MCC
ACTIVE HARMONIC FILTER
60 A

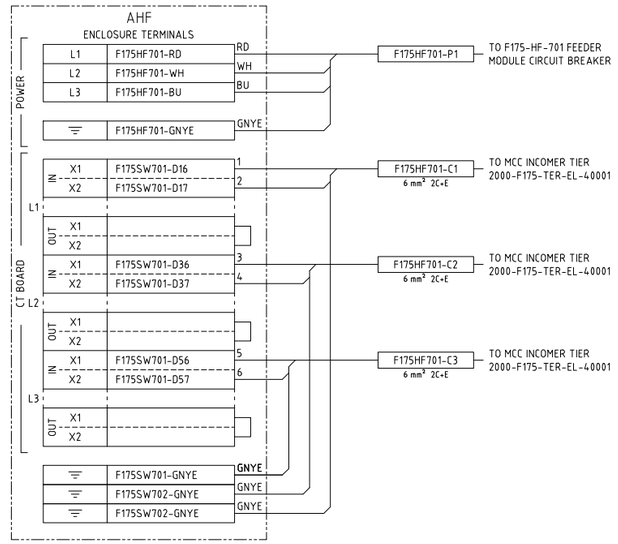

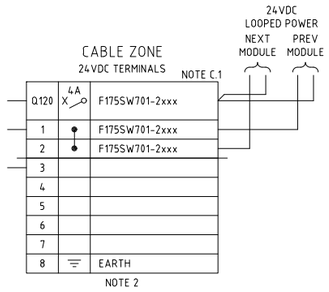


NOTES

1. TERMINALS ON TERMINAL STRIPS ABOVE 50VAC SHALL HAVE A SEPARATE PERSPEX SHROUD AND SHALL BE LABELLED "DANGER xxxVAC".
2. WIRE NUMBER FERRULES ON TERMINAL STRIP SHALL BE PREFIXED WITH EQUIPMENT NUMBER e.g. F175HF701-1200.
3. EACH WIRE SHALL BE IDENTIFIED AT BOTH ENDS WITH FERRULES.
4. NHP TDG×2 TOROID TO SUIT CABLE DIAMETER (TOROID MIN. 30mA).
5. EARTH LEAKAGE RELAY USER INTERFACE TO BE MOUNTED ON MCC MODULE DOOR.
   RELAY SETTINGS SET TO:
   IΔn ="1A".
   DELAY = "100ms".
   RANGES = "x1".
   FAILSAFE MODE = "Ne".
   RESET = "MAN".
6. REFER TO CABLE SCHEDULE 2000-F175-LST-EL-40003.
7. P1 & P2 PORTS ARE FACTORY FITTED WITH RJ45 TERMINATOR.


LEGEND

- 00/01/00 — DCS DIGITAL INPUT
- 00/02/00 — DCS DIGITAL OUTPUT
- MCC TERMINAL
- VSD TERMINAL
- FIELD TERMINAL
- DCS OR I/O TERMINAL
- MARSHALLING TERMINAL
- DEVICE TERMINAL
- INDICATION LAMP (cc = COLOUR)

DCS LEGEND

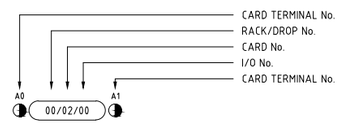

TERMINATION LEGEND

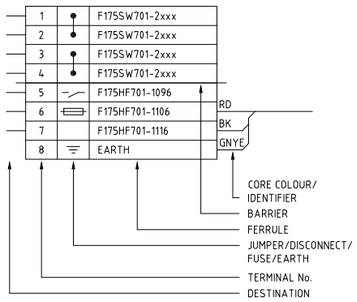

CONSTRUCTION NOTES

C.1 TO BE DETERMINED BY MCC VENDOR

APPROVED FOR CONSTRUCTION

2000-F175-SCM-EL-40015_Rev1

Southlakes booster station F175-HF-701 LV MCC active harmonic filter feeder control schematic diagram