
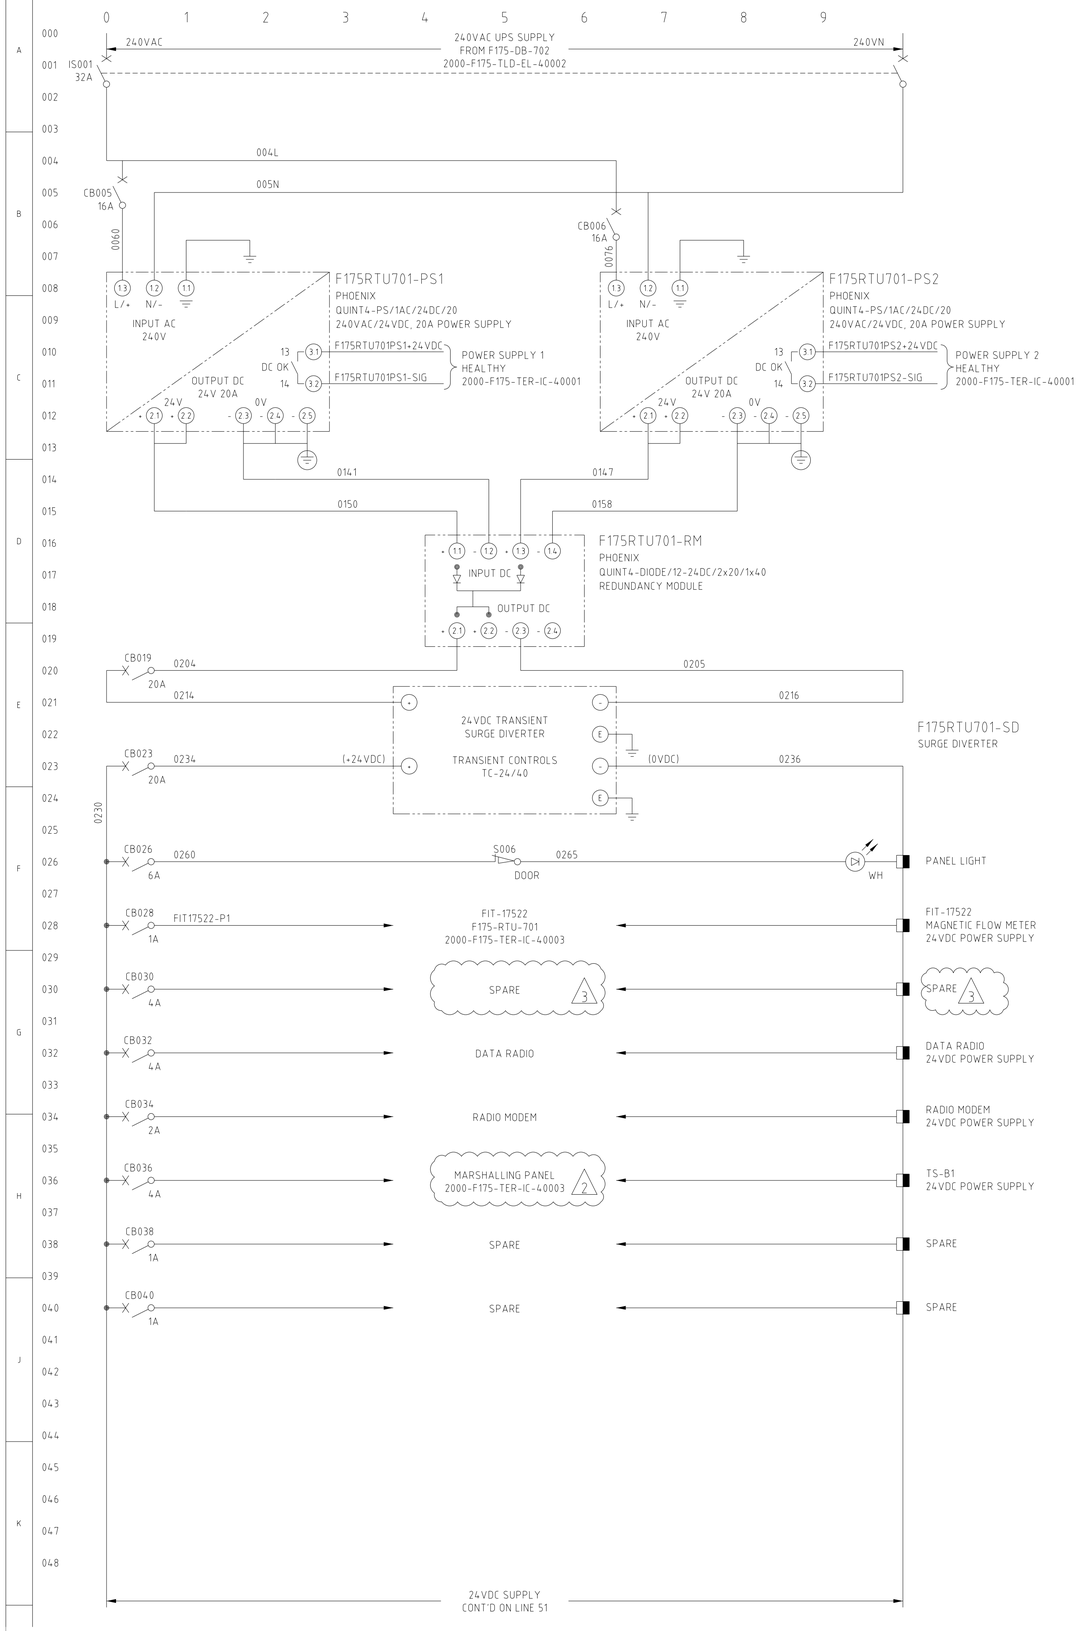


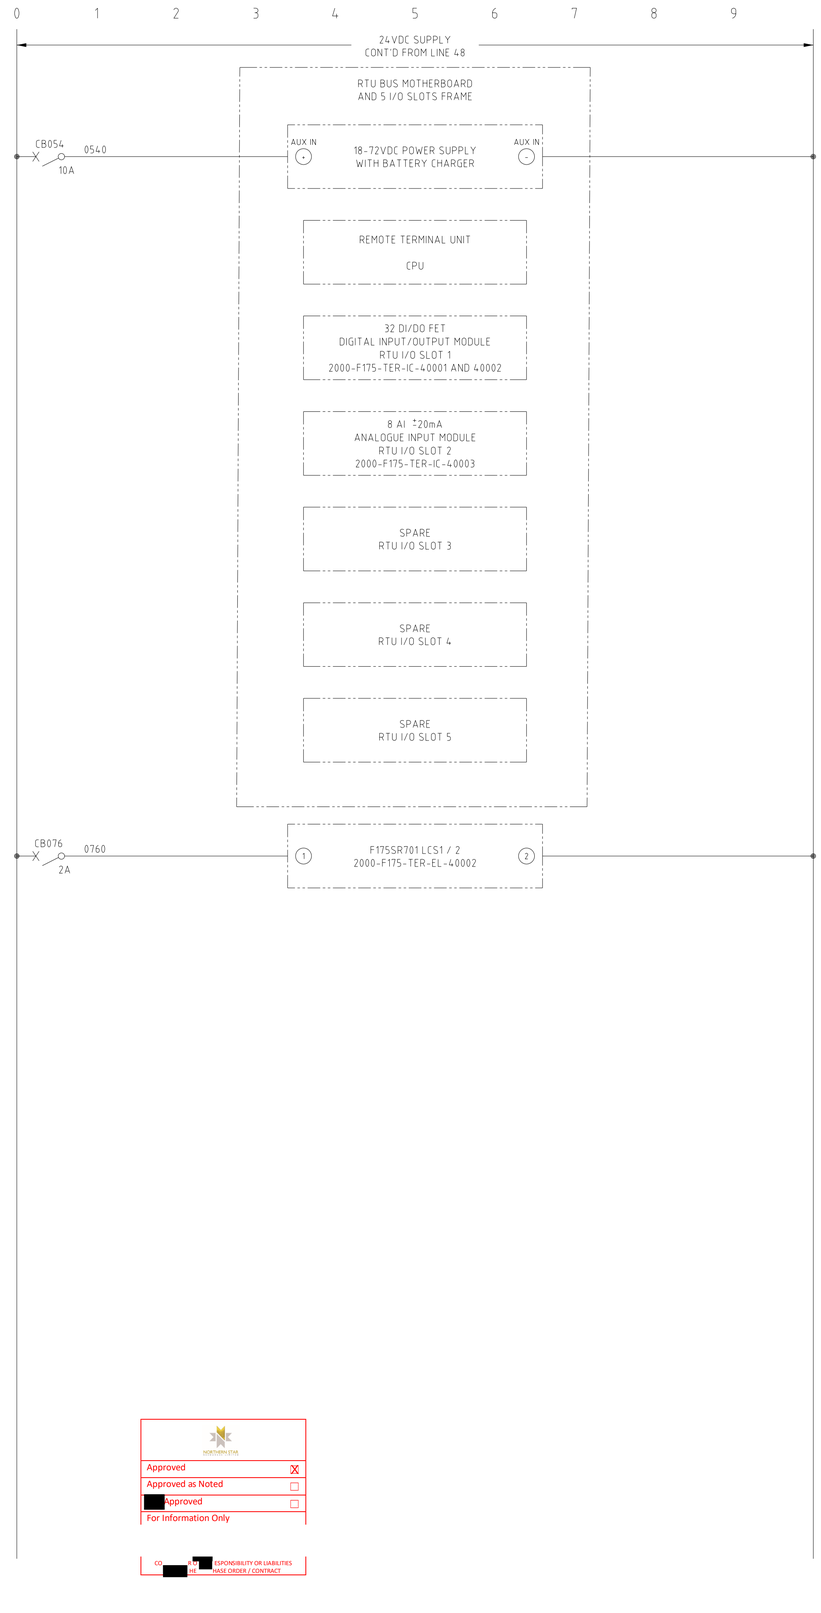

NOTES

1. TERMINALS ON TERMINAL STRIPS ABOVE 50VAC SHALL HAVE A SEPARATE PERSPEX SHROUD AND SHALL BE LABELLED "DANGER xxxVAC".
2. WIRE NUMBER FERRULES ON TERMINAL STRIP SHALL BE PREFIXED WITH EQUIPMENT NUMBER e.g. FxxPPxxx-1200.
3. EACH WIRE SHALL BE IDENTIFIED AT BOTH ENDS WITH FERRULES.
4. FOR NETWORK CONNECTION DETAILS REFER TO: F175-SR-701 SWITCHROOM COMMUNICATIONS BLOCK DIAGRAM 2000-F175-BLK-IC-40001

LEGEND

- FIELD TERMINAL
- DCS OR I/O TERMINAL
- MARSHALLING TERMINAL
- DEVICE TERMINAL
- INDICATION LAMP (cc = COLOUR)
- EARTH BAR
- IEB — INSTRUMENT EARTH BAR

NORTHERN STAR

Approved X
Approved as Noted ☐
[redacted] Approved ☐
For Information Only

CO[redacted] RESPONSIBILITY OR LIABILITIES
[redacted] BASE ORDER / CONTRACT

APPROVED FOR CONSTRUCTION

2000-F175-SCM-IC-40002_Rev3

Rtu cabinet schematic diagram