


NOTE 2.

NOTES

1. TERMINALS ON TERMINAL STRIPS ABOVE 50VAC SHALL HAVE A SEPARATE PERSPEX SHROUD AND SHALL BE LABELLED "DANGER xxxVAC"
2. WIRE NUMBER FERRULES ON TERMINAL STRIP SHALL BE PREFIXED WITH EQUIPMENT NUMBER e.g. FxxSCxxx-1200
3. EACH WIRE SHALL BE IDENTIFIED AT BOTH ENDS WITH FERRULES


LEGEND

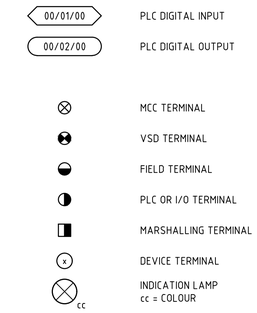

PLC LEGEND



TERMINATION LEGEND

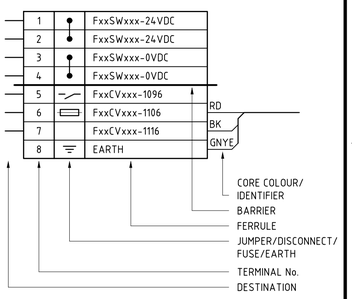

2000-F19-SCM-EL-10001_Rev0

F19-cp-401 ball charger control panel schematic & termination diagram