
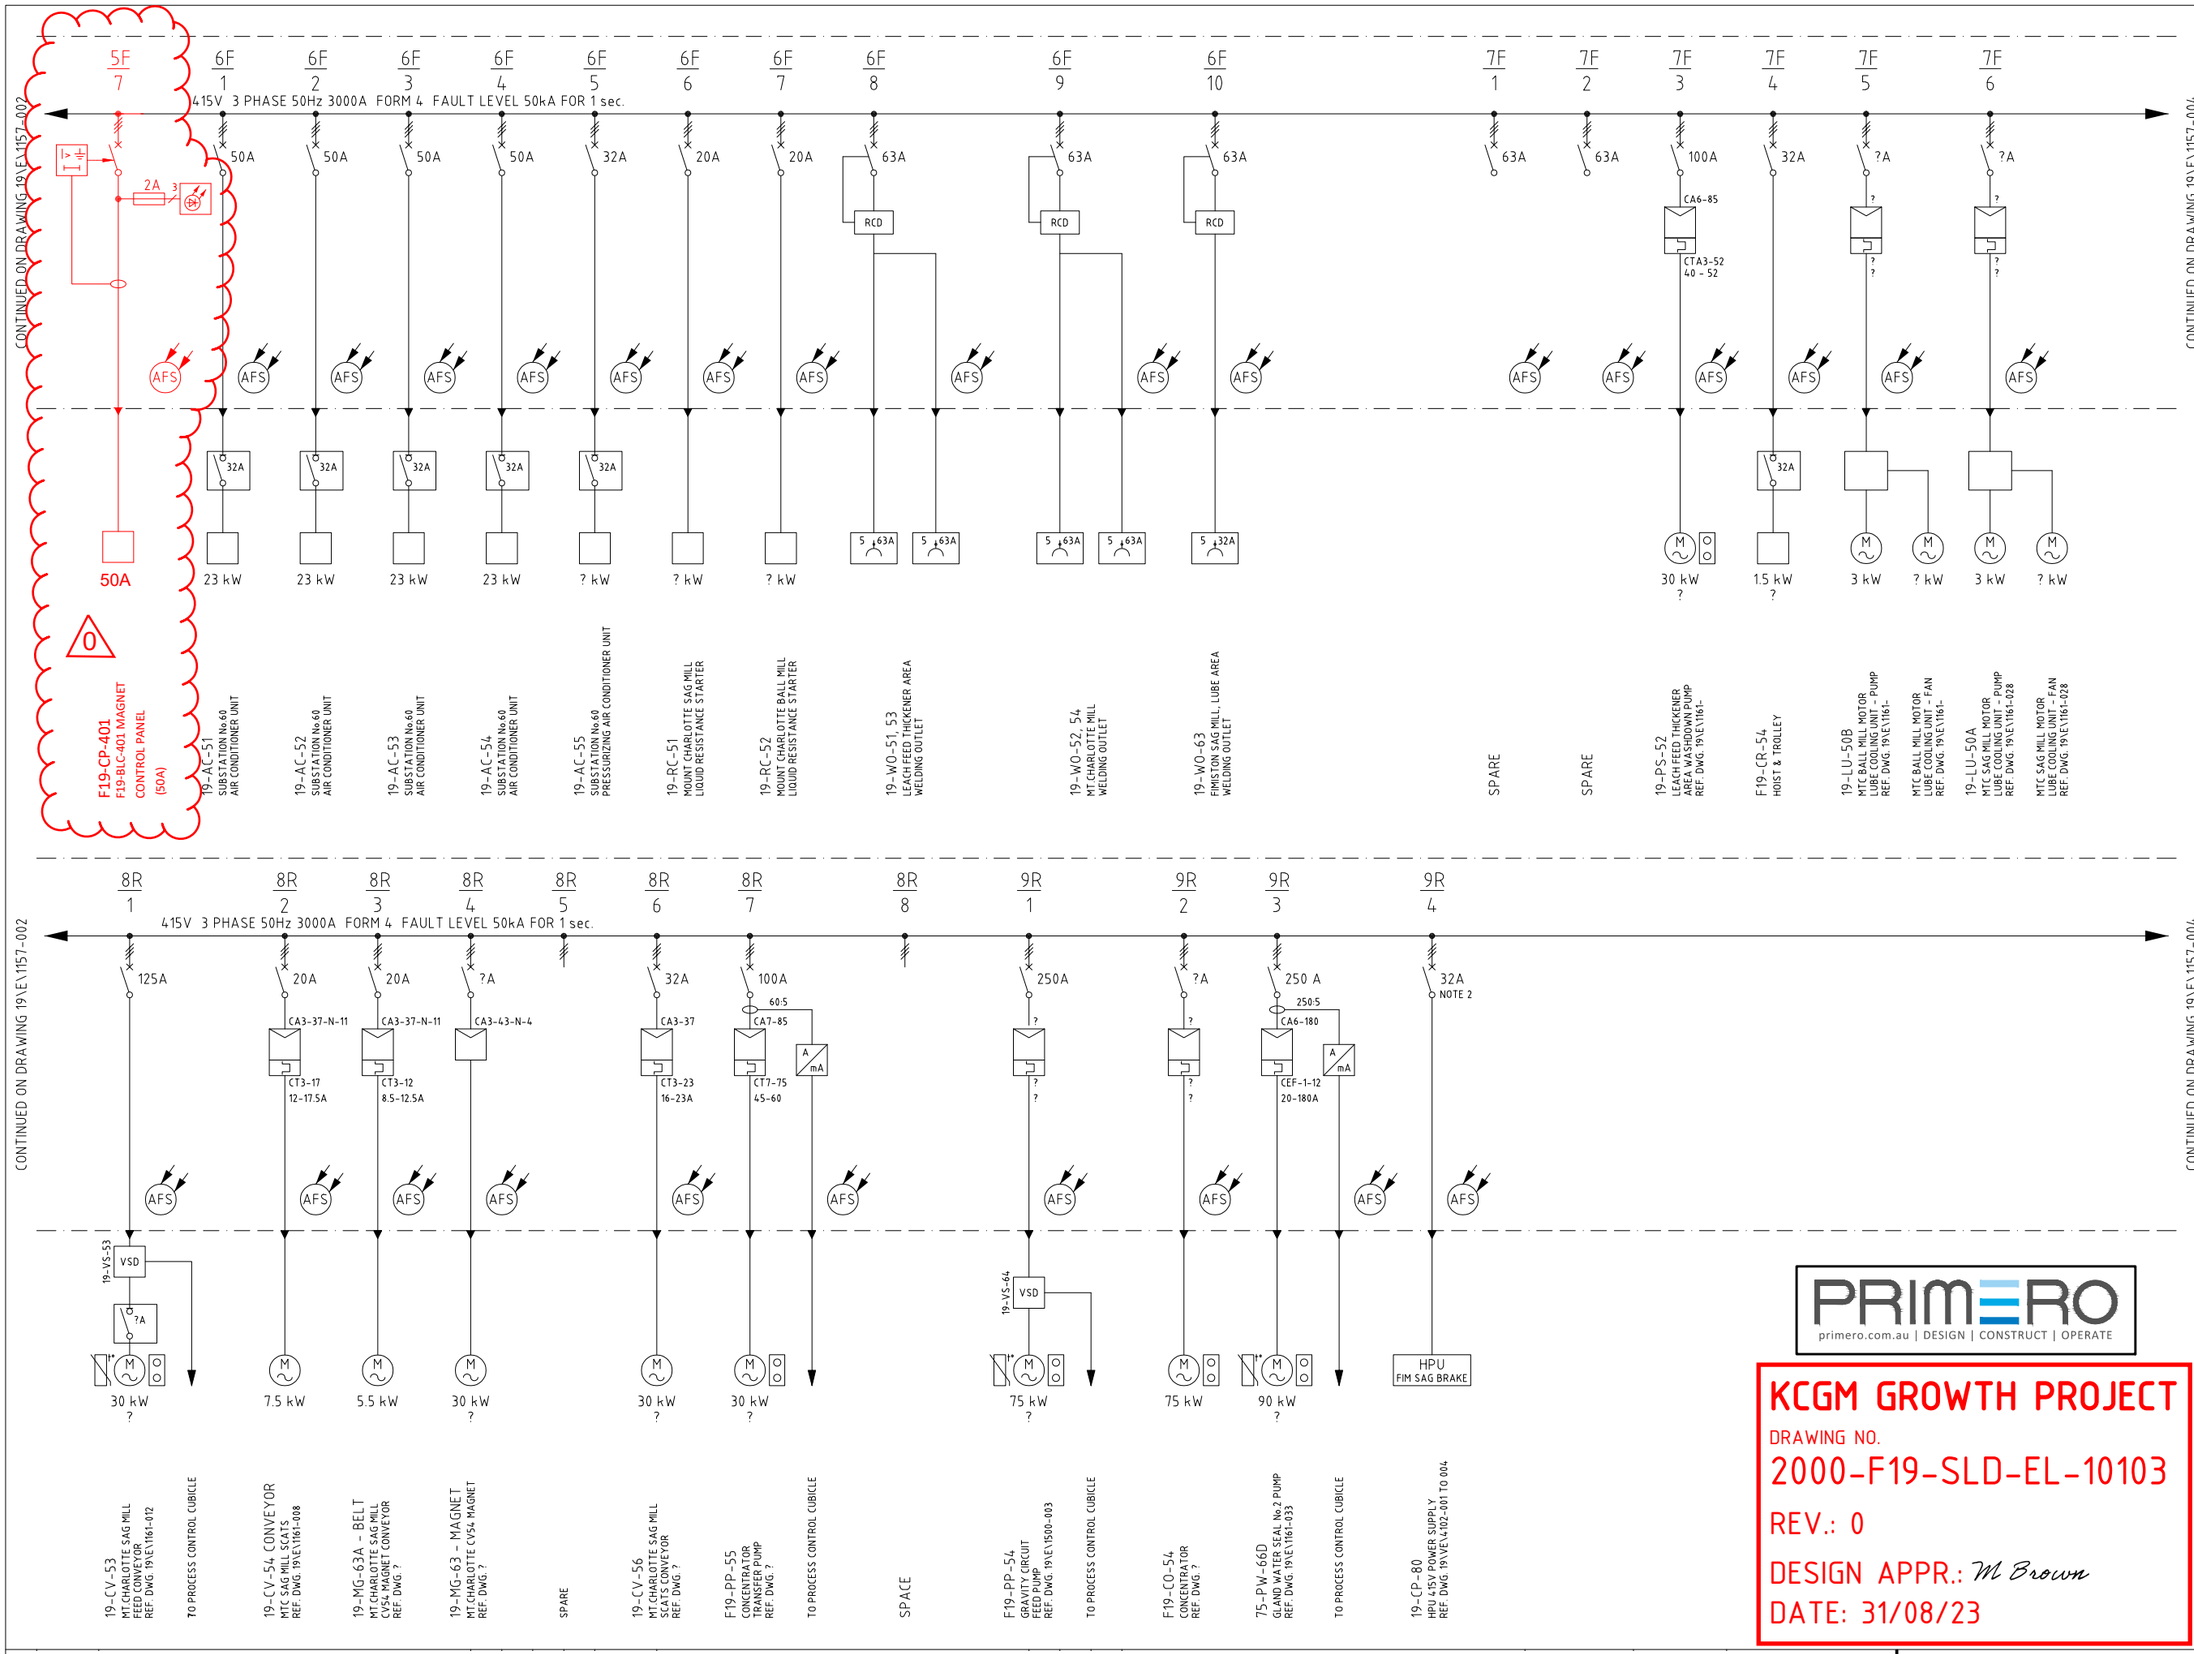



## LEGEND

## LOCATION

SUB STATION 60

19-SW-61

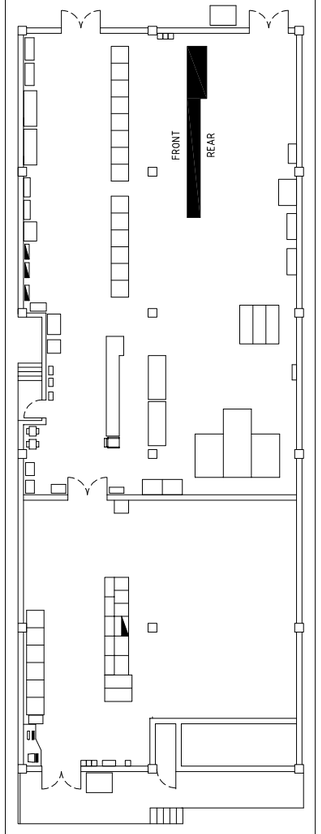


PRIMERO
primero.com.au | DESIGN | CONSTRUCT | OPERATE

**KCGM GROWTH PROJECT**

DRAWING NO.

2000-F19-SLD-EL-10103

REV.: 0

DESIGN APPR.: M Brown

DATE: 31/08/23

## NOTES

1. EARTH LEAKAGE CIRCUIT BREAKER SHALL HAVE 300mA SENSITIVITY FOR WELDING OUTLET.
2. EARTH CONTINUITY RELAY, SCIENTECHNIC TYPE PCA. WIRED BACK TO THE ARC FLASH RELAY
3. ALL AFS (ARC FLASH SENSORS) ARE CONNECTED TO THE ARC FLASH RELAY VIA I/O UNITS

**2000-F19-SLD-EL-10103_Rev0**

Mt Charlotte CCT milling & classification substation no. 60 415V MCC
19-SW-61 single line diagram sheet 3