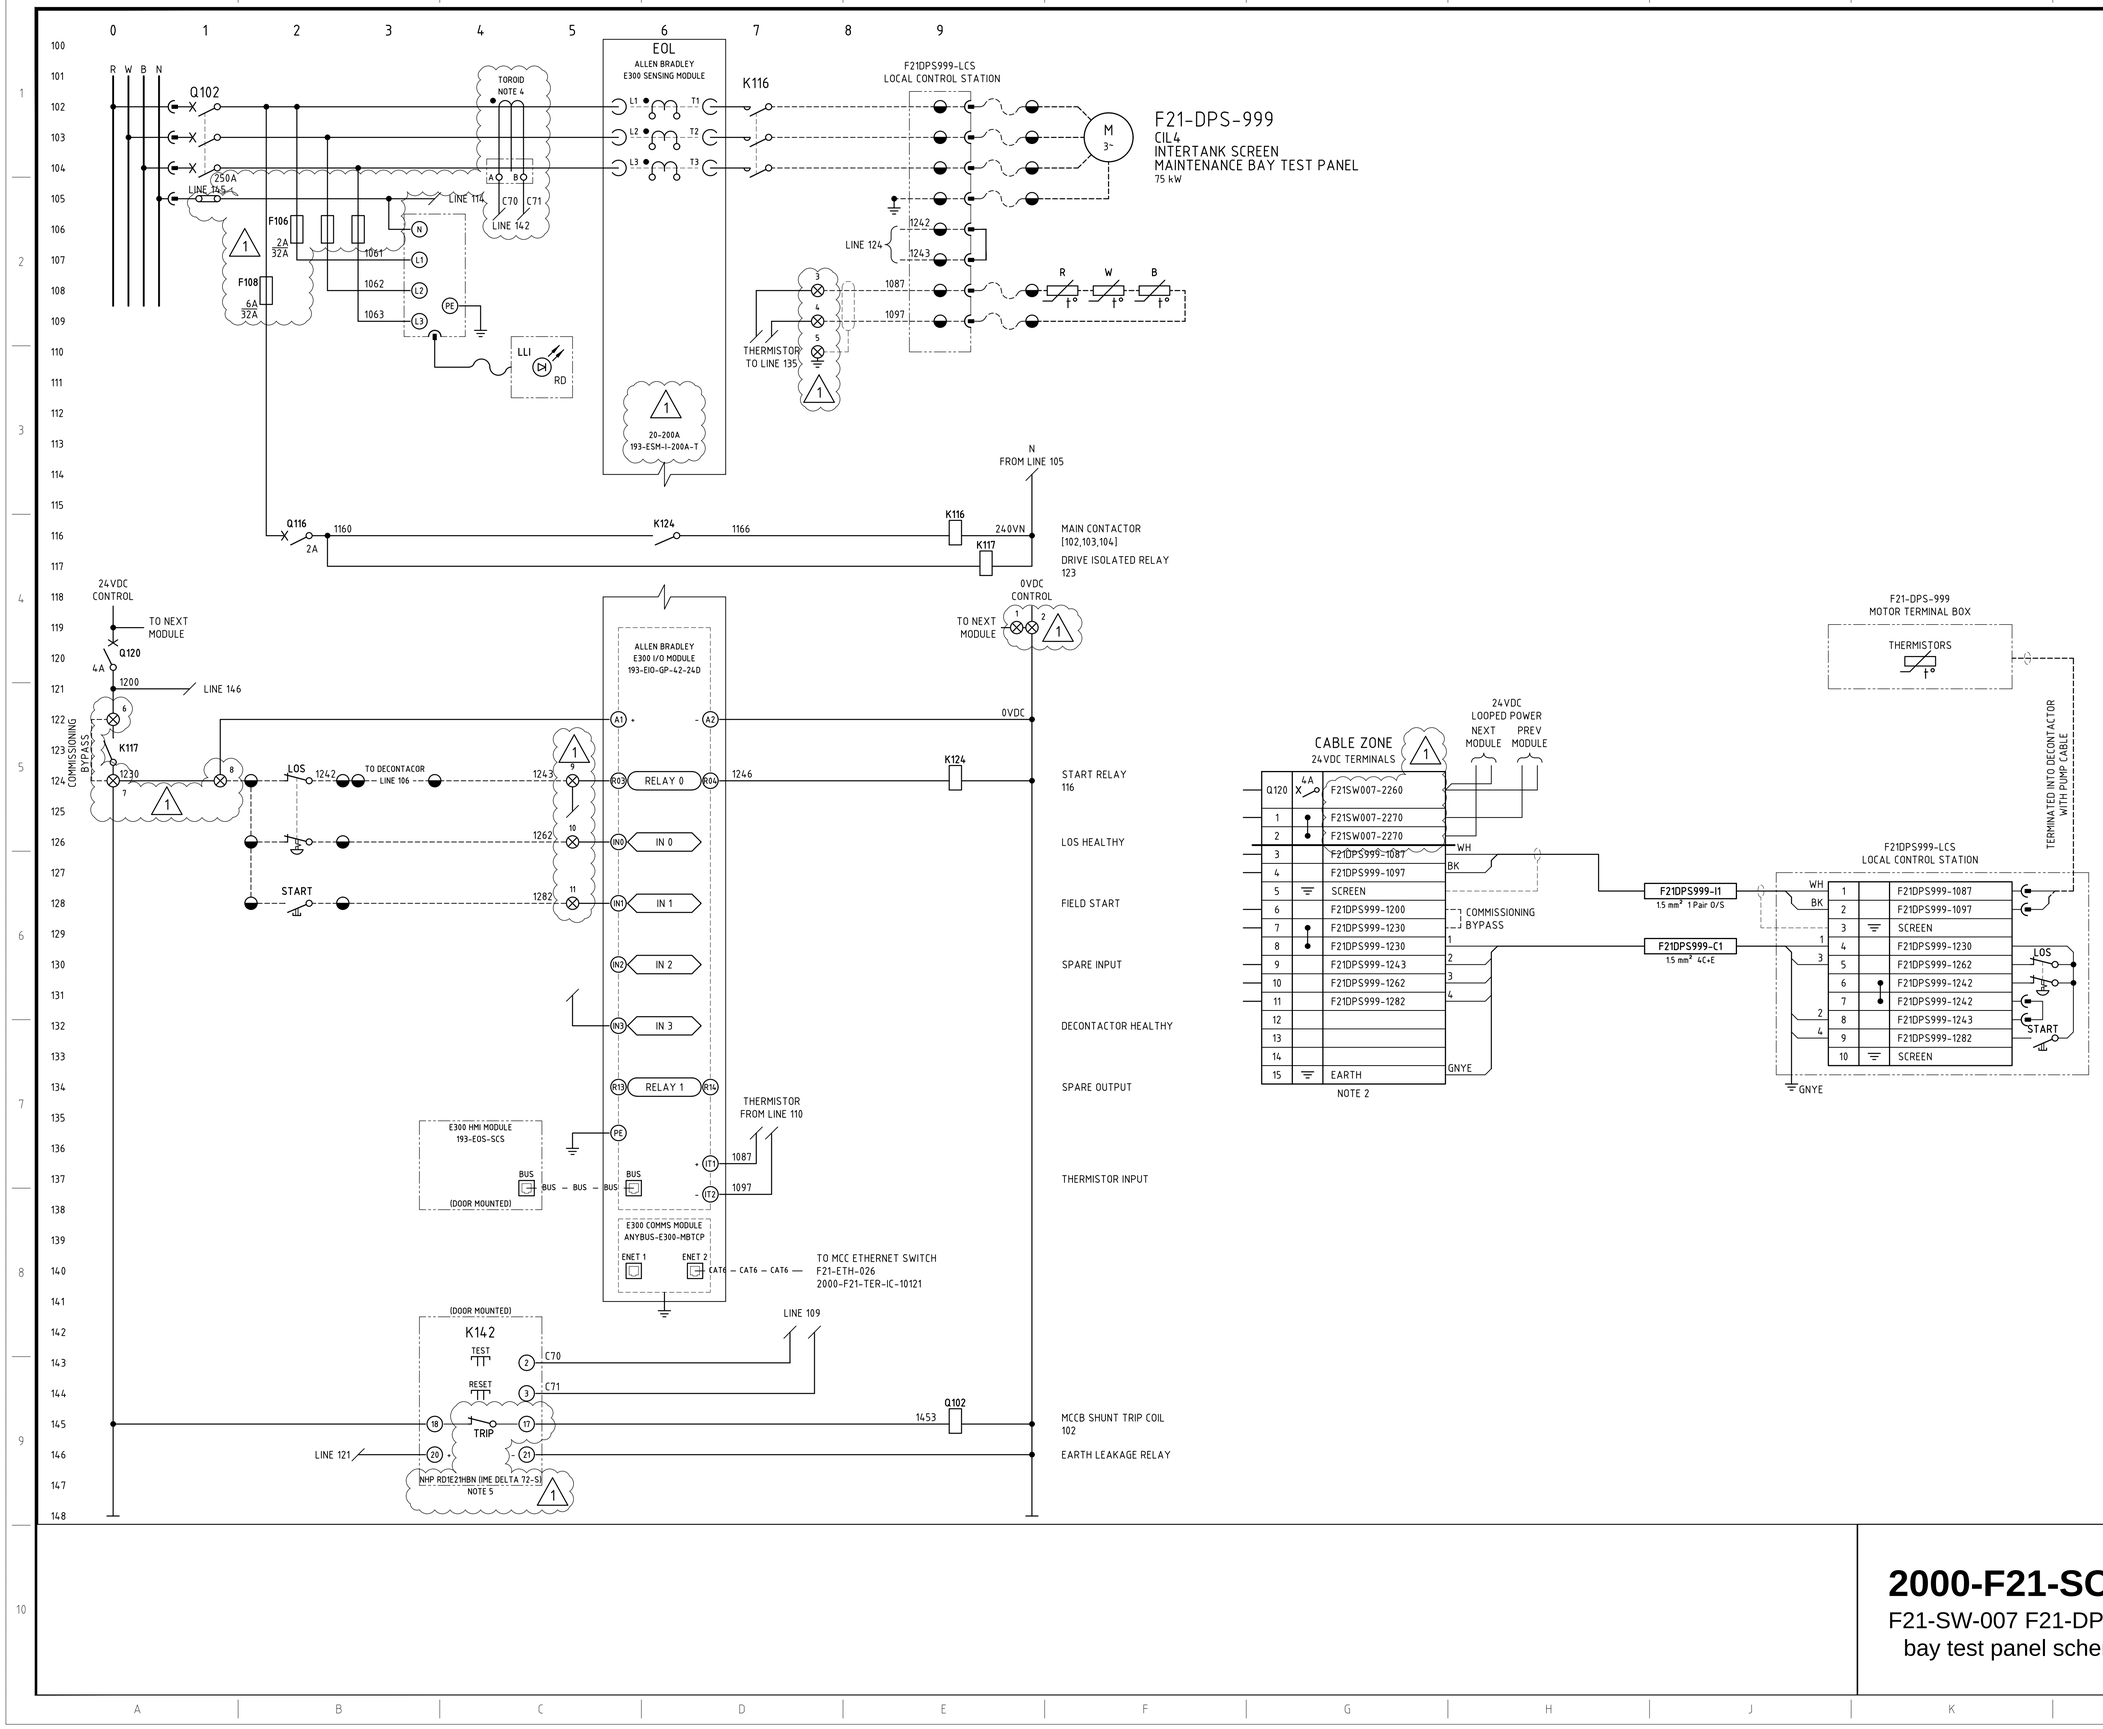


NOTES

1. TERMINALS ON TERMINAL STRIPS ABOVE 50VAC SHALL HAVE A SEPARATE PERSPEX SHROUD AND SHALL BE LABELLED "DANGER xxxVAC".
2. (1) WIRE NUMBER FERRULES ON TERMINAL STRIP SHALL BE PREFIXED WITH EQUIPMENT NUMBER e.g. F21DPS999-1200, UNLESS OTHERWISE NOTED.
3. EACH WIRE SHALL BE IDENTIFIED AT BOTH ENDS WITH FERRULES.
4. NHP TDGH2
   IN:90A IΔN MIN:0.03A TOROID TO SUIT CABLE DIAMETER.
5. EARTH LEAKAGE RELAY (ELV) USER INTERFACE TO BE MOUNTED ON MCC MODULE DOOR. RELAY ENERGISED (NORMALLY CLOSED CONTACT OPEN) IN NORMAL OPERATION. (1)

LEGEND

- 00/01/00 — DCS DIGITAL INPUT
- 00/02/00 — DCS DIGITAL OUTPUT
- ⊗ — MCC TERMINAL
- ◕ — VSD TERMINAL
- ◒ — FIELD TERMINAL
- ◑ — DCS OR I/O TERMINAL
- ◧ — MARSHALLING TERMINAL
- (x) — DEVICE TERMINAL
- ⊗cc — INDICATION LAMP, cc = COLOUR

(1)

TERMINATION LEGEND

Q120	4A X	F21SW007-2xxx	
1		F21SW007-2xxx	
2		F21SW007-2xxx	
3		F21DPS999-1200	RD
4		F21DPS999-1230	BK
5		F21DPS999-1230	GNYE
6		EARTH	

CORE COLOUR/ IDENTIFIER
BARRIER
FERRULE
JUMPER/DISCONNECT/ FUSE/EARTH
TERMINAL No.
DESTINATION

2000-F21-SCM-EL-10280_Rev1

F21-SW-007 F21-DPS-999 CIL4 intertank scn maint. bay test panel schematic and termination diagram

O:\CAD PROJECTS\235 NORTHERN STAR RESOURCES LTD\23517 KCGM GROWTH PROJECT\03 DELIVERABLES\EL\F21 - FLOTATION TAILINGS CIL 4\2000-F21-SCM-EL-10280.DWG 06NOV25 11:07AM HOTSEAT04