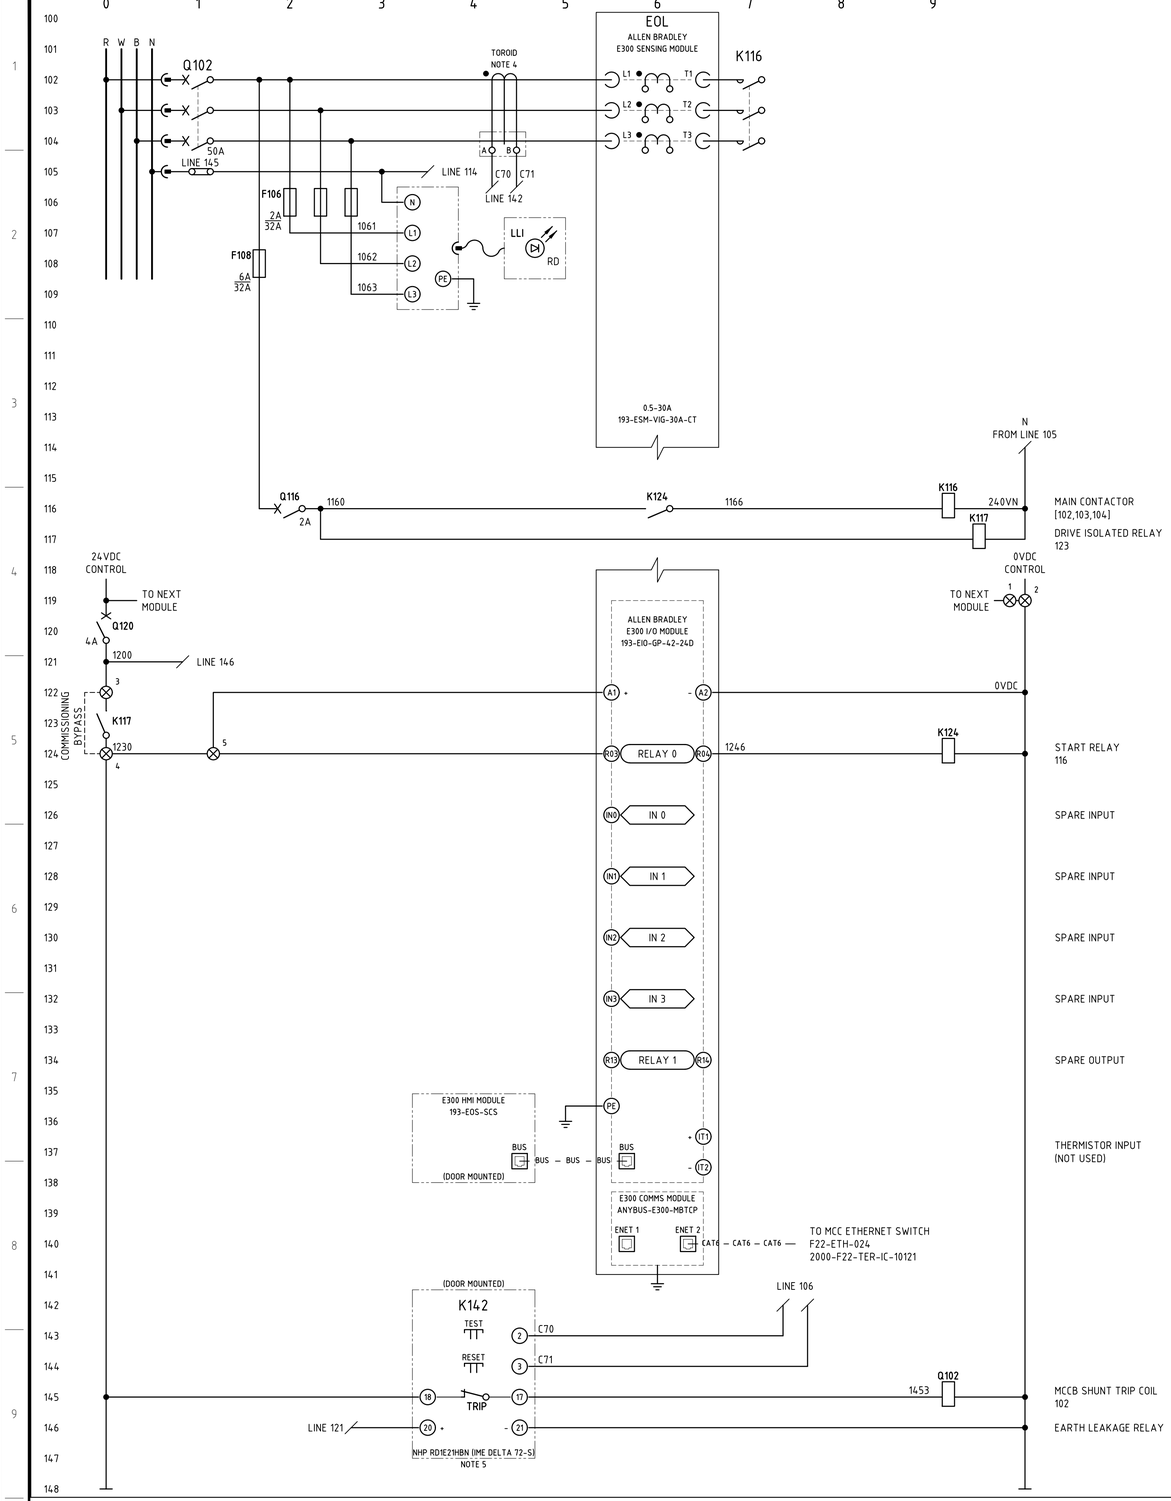



SPARE
15kW

CABLE ZONE
24VDC TERMINALS

| | | |
|---|---|---|
| Q120 | 4A | F22SW031-2260 |
| 1 | | F22SW031-2270 |
| 2 | | F22SW031-2270 |
| 3 | | F22xxxxx-1200 |
| 4 | | F22xxxxx-1230 |
| 5 | | F22xxxxx-1230 |
| 6 | | |
| 7 | | |
| 8 | | |
| 9 | | |
| 10 | | |
| 11 | | |
| 12 | ⏚ | EARTH |

NOTE 2

24VDC LOOPED POWER
NEXT MODULE
PREV MODULE
COMMISSIONING BYPASS


## NOTES

1. TERMINALS ON TERMINAL STRIPS ABOVE 50VAC SHALL HAVE A SEPARATE PERSPEX SHROUD AND SHALL BE LABELLED "DANGER xxxVAC".
2. WIRE NUMBER FERRULES ON TERMINAL STRIP SHALL BE PREFIXED WITH EQUIPMENT NUMBER e.g. F22xxxxx-1200, UNLESS OTHERWISE NOTED.
3. EACH WIRE SHALL BE IDENTIFIED AT BOTH ENDS WITH FERRULES.
4. NHP TDGB2
   IN:70A IΔN MIN:0.03A TOROID TO SUIT CABLE DIAMETER.
5. EARTH LEAKAGE RELAY (ELV) USER INTERFACE TO BE MOUNTED ON MCC MODULE DOOR. RELAY ENERGISED (NORMALLY CLOSED CONTACT OPEN) IN NORMAL OPERATION.

## LEGEND

- 00/01/00 — DCS DIGITAL INPUT
- 00/02/00 — DCS DIGITAL OUTPUT
- ⊗ — MCC TERMINAL
- ◕ — VSD TERMINAL
- ◒ — FIELD TERMINAL
- ◑ — DCS OR I/O TERMINAL
- ◧ — MARSHALLING TERMINAL
- (x) — DEVICE TERMINAL
- ⊗ cc — INDICATION LAMP, cc = COLOUR

## TERMINATION LEGEND

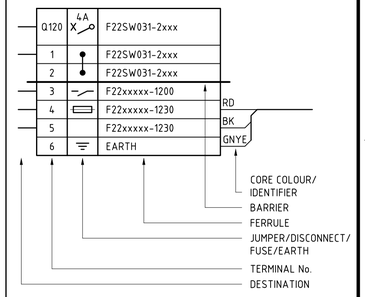


# 2000-F22-SCM-EL-10275_Rev0

F22-SW-031 SPARE 15kW DOL SCHEMATIC AND TERMINATION DIAGRAM