

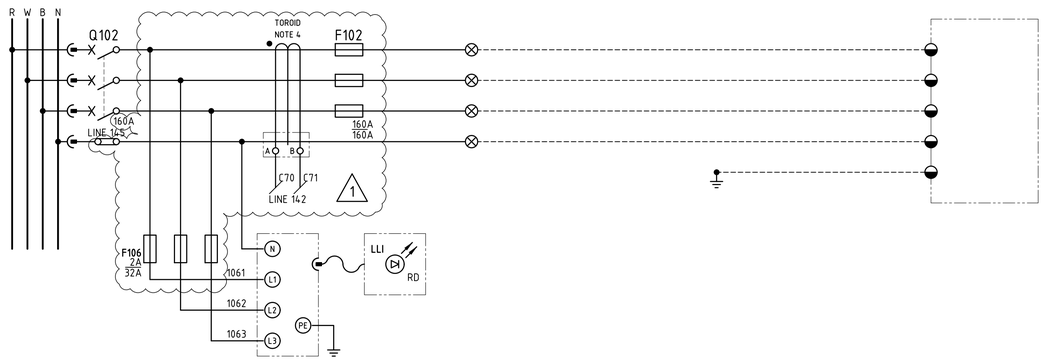


F23-DB-101
FINAL TAILS PUMPS
11kV SWITCHROOM
HV VSD AUXILIARY SUPPLIES DB
160 A

2000-F23-TLD-EL-10054



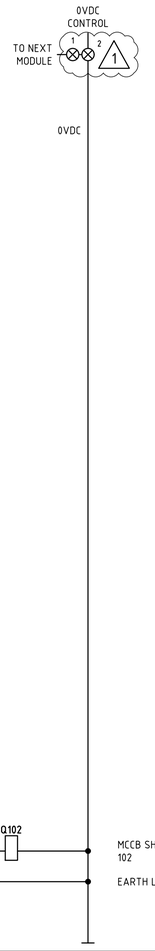


CABLE ZONE
24VDC TERMINALS
1

24VDC
LOOPED POWER
NEXT MODULE
PREV MODULE

Q120	4A	F23SW023-2240
1		F23SW023-2250
2		F23SW023-2250
3		
4		
5		
6		
7		
8	⏚	EARTH

NOTE 2

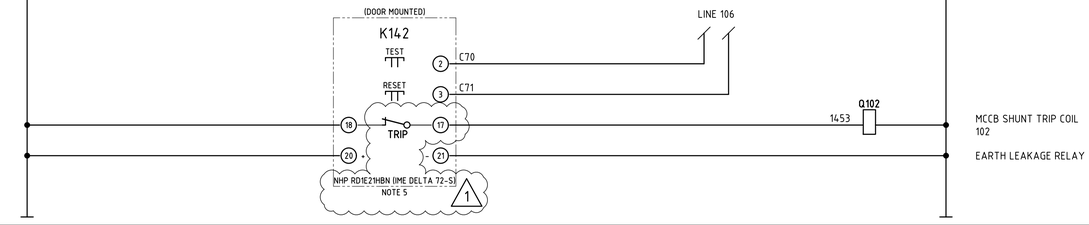

NOTES


1. TERMINALS ON TERMINAL STRIPS ABOVE 50VAC SHALL HAVE A SEPARATE PERSPEX SHROUD AND SHALL BE LABELLED "DANGER xxxVAC".
2. WIRE NUMBER FERRULES ON TERMINAL STRIP SHALL BE PREFIXED WITH EQUIPMENT NUMBER e.g. F23DB101-1200, UNLESS OTHERWISE NOTED. (1)
3. EACH WIRE SHALL BE IDENTIFIED AT BOTH ENDS WITH FERRULES.
4. NHP TDGB2
   IN:70A IΔN MIN:0.03A TOROID TO SUIT CABLE DIAMETER.
5. EARTH LEAKAGE RELAY (ELV) USER INTERFACE TO BE MOUNTED ON MCC MODULE DOOR. RELAY ENERGISED (NORMALLY CLOSED CONTACT OPEN) IN NORMAL OPERATION. (1)

LEGEND

- 00/01/00 — DCS DIGITAL INPUT
- 00/02/00 — DCS DIGITAL OUTPUT
- ⊗ — MCC TERMINAL
- ◕ — VSD TERMINAL
- ◒ — FIELD TERMINAL
- ◑ — DCS OR I/O TERMINAL
- ◧ — MARSHALLING TERMINAL
- ⊗ x — DEVICE TERMINAL
- ⊗ cc — INDICATION LAMP, cc = COLOUR

(1)

TERMINATION LEGEND

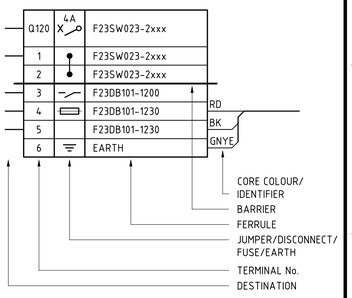

2000-F23-SCM-EL-10224_Rev1

F23-SW-023 F23-DB-101 HV VSD auxiliary supplies
415V DB schematic and termination diagram