
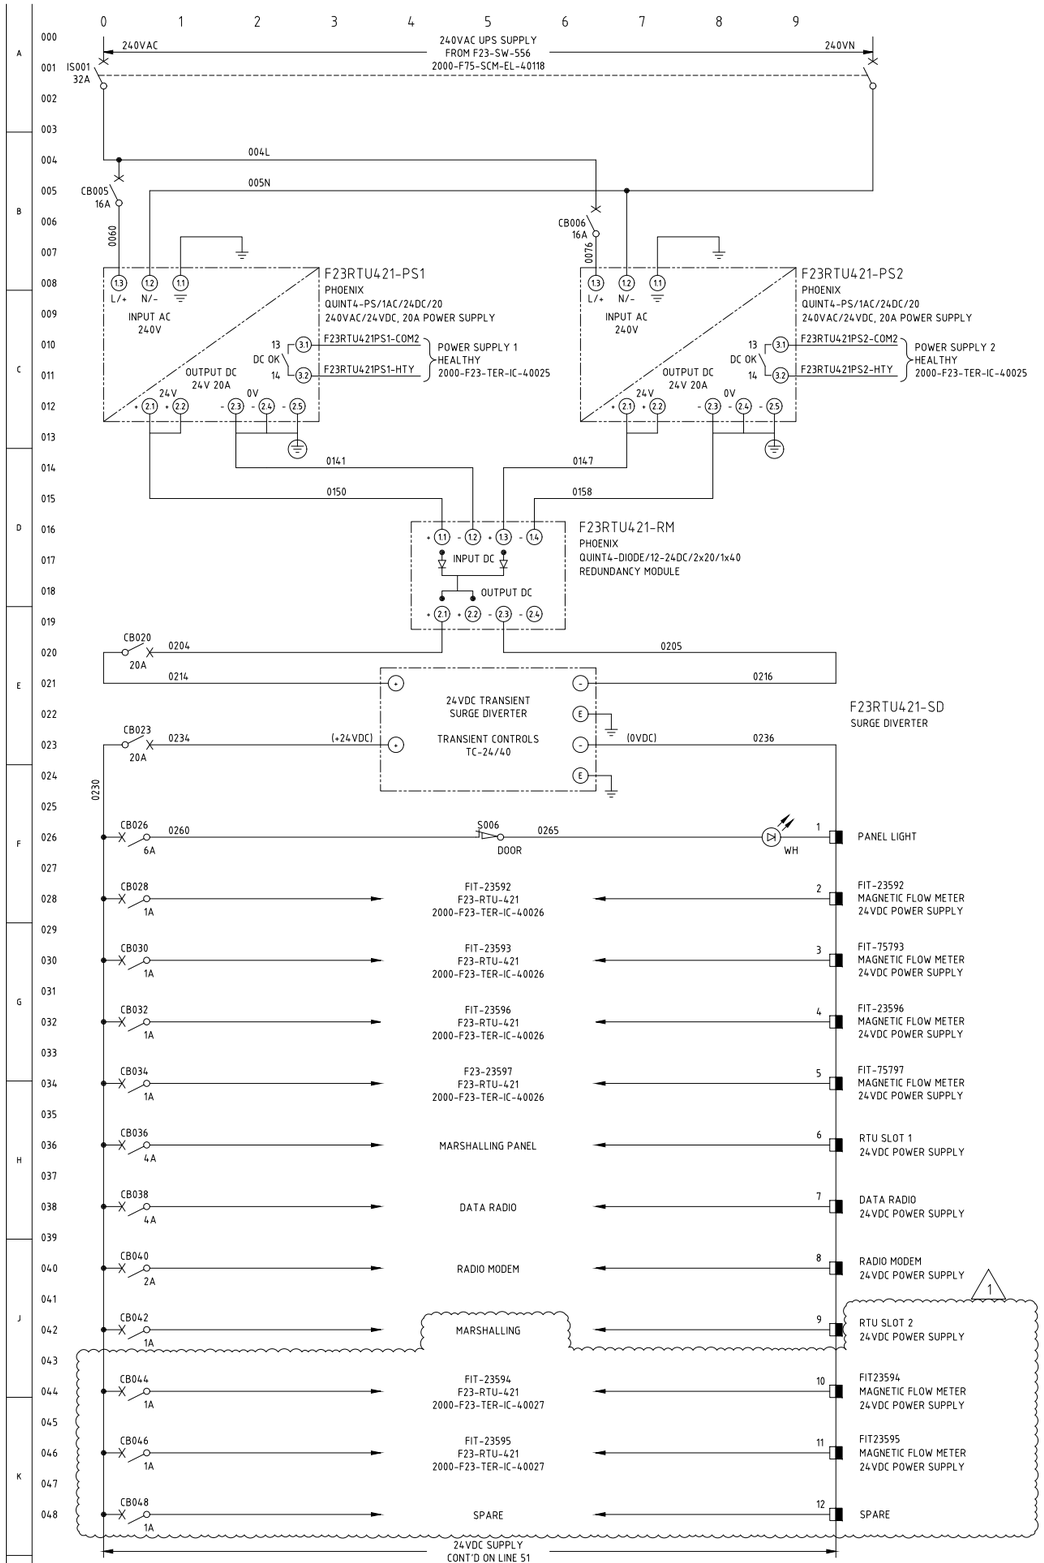


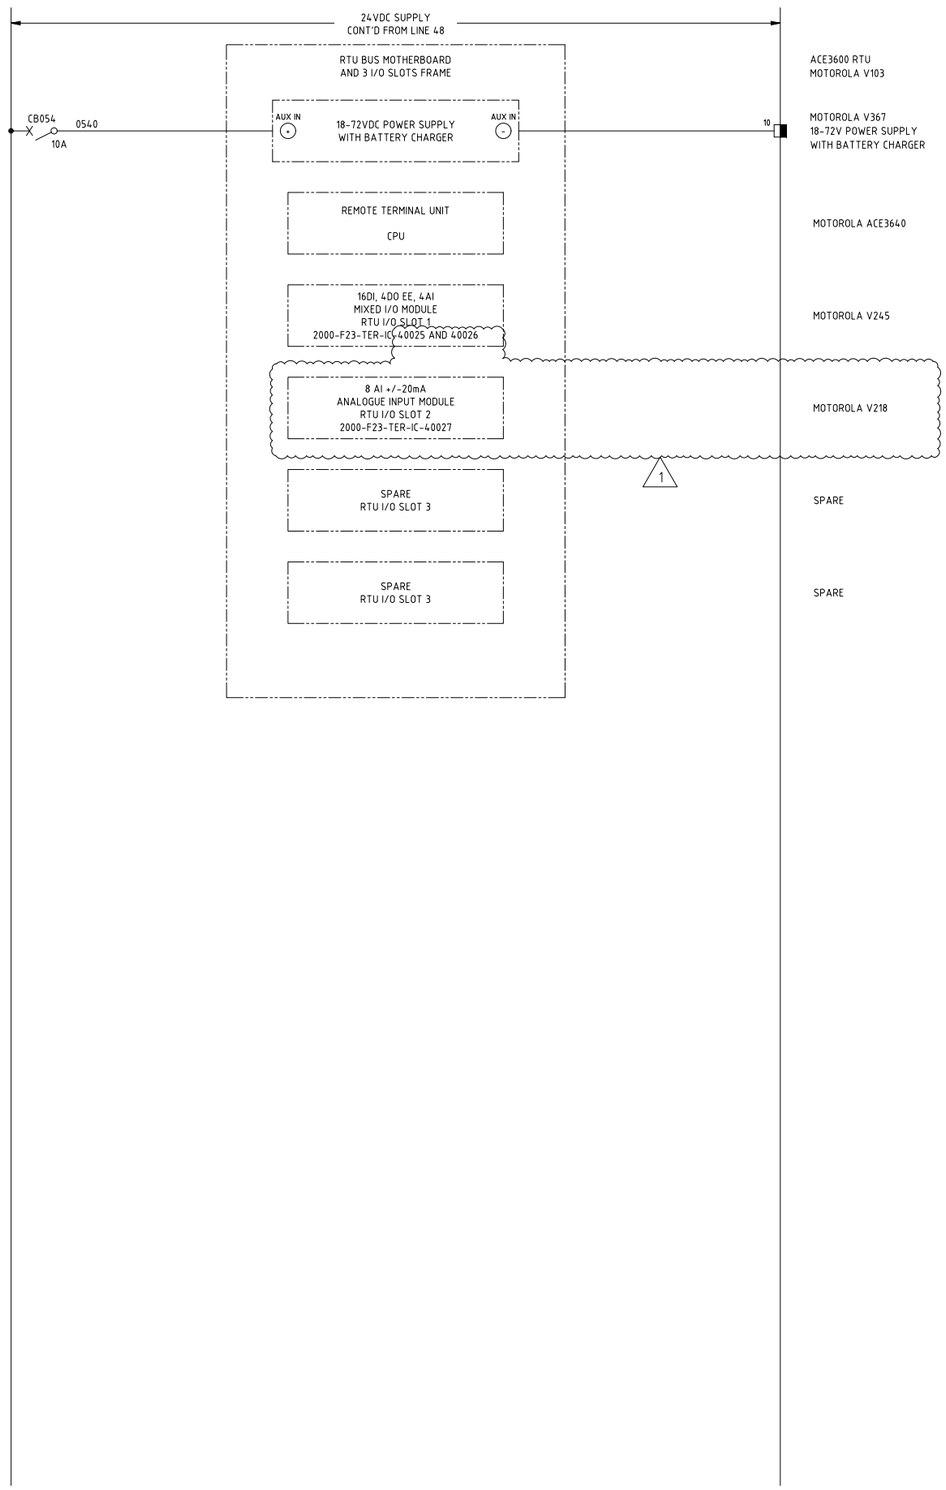

NOTES

1. TERMINALS ON TERMINAL STRIPS ABOVE 50VAC SHALL HAVE A SEPARATE PERSPEX SHROUD AND SHALL BE LABELLED "DANGER xxxVAC".
2. WIRE NUMBER FERRULES ON TERMINAL STRIP SHALL BE PREFIXED WITH EQUIPMENT NUMBER e.g. FxxPPxxx-1200.
3. EACH WIRE SHALL BE IDENTIFIED AT BOTH ENDS WITH FERRULES.

LEGEND

- FIELD TERMINAL
- DCS OR I/O TERMINAL
- MARSHALLING TERMINAL
- DEVICE TERMINAL
- INDICATION LAMP (cc = COLOUR)
- EARTH BAR
- INSTRUMENT EARTH BAR (IEB)

NORTHERN STAR RESOURCES LIMITED

Approved	X
Approved as Noted	☐
Not Approved	☐
For Information Only	

CONTRACTOR OF ITS RESPONSIBILITY OR LIABILITIES
UNDER THE PURCHASE ORDER / CONTRACT

ISSUED FOR CONSTRUCTION

2000-F23-SCM-IC-40020_Rev1

Telemetry panel schematic diagram