

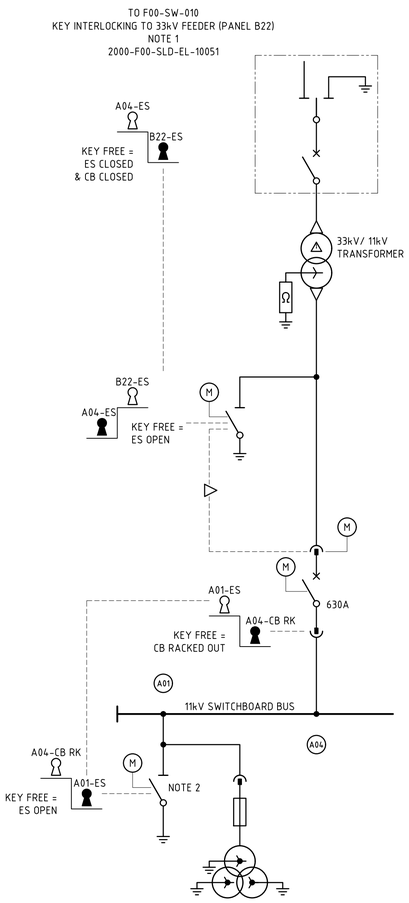


F23-SW-016 11kV INCOMER & BUS
EARTH SWITCH KEY
INTERLOCKING SCHEME
ALL INTERLOCKING IS SINGLE KEY
1 OUT OF 2 INTERLOCKING

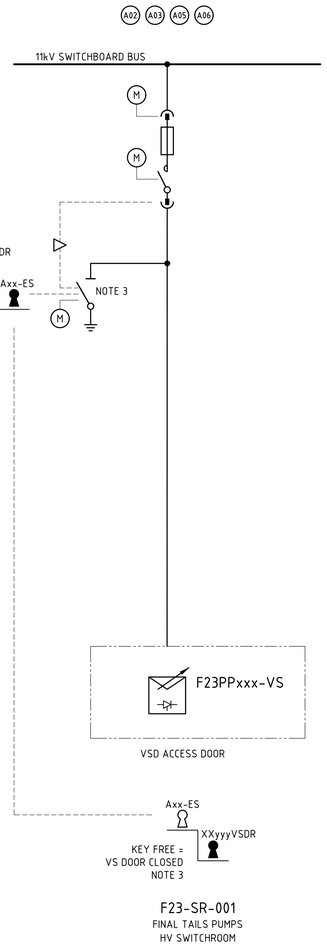


F23-SR-001
FINAL TAILS PUMPS
HV SWITCHROOM

11kV FEEDER TO HV
VSD ACCESS DOOR
KEY INTERLOCKING SCHEME
ALL INTERLOCKING IS SINGLE KEY
1 OUT OF 2 INTERLOCKING

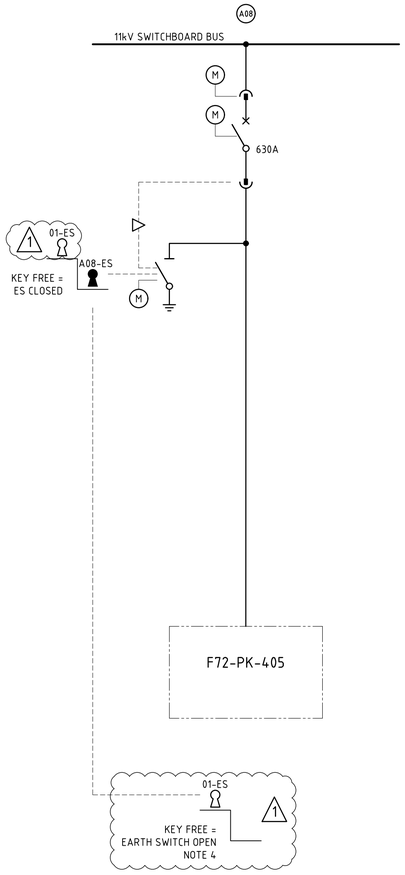

F72-PK-405
OXYGEN PLANT VSA PACKAGE

11kV FEEDER TO OXYGEN PLANT INCOMER EARTH SWITCH
KEY INTERLOCKING SCHEME
ALL INTERLOCKING IS SINGLE KEY
1 OUT OF 2 INTERLOCKING
2000-S021-D01-20001

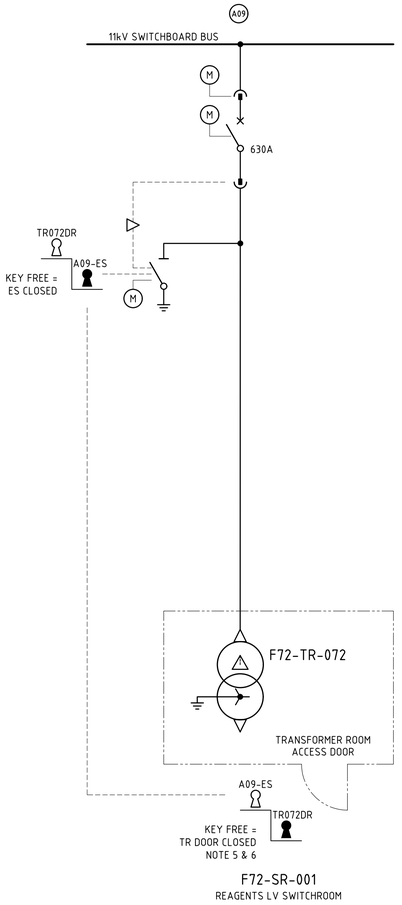

F72-SR-001
REAGENTS LV SWITCHROOM

11kV FEEDER TO 415V SWITCHROOM
TRANSFORMER ACCESS DOOR
KEY INTERLOCKING SCHEME
ALL INTERLOCKING IS SINGLE KEY
1 OUT OF 2 INTERLOCKING

NOTES

1. UPSTREAM 33kV FEEDER 3 POSITION SWITCH KEY INTERLOCKED WITH THE 11kV SWITCHBOARD INCOMER EARTH SWITCH SUCH THAT THE UPSTREAM 3 POSITION SWITCH MUST BE CLOSED IN THE EARTH POSITION AND THE FEEDER CIRCUIT BREAKER CLOSED WHEN THE 11kV INCOMER EARTH SWITCH IS CLOSED.
2. BUS EARTH SWITCH AND INCOMER CIRCUIT BREAKER SHALL BE KEY INTERLOCKED SUCH THAT BUS EARTH SWITCH CANNOT BE CLOSED WHILE INCOMER CIRCUIT BREAKER IS RACKED IN.
3. HV VSD ACCESS DOOR SHALL BE FORTRESS KEY INTERLOCKED WITH THE UPSTREAM FEEDER EARTH SWITCH.
4. OXYGEN PLANT INCOMER EARTH SWITCH ACCESS DOOR SHALL BE FORTRESS KEY INTERLOCKED WITH THE UPSTREAM FEEDER EARTH SWITCH.
5. 415V MCC TRANSFORMER ROOM ACCESS DOOR SHALL BE FORTRESS KEY INTERLOCKED WITH THE UPSTREAM FEEDER EARTH SWITCH.
6. TRANSFORMER ENCLOSURE DOOR STATUS SHALL BE MONITORED BY THE DCS. OPENING THE DOOR SHALL RAMP STOP THE RELEVANT SWITCHROOM AREA AND OPEN THE UPSTREAM CIRCUIT BREAKER.

LEGEND

- MECHANICAL OR ELECTRICAL INTERLOCK DEVICE
- KEY FREE
- KEY CAPTIVE

NORTHERN STAR

Approved	X
Approved as Noted	
Not Approved	
For Information Only	

ACCEPTANCE DOES NOT RELIEVE THE SUPPLIER / CONTRACTOR OF ITS RESPONSIBILITY OR LIABILITIES UNDER THE PURCHASE ORDER / CONTRACT

2000-F23-SLD-EL-10051_Rev1

Final tailings handling & storage F23-SW-016 11kV switchboard key interlocking single line diagram