

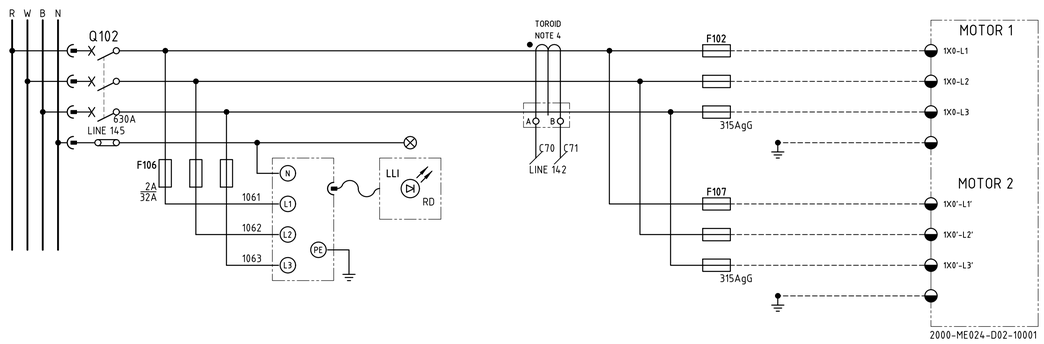


F24-CM-401
PLANT AIR
COMPRESSOR 1
308.6 kW





CABLE ZONE
24VDC TERMINALS

24VDC LOOPED POWER


			NEXT MODULE	PREV MODULE
Q120	4A	F16SW005-2220		
1		F16SW005-2230		
2		F16SW005-2230		
3				
4				
5				
6				
7				
8	⏚	EARTH		

NOTE 2


NOTES

1. TERMINALS ON TERMINAL STRIPS ABOVE 50VAC SHALL HAVE A SEPARATE PERSPEX SHROUD AND SHALL BE LABELLED "DANGER xxxVAC".
2. WIRE NUMBER FERRULES ON TERMINAL STRIP SHALL BE PREFIXED WITH EQUIPMENT NUMBER e.g. F24CM401-1200, UNLESS OTHERWISE NOTED.
3. EACH WIRE SHALL BE IDENTIFIED AT BOTH ENDS WITH FERRULES.
4. NHP TDGF2
   IN:400A IΔN MIN:0.3A TOROID TO SUIT CABLE DIAMETER.
5. EARTH LEAKAGE RELAY (ELV) USER INTERFACE TO BE MOUNTED ON MCC MODULE DOOR. RELAY ENERGISED (NORMALLY CLOSED CONTACT OPEN) IN NORMAL OPERATION.

LEGEND

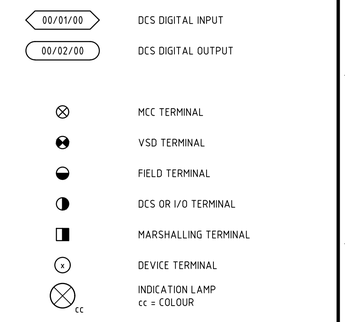

TERMINATION LEGEND

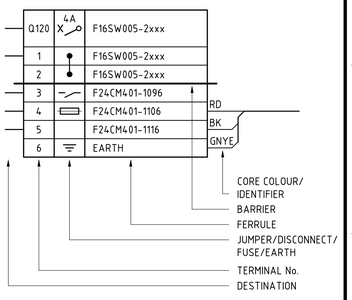

2000-F24-SCM-EL-10601_Rev2

F16-SW-005 - F24-CM-401 plant air compressor 1 - schematic and termination diagram