




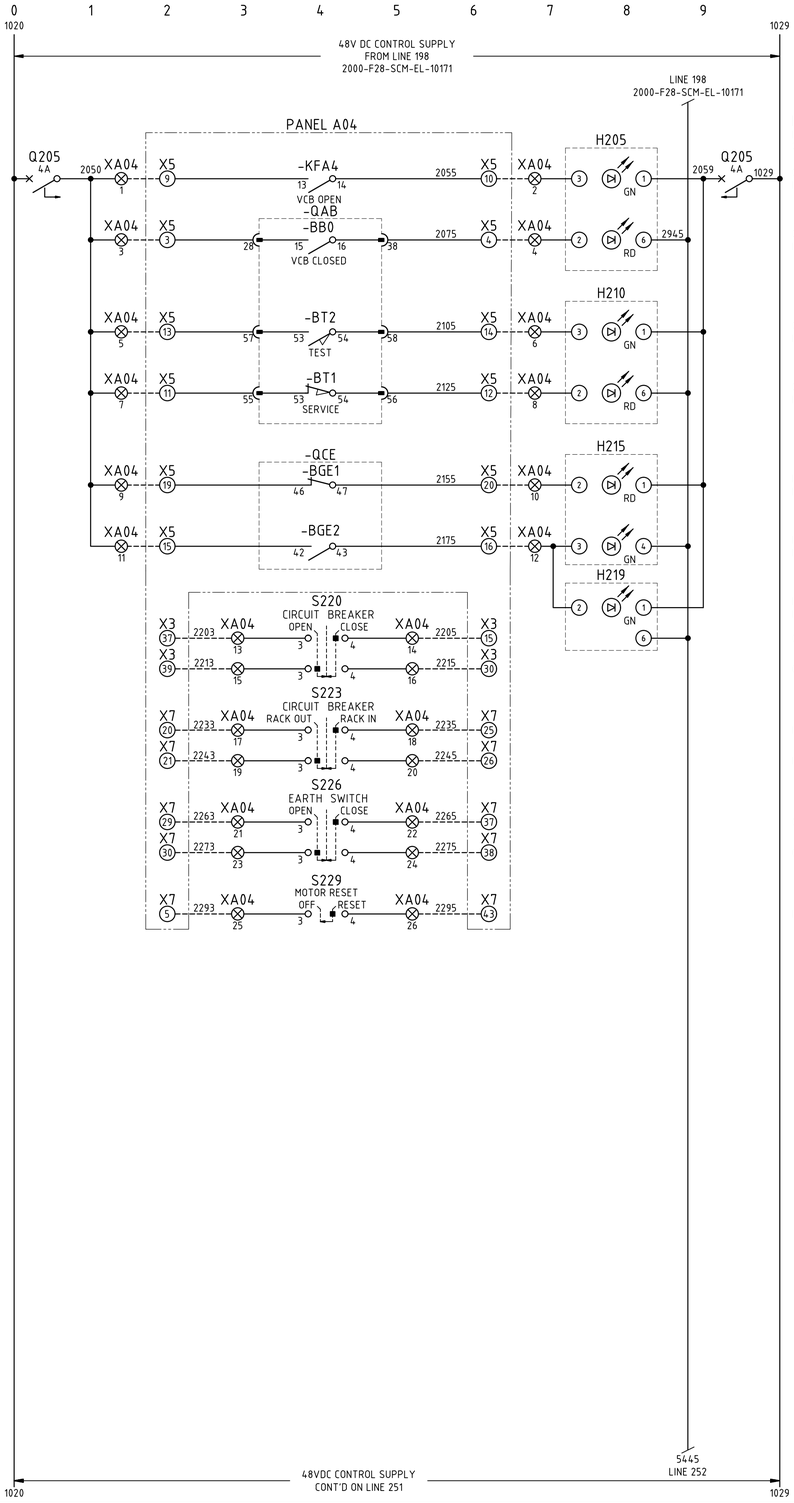

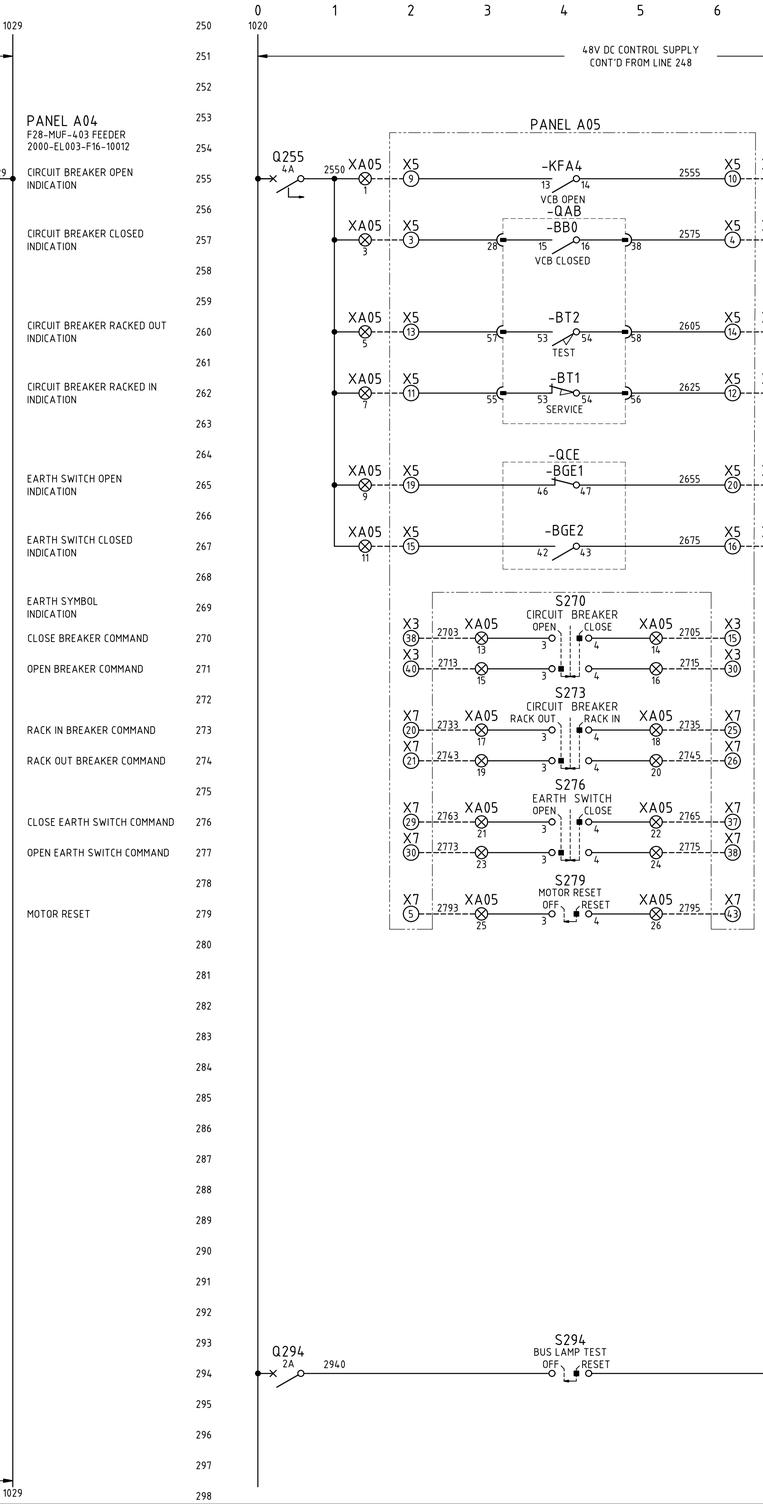

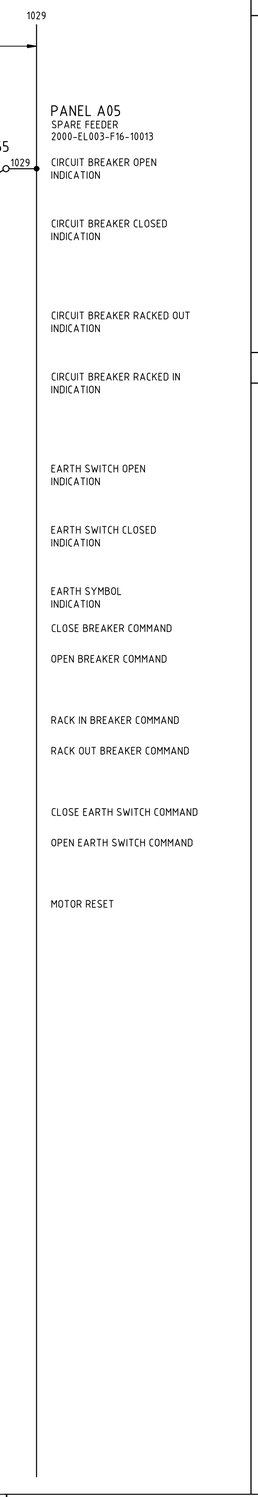


## NOTES

1. WIRE NUMBER FERRULES ON TERMINAL STRIP SHALL BE PREFIXED WITH EQUIPMENT NUMBER e.g. FxxPPxxx-1200, UNLESS OTHERWISE NOTED.
2. EACH WIRE SHALL BE IDENTIFIED AT BOTH ENDS WITH FERRULES.

## LEGEND

- RSP TERMINAL
- Xx (xx) HV SWITCHBOARD TERMINAL
- (x) DEVICE TERMINAL

# 2000-F28-SCM-EL-10172_Rev2

F28SW013-LCS - 11kV SWITCHBOARD REMOTE SWITCHING PANEL - SCHEMATIC DIAGRAM SHEET 2