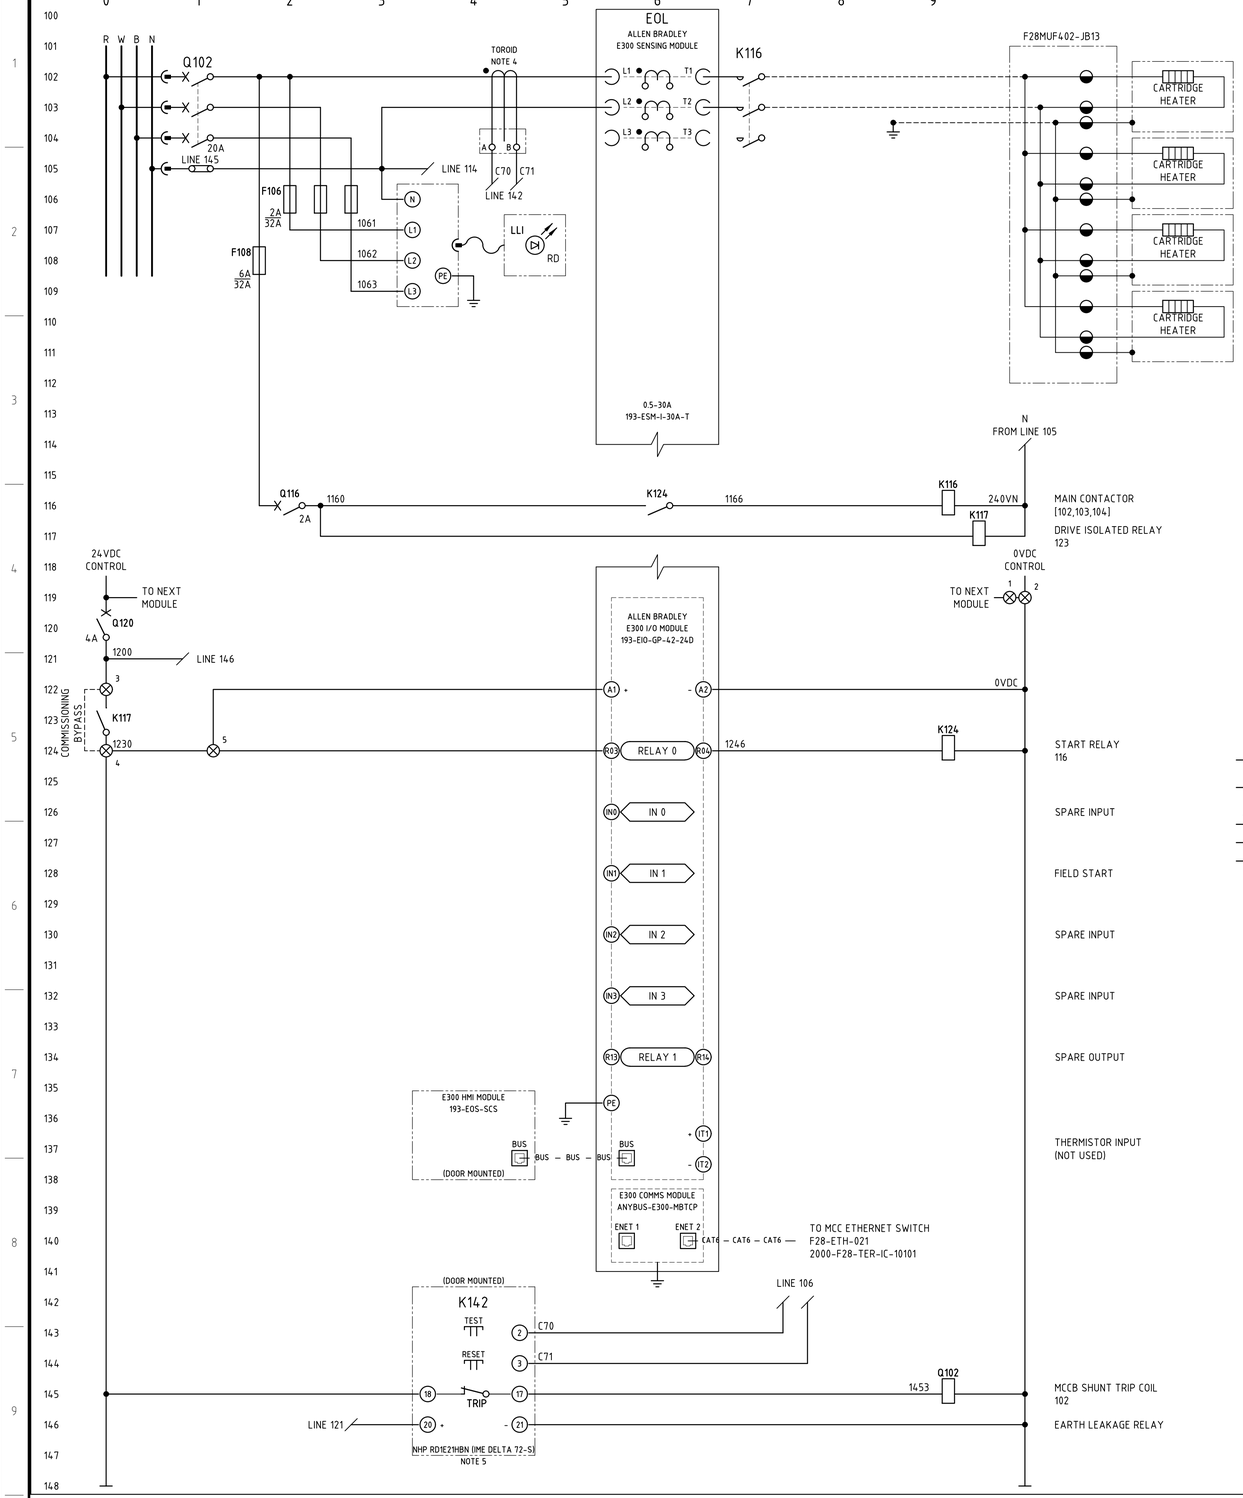


F28-HT-481

UFG MILL 2
BEARING OLS
HEATERS
2.4 kW

CABLE ZONE

24VDC TERMINALS

24VDC LOOPED POWER
NEXT MODULE — PREV MODULE

Q120	4A	F12SW001-2220	
1		F12SW001-2230	
2		F12SW001-2230	
3		F28HT481-1200	COMMISSIONING BYPASS
4		F28HT481-1230	
5			
6			
7			
8			
9			
10			
11			
12			
13	⏚	EARTH	

NOTE 2

NOTES

1. TERMINALS ON TERMINAL STRIPS ABOVE 50VAC SHALL HAVE A SEPARATE PERSPEX SHROUD AND SHALL BE LABELLED "DANGER xxxVAC".
2. WIRE NUMBER FERRULES ON TERMINAL STRIP SHALL BE PREFIXED WITH EQUIPMENT NUMBER e.g. F28HT481-1200, UNLESS OTHERWISE NOTED.
3. EACH WIRE SHALL BE IDENTIFIED AT BOTH ENDS WITH FERRULES.
4. NHP TDGB2
   IN:70A IΔN MIN:0.03A TOROID TO SUIT CABLE DIAMETER.
5. EARTH LEAKAGE RELAY (ELV) USER INTERFACE TO BE MOUNTED ON MCC MODULE DOOR. RELAY ENERGISED (NORMALLY CLOSED CONTACT OPEN) IN NORMAL OPERATION.

LEGEND

00/01/00	DCS DIGITAL INPUT
00/02/00	DCS DIGITAL OUTPUT
⊗	MCC TERMINAL
◓	VSD TERMINAL
◒	FIELD TERMINAL
◑	DCS OR I/O TERMINAL
◧	MARSHALLING TERMINAL
ⓧ	DEVICE TERMINAL
⊗ cc	INDICATION LAMP cc = COLOUR

TERMINATION LEGEND

Q120	4A	F28SW009-2xxx	
1		F28SW009-2xxx	
2		F28SW009-2xxx	
3		F28HT481-1200	
4		F28HT481-1230	RD
5		F28HT481-1230	BK
6	⏚	EARTH	GNYE

CORE COLOUR/ IDENTIFIER
BARRIER
FERRULE
JUMPER/DISCONNECT/ FUSE/EARTH
TERMINAL No.
DESTINATION

2000-F28-SCM-EL-10216_Rev2

F28-SW-009 - F28-HT-481 UFG mill 2 bearing ols heaters - schematic and termination diagram