
SUBSTATION No. 35

MILLING CIRCUIT 2 FILTRATION/GOLDROOM

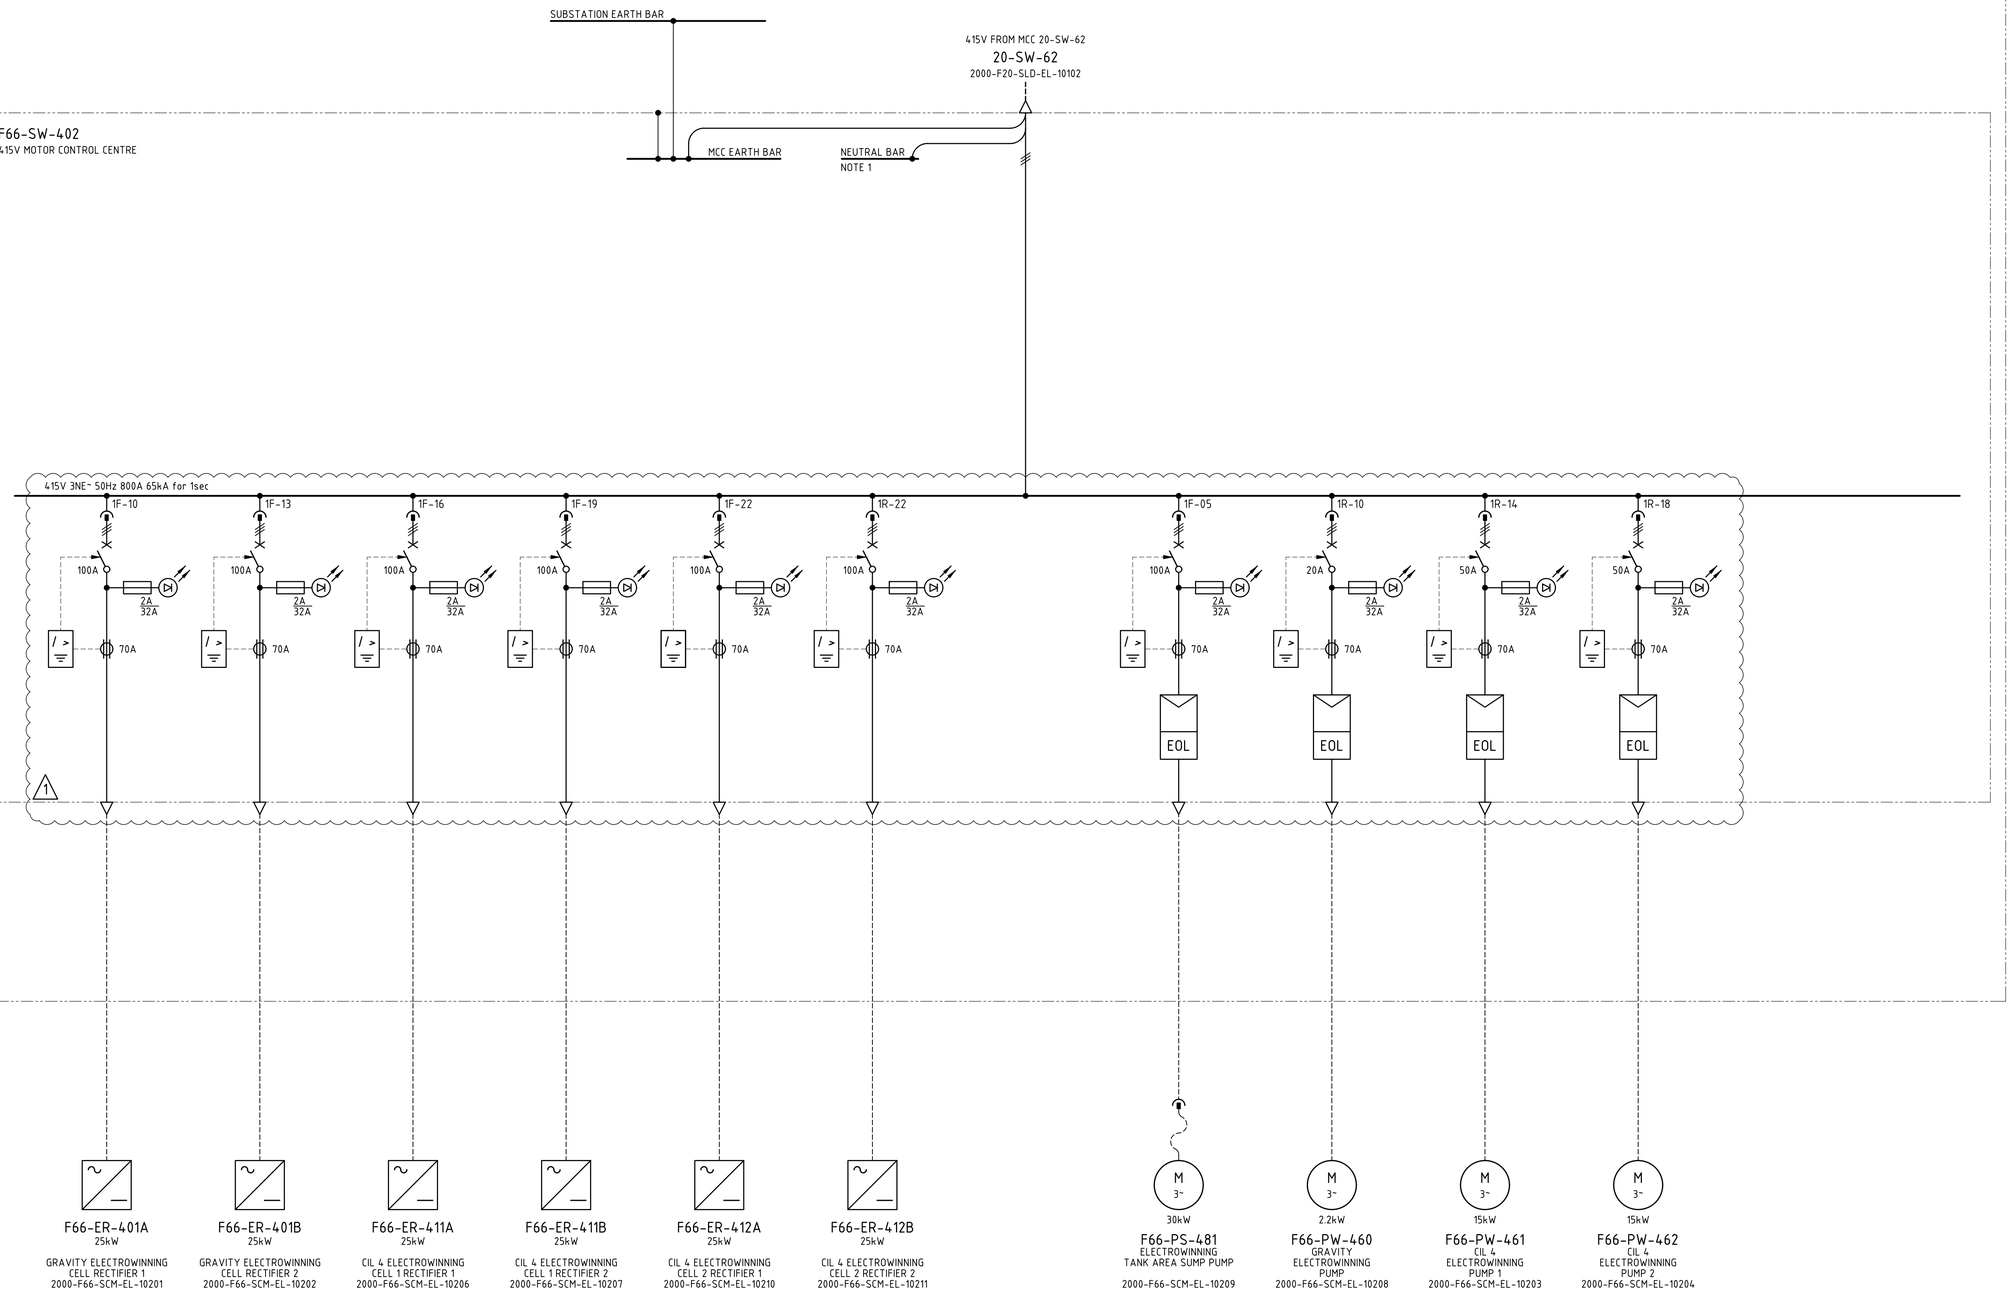

NOTES

1. EARTH-NEUTRAL LINK INSTALLED IN UPSTREAM 20-SW-62 INCOMER. SIGNAGE SHALL BE PLACED ON F66-SW-402 INCOMING SUPPLY SECTION READING "M.E.N. LINK LOCATED IN 20-SW-62".
2. SWITCHBOARD VENDOR SHALL SELECT SWITCHGEAR TO PROVIDE TYPE-2 CO-ORDINATION SUITABLE FOR HIGH EFFICIENCY MOTORS.
3. ALL DRIVE I/O VIA COMMS NETWORK TO DCS.
4. ANY DRIVE RTDs SHALL BE WIRED TO DEDICATED REMOTE I/O CARDS IN THE FIELD. RTD RELAYS MAY BE INCLUDED IN THE MCC MODULE WITH ENGINEERING APPROVAL.
5. CIRCUIT BREAKER TO BE SUBSTITUED FOR FUSED-SWITCH WHERE REQUIRED BY EQUIPMENT MANUFACTURERS GUIDELINES.

LEGEND

- DIRECT ON-LINE MOTOR STARTER GENERIC
- EOL — ELECTRONIC OVERLOAD UNIT
- EARTH LEAKAGE RELAY
- FIELD-MOUNTED DECONTACTOR
- CIRCUIT BREAKER (NOTE 5)
  - xxxA — ST TRIP SET POINT
  - xxxA — CB SIZE

Approved	☒
Approved as Noted	☐
Not Approved	☐
For Information Only	

ACCEPTANCE DOES NOT RELIEVE THE SUPPLIER / CONTRACTOR OF ITS RESPONSIBILITY OR LIABILITIES UNDER THE PURCHASE ORDER / CONTRACT

2000-F66-SLD-EL-10101_Rev1

Milling CCT 2 filtration/goldroom substation no. 35
MCC F66-SW-402 single line diagram