
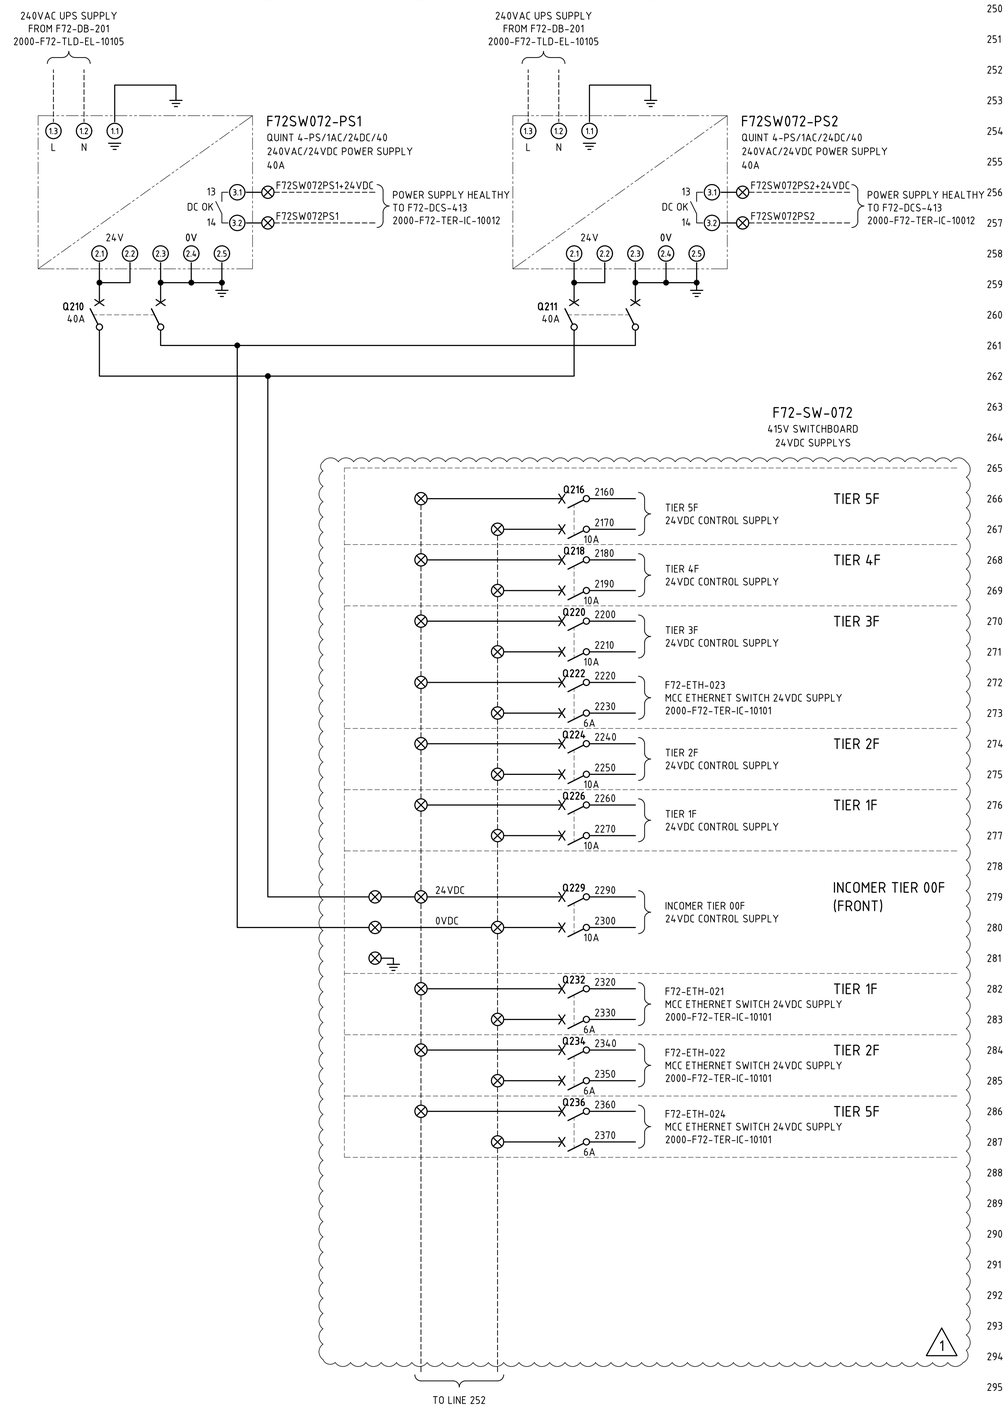


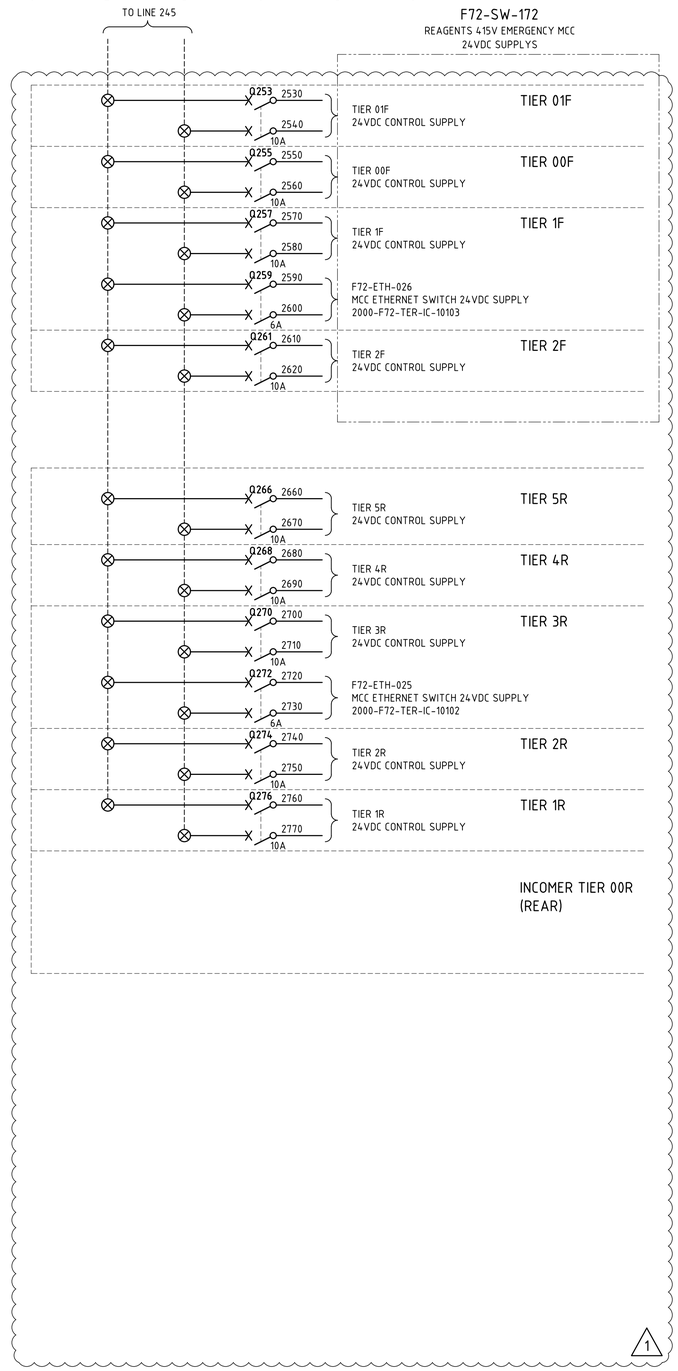

NOTES


1. TERMINALS ON TERMINAL STRIPS ABOVE 50VAC SHALL HAVE A SEPARATE PERSPEX SHROUD AND SHALL BE LABELLED "DANGER xxxVAC".
2. WIRE NUMBER FERRULES ON TERMINAL STRIP SHALL BE PREFIXED WITH EQUIPMENT NUMBER e.g. F72SW072-1200 UNLESS OTHERWISE NOTED.
3. EACH WIRE SHALL BE IDENTIFIED AT BOTH ENDS WITH FERRULES.

LEGEND

- 00/01/00 — DCS DIGITAL INPUT
- 00/02/00 — DCS DIGITAL OUTPUT
- MCC TERMINAL
- VSD TERMINAL
- FIELD TERMINAL
- DCS OR I/O TERMINAL
- MARSHALLING TERMINAL
- DEVICE TERMINAL
- INDICATION LAMP (cc = COLOUR)

TERMINATION LEGEND

1	●	F72SW072-24VDC
2	●	F72SW072-24VDC
3	●	F72SW072-0VDC
4	●	F72SW072-0VDC
5	⏦	F72SW072-1096
6	▭	F72SW072-1106
7		F72SW072-1116
8	⏚	EARTH

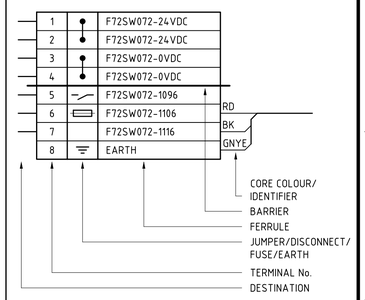

1

2000-F72-SCM-EL-10224_Rev1

F72-SW-072 F72-SW-072 24VDC distribution schematic diagram