
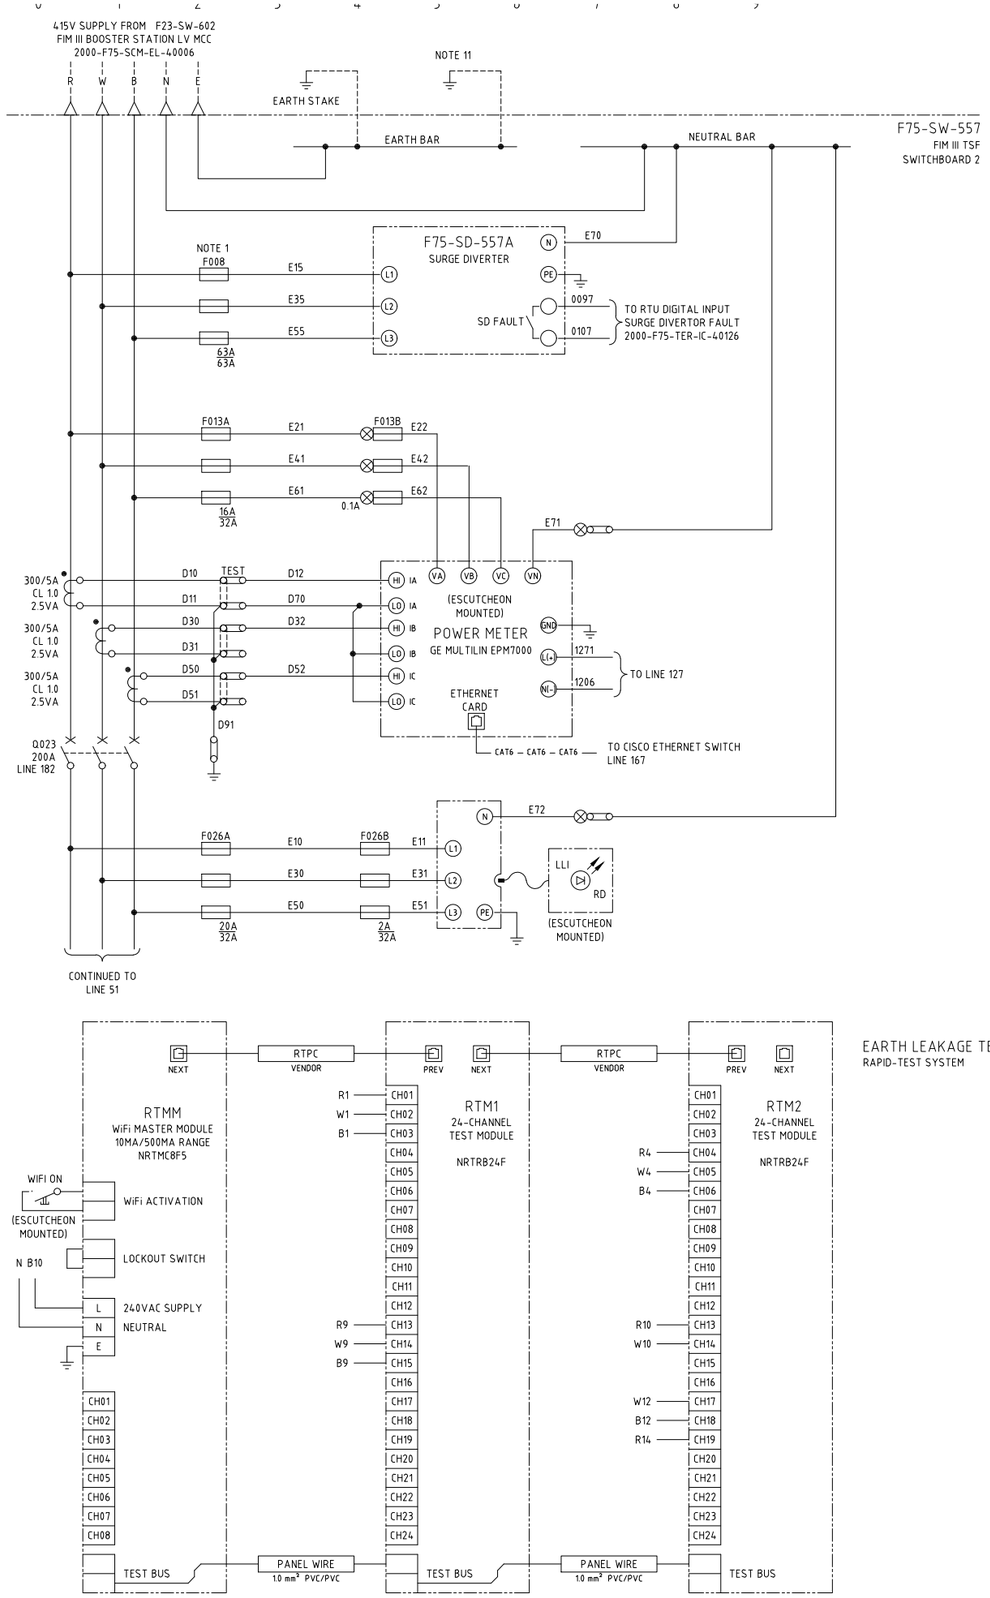


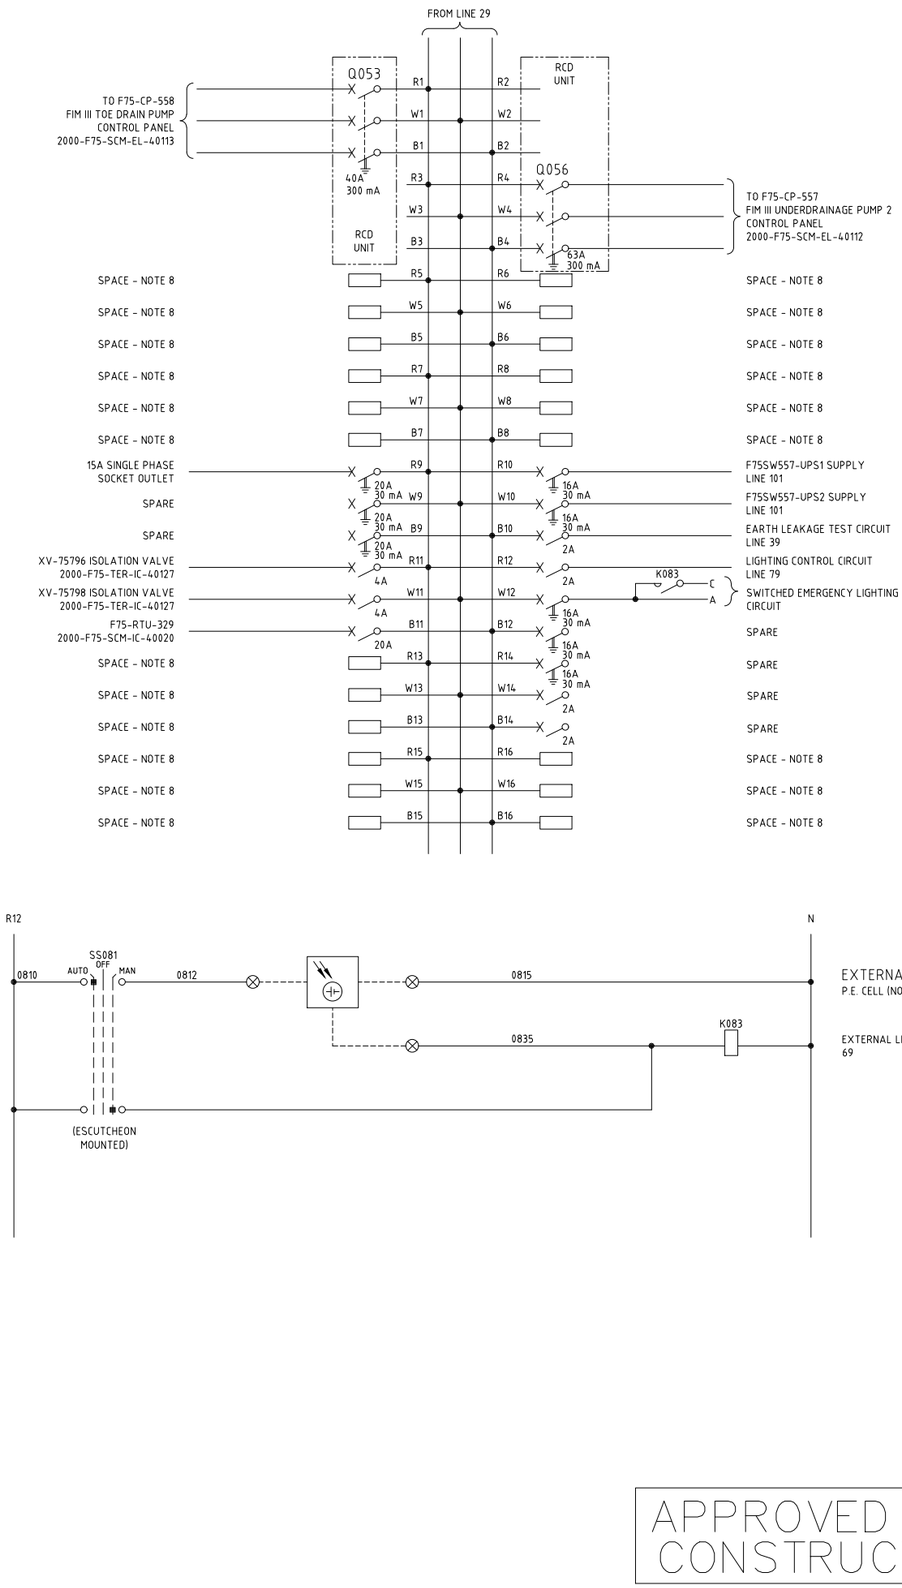

NOTES

1. SURGE DIVERTER FUSES SHALL BE SIZED BY VENDOR TO SUIT DUTY.
2. MINIATURE CIRCUIT BREAKERS SHALL BE SIZED AND RATED TO SUIT INCOMER REQUIREMENTS.
3. ALL TERMINATIONS ABOVE 50VAC SHALL BE TO IP2x OR ABOVE, IF NOT, TO HAVE A SEPARATE PERSPEX SHROUD FITTED AND SHALL BE LABELLED "DANGER xxxVAC".
4. WIRE NUMBER FERRULES ON TERMINAL STRIP SHALL BE PREFIXED WITH EQUIPMENT NUMBER e.g. F75SW557-XXXX, UNLESS NOTED OTHERWISE.
5. EACH WIRE SHALL BE IDENTIFIED AT BOTH ENDS WITH FERRULES.
6. THREE PHASE CIRCUITS SHALL ALWAYS BE PLACED ACROSS CIRCUIT RWB - i.e. R7, W7, B7 - NEVER ACROSS MIXED CIRCUITS i.e. B5, R7, W7.
7. CIRCUIT BREAKERS SHALL BE PAD-LOCKABLE IN THE 'OFF' POSITION ONLY, VIA LOCK-DOGS OR SIMILAR, LOCKING TO ESCUTCHEON SHALL NOT BE ACCEPTABLE.
8. ALL SPARE SPACE SHALL BE FILLED WITH DUMMY CIRCUIT BREAKERS, ESCUTCHEON POLE FILLERS SHALL NOT BE ACCEPTABLE.
9. ESCUTCHEON SHALL BE KEYED TO MAIN ISOLATOR HANDLE SUCH THAT ESCUTCHEON CANNOT BE REMOVED WHILE BOARD IS LIVE.
10. NEUTRAL CIRCUITS FED FROM RCDs MUST BE WIRED BACK TO THE NEUTRAL OF THE RCD, NOT THE NEUTRAL BAR.
11. EQUIPOTENTIAL BONDING CONDUCTOR SHALL BE INSTALLED FROM SWITCHBOARD EARTH BAR TO EQUIPMENT OUTLINED IN ELCTRICAL INSTALLATION SPEC 2000-F00-STS-EL-10012 VIA 35mm² Cu GNYE/PVC.
12. 6kA MINIATURE CIRCUIT BREAKERS SHALL ONLY BE USED WITH ENGINEERING APPROVAL.
13. AS-BUILT CIRCUIT SCHEDULE SHALL BE KEPT INTERNAL TO SWITCHBOARD AT ALL TIMES.
14. P.E. CELL SHALL BE INSTALLED OUT OF DIRECT LINE OF ANY LIGHTING.
15. EARTH-NEUTRAL LINK SHALL BE INSTALLED IN BOOSTER STATION MCC F23-SW-602. NO EARTH-NEUTRAL LINK REQUIRED IN THIS SWITCHBOARD.
16. REFER CABLE SCHEDULE 2000-F75-LST-EL-40003 FOR PATCH LEAD LABEL DETAILS.

LEGEND

- MxDIxx — RTU DIGITAL INPUT
- MxDOxx — RTU DIGITAL OUTPUT
- PE CELL
- SWITCHBOARD TERMINAL
- VSD TERMINAL
- FIELD TERMINAL
- DCS OR I/O TERMINAL
- RTU TERMINAL
- DEVICE TERMINAL
- INDICATION LAMP (cc = COLOUR)
- SM/MM — xx C — MULTI CORE FIBRE OPTIC CABLE; SM/MM - SINGLE OR MULTIMODE (SM TYPICAL); xx C - NUMBER OF CORES
- SM/MM/YY — XX/xx C — DUPLEX FIBRE OPTIC PATCH LEAD; SM/MM - SINGLE OR MULTIMODE (SM TYPICAL); XX/YY - CONNECTOR TYPE(S); xx C - MUMBER OF CORES (TYP.2 CORE)

APPROVED FOR CONSTRUCTION

2000-F75-SCM-EL-40120_Rev0

FIM III tailings dam F75-SW-557 FIM III TSF switchboard 2 schematic diagram sheet 1