
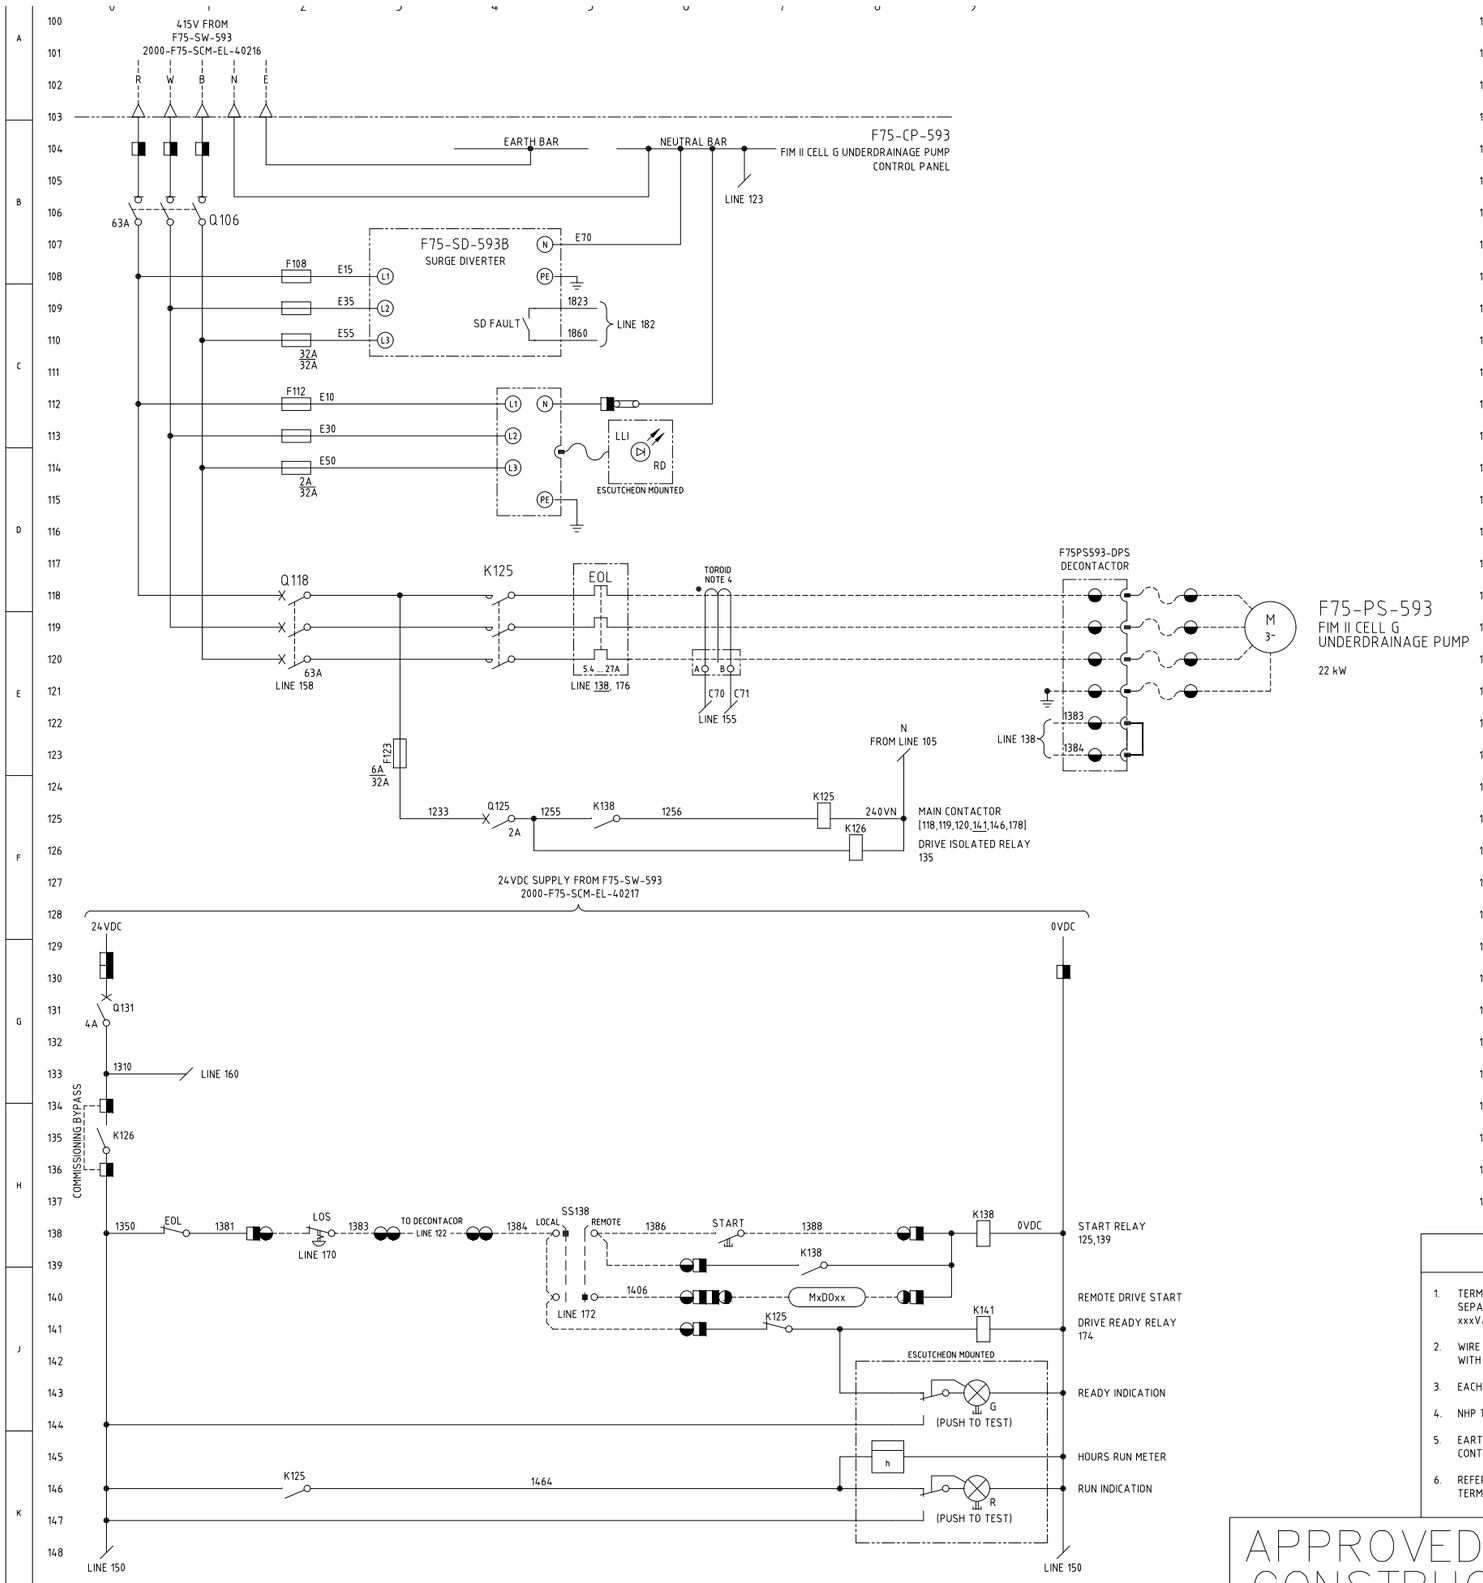


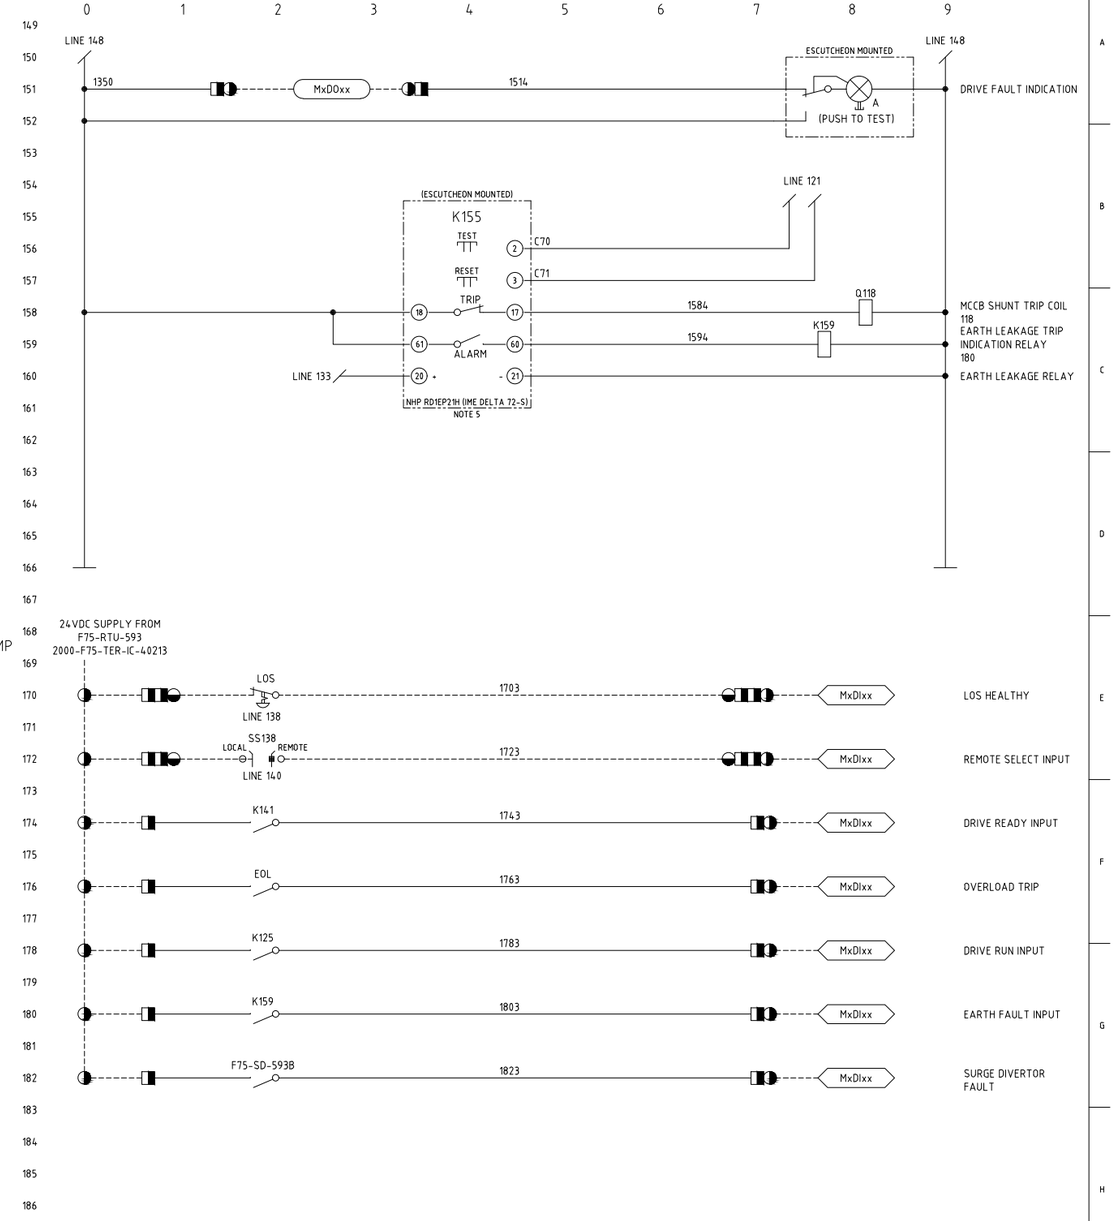

F75-PS-593
FIM II CELL G
UNDERDRAINAGE PUMP

22 kW

NOTES


1. TERMINALS ON TERMINAL STRIPS ABOVE 50VAC SHALL HAVE A SEPARATE PERSPEX SHROUD AND SHALL BE LABELLED "DANGER xxxVAC".
2. WIRE NUMBER FERRULES ON TERMINAL STRIP SHALL BE PREFIXED WITH EQUIPMENT NUMBER e.g. FxxPSxxx-1200.
3. EACH WIRE SHALL BE IDENTIFIED AT BOTH ENDS WITH FERRULES.
4. NHP TDGx2 TOROID TO SUIT CABLE DIAMETER.
5. EARTH LEAKAGE RELAY USER INTERFACE TO BE MOUNTED ON CONTROL PANEL ESCUTCHEON.
6. REFER 2000-F75-LST-IC-40004 FOR RTU I/O ADDRESSES AND TERMINATION DETAILS.

APPROVED FOR CONSTRUCTION

LEGEND

- MxDIxx — RTU DIGITAL INPUT
- MxDOxx — RTU DIGITAL OUTPUT
- SWITCHBOARD TERMINAL
- VSD TERMINAL
- FIELD TERMINAL
- RTU TERMINAL
- CONTROL PANEL TERMINAL
- DEVICE TERMINAL
- INDICATION LAMP (cc = COLOUR)

TERMINATION LEGEND

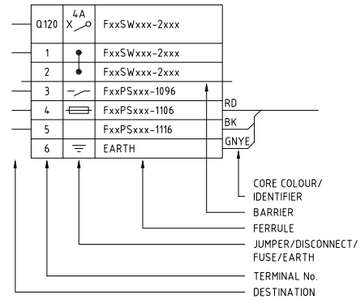

2000-F75-SCM-EL-40213_Rev0

FIM II tailings dam F75-CP-593 FIM II cell g underdrainage pump cp schematic diagram