
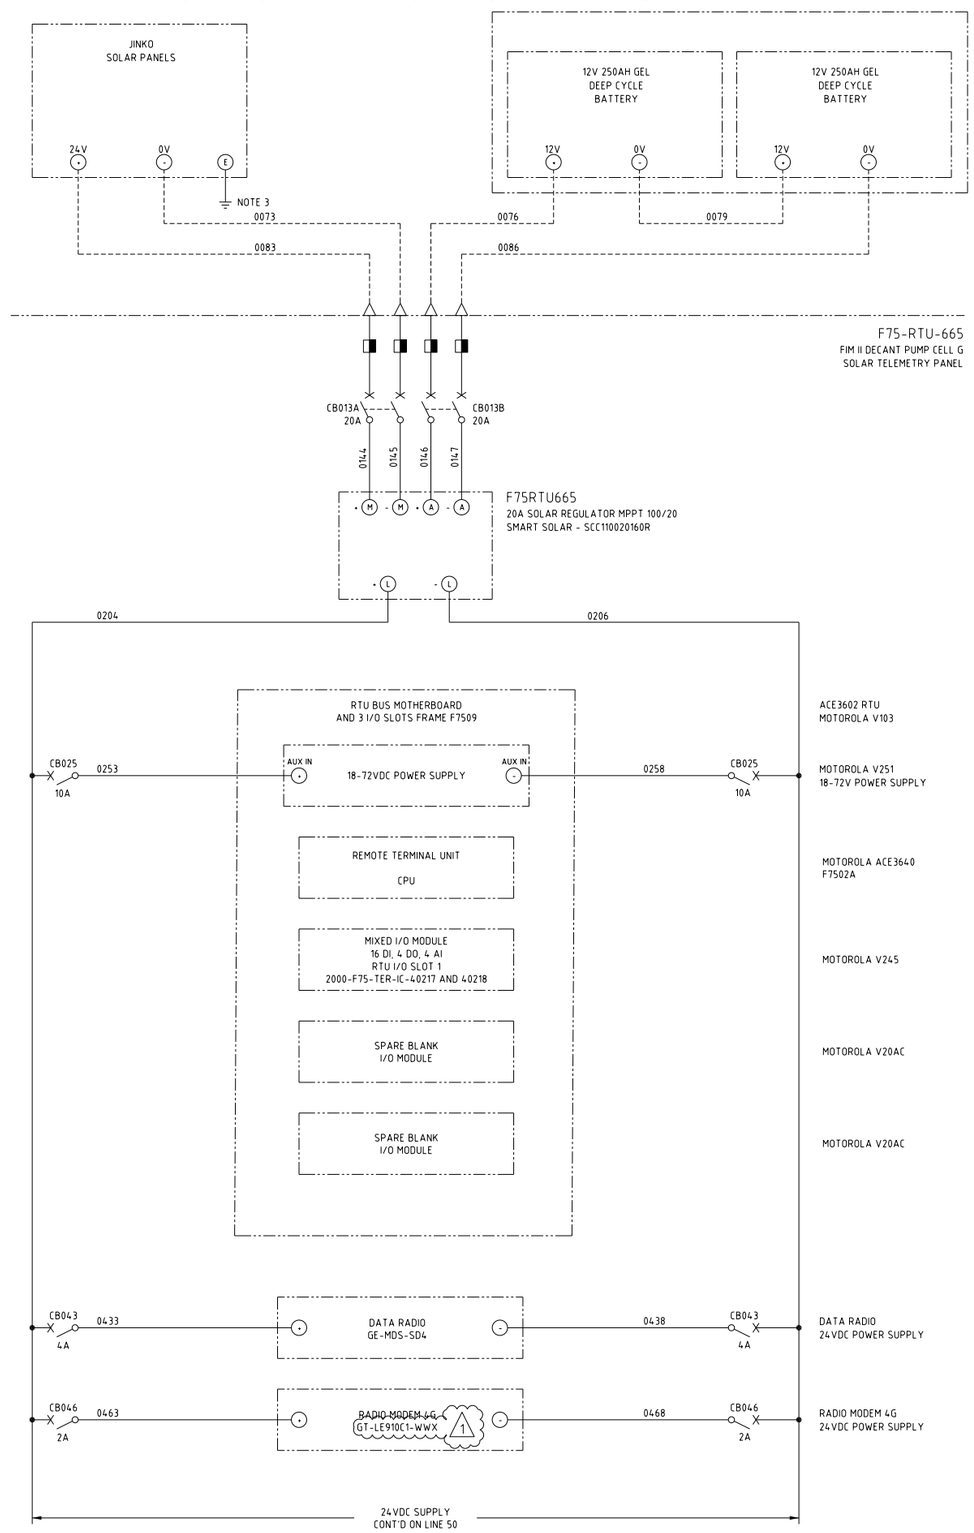


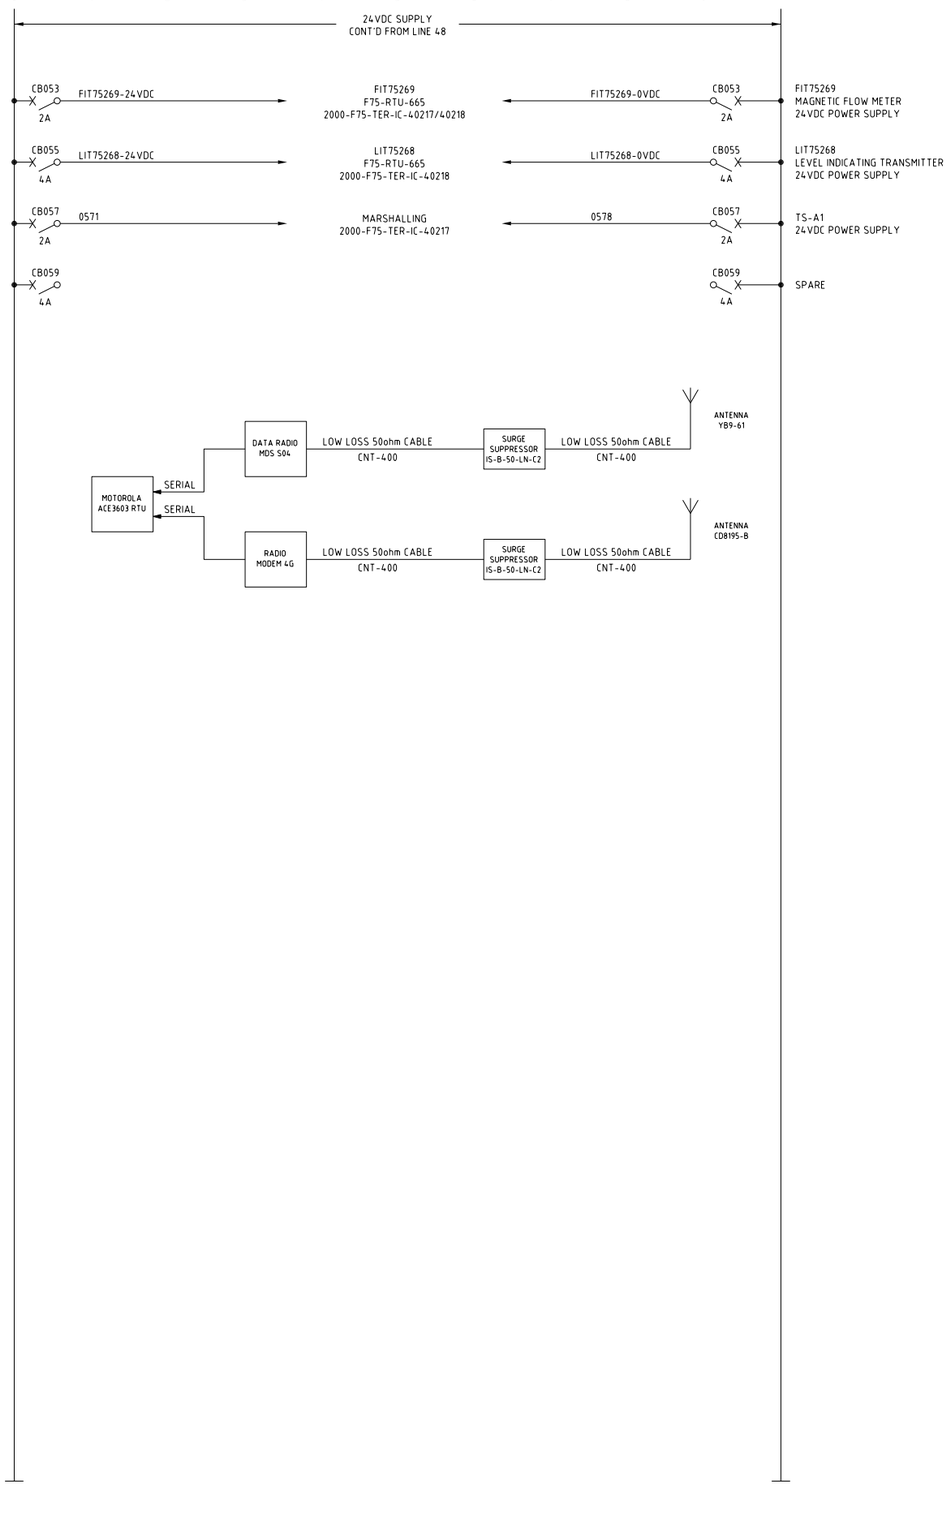

NOTES

1. WIRE NUMBER FERRULES ON TERMINAL STRIP SHALL BE PREFIXED WITH EQUIPMENT NUMBER e.g. FxxPPxxx-1200.
2. EACH WIRE SHALL BE IDENTIFIED AT BOTH ENDS WITH FERRULES.
3. EARTH TO RTU TELEMETRY PANEL FRAME.
4. CIRCUIT BREAKERS TO BE DOUBLE POLE AS SHOWN.

LEGEND

- FIELD TERMINAL
- RTU PANEL TERMINAL
- DEVICE TERMINAL
- INDICATION LAMP (cc = COLOUR)
- EARTH BAR
- IEB — INSTRUMENT EARTH BAR

NORTHERN STAR RESOURCES LIMITED

Approved	X
Approved as Noted	☐
Not Approved	☐
For Information Only	

ACCEPTANCE DOES NOT RELIEVE THE SUPPLIER / CONTRACTOR OF ITS RESPONSIBILITY OR LIABILITIES UNDER THE PURCHASE ORDER / CONTRACT

APPROVED FOR CONSTRUCTION

2000-F75-SCM-IC-40201_Rev1

FIM II tailings dam F75-RTU-665 FIM II decant pump cell g solar telemetry panel schematic diagram