


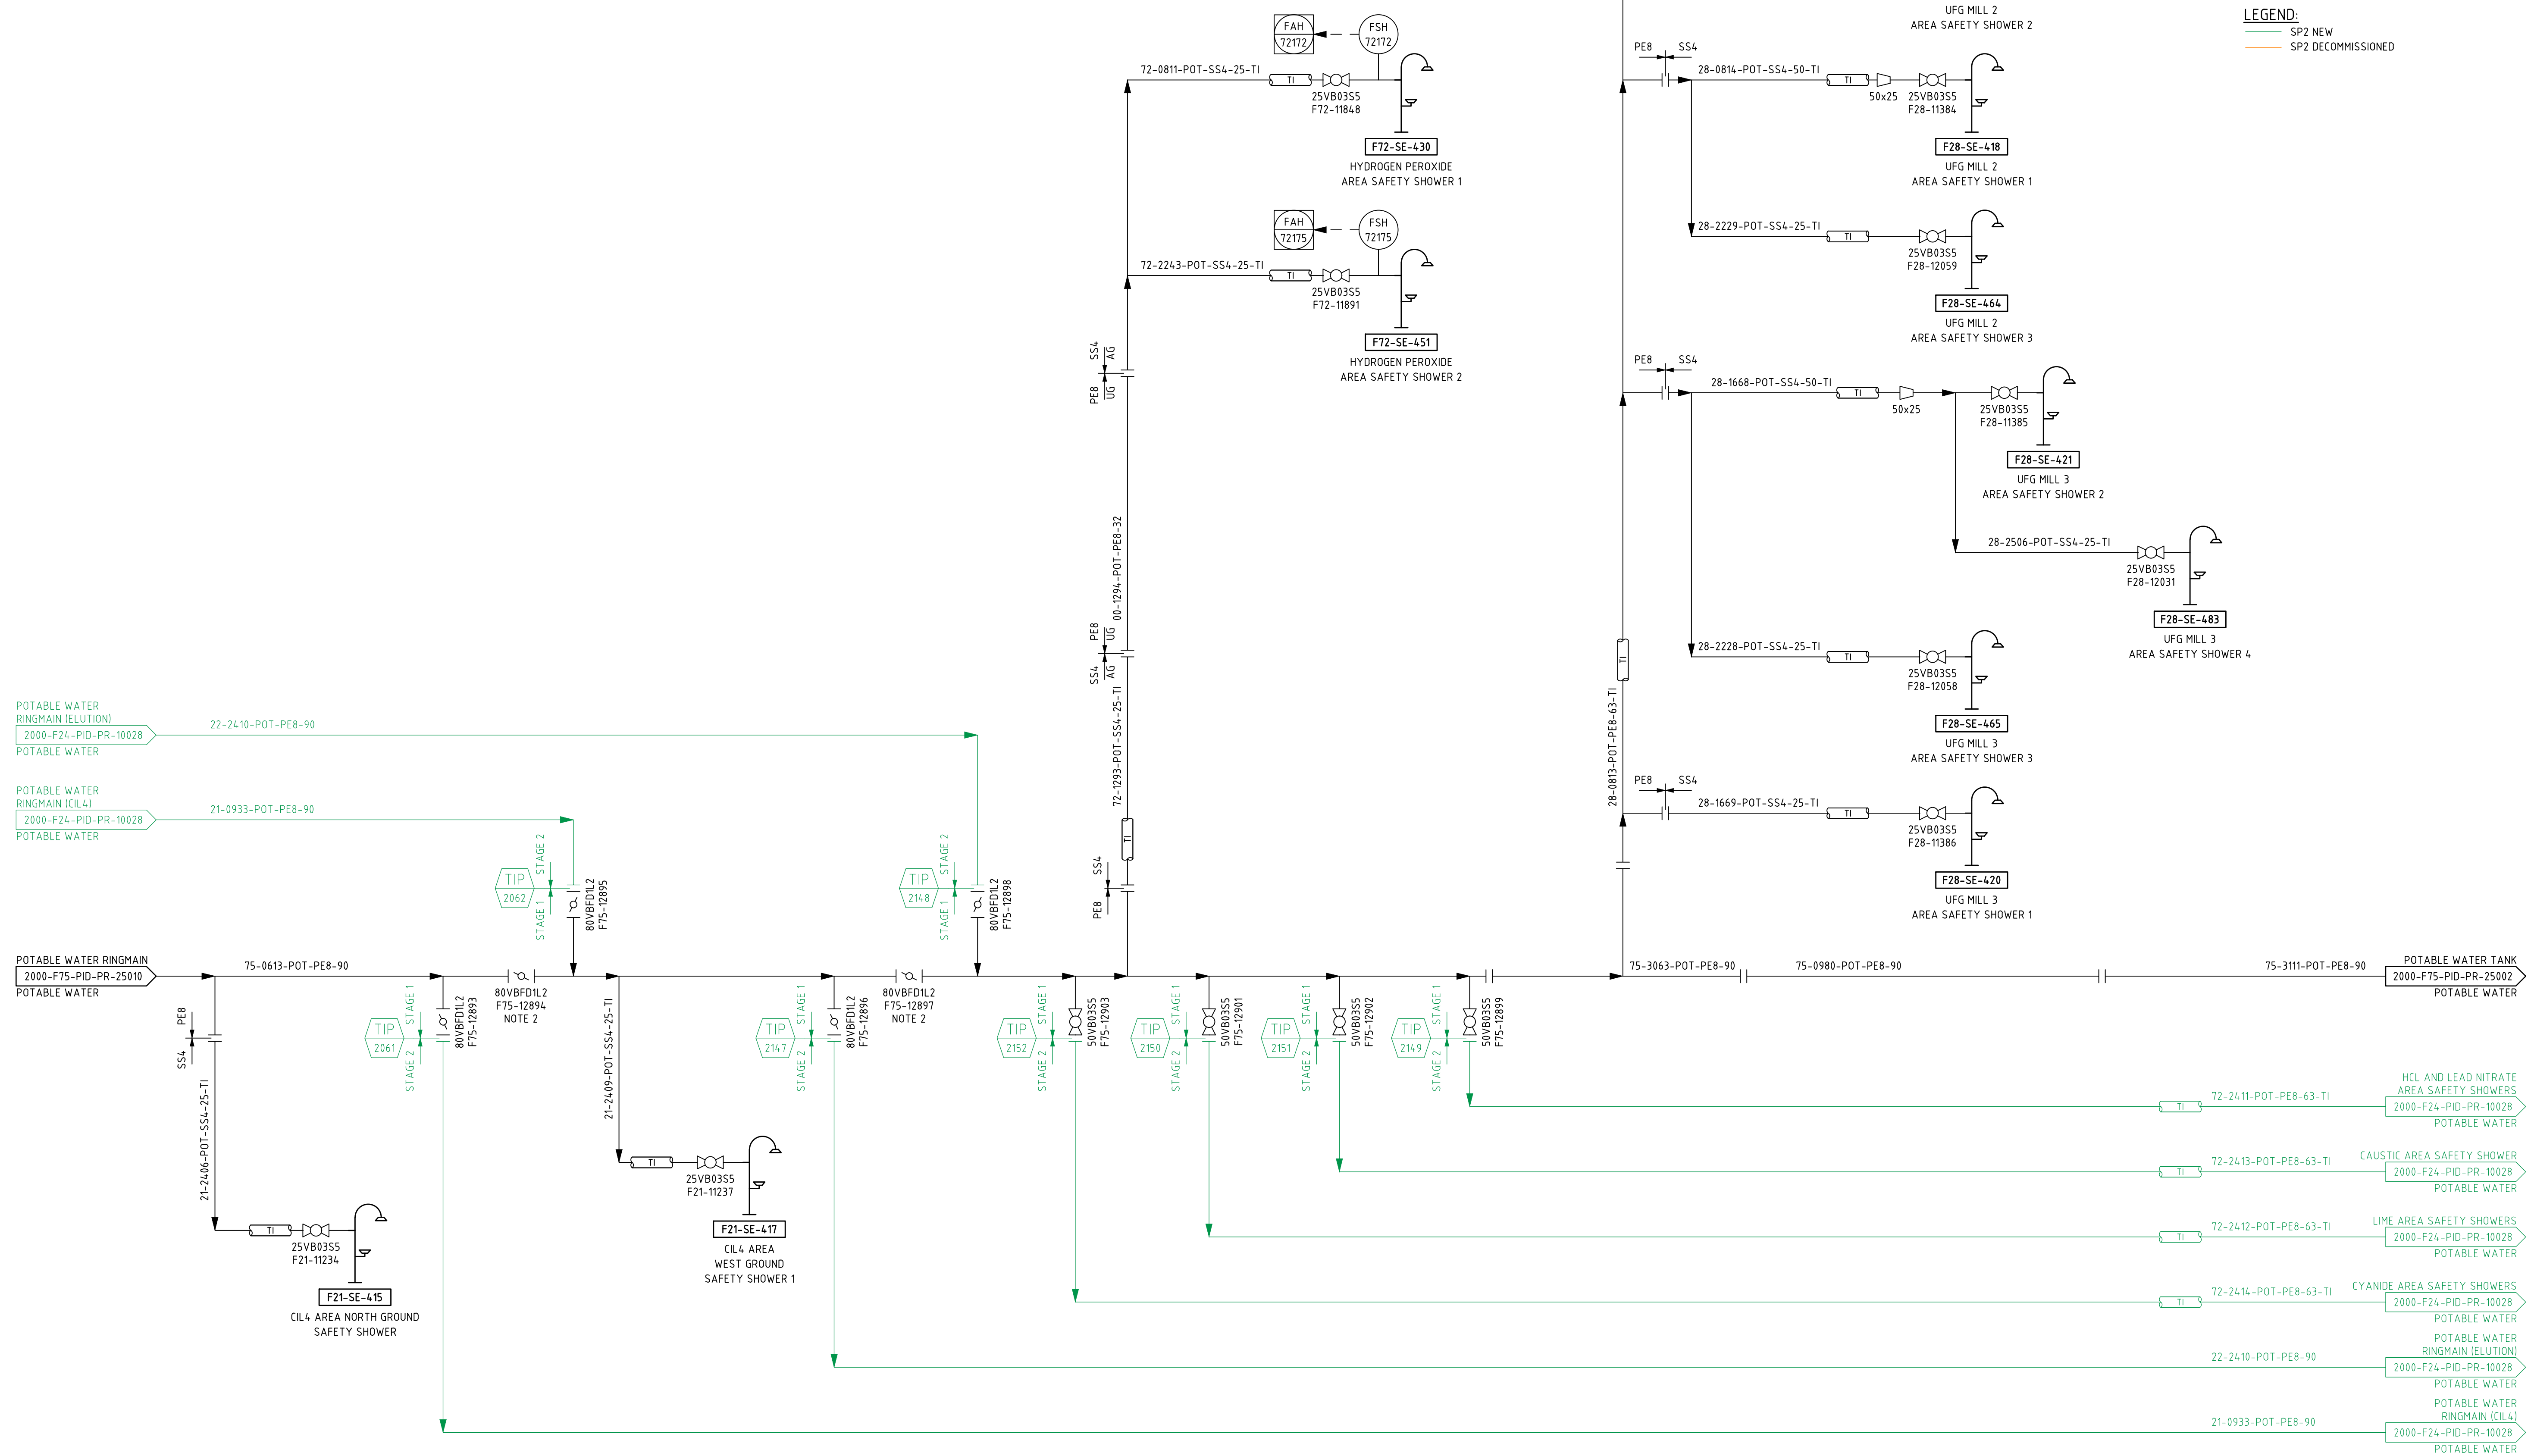

NOTES:

1. ALL STAGNANT SECTIONS OF SAFETY SHOWER PIPEWORK EXPOSED TO DIRECT SUNLIGHT TO BE INSULATED. SITE TO CONFIRM EXTENTS OF INSULATION. INSULATION NOT REQUIRED FOR RINGMAIN.
2. VALVES TO BE LOCKED CLOSED DURING SP2 COMMISSIONING.

LEGEND

- SP2 NEW
— SP2 DECOMMISSIONED