

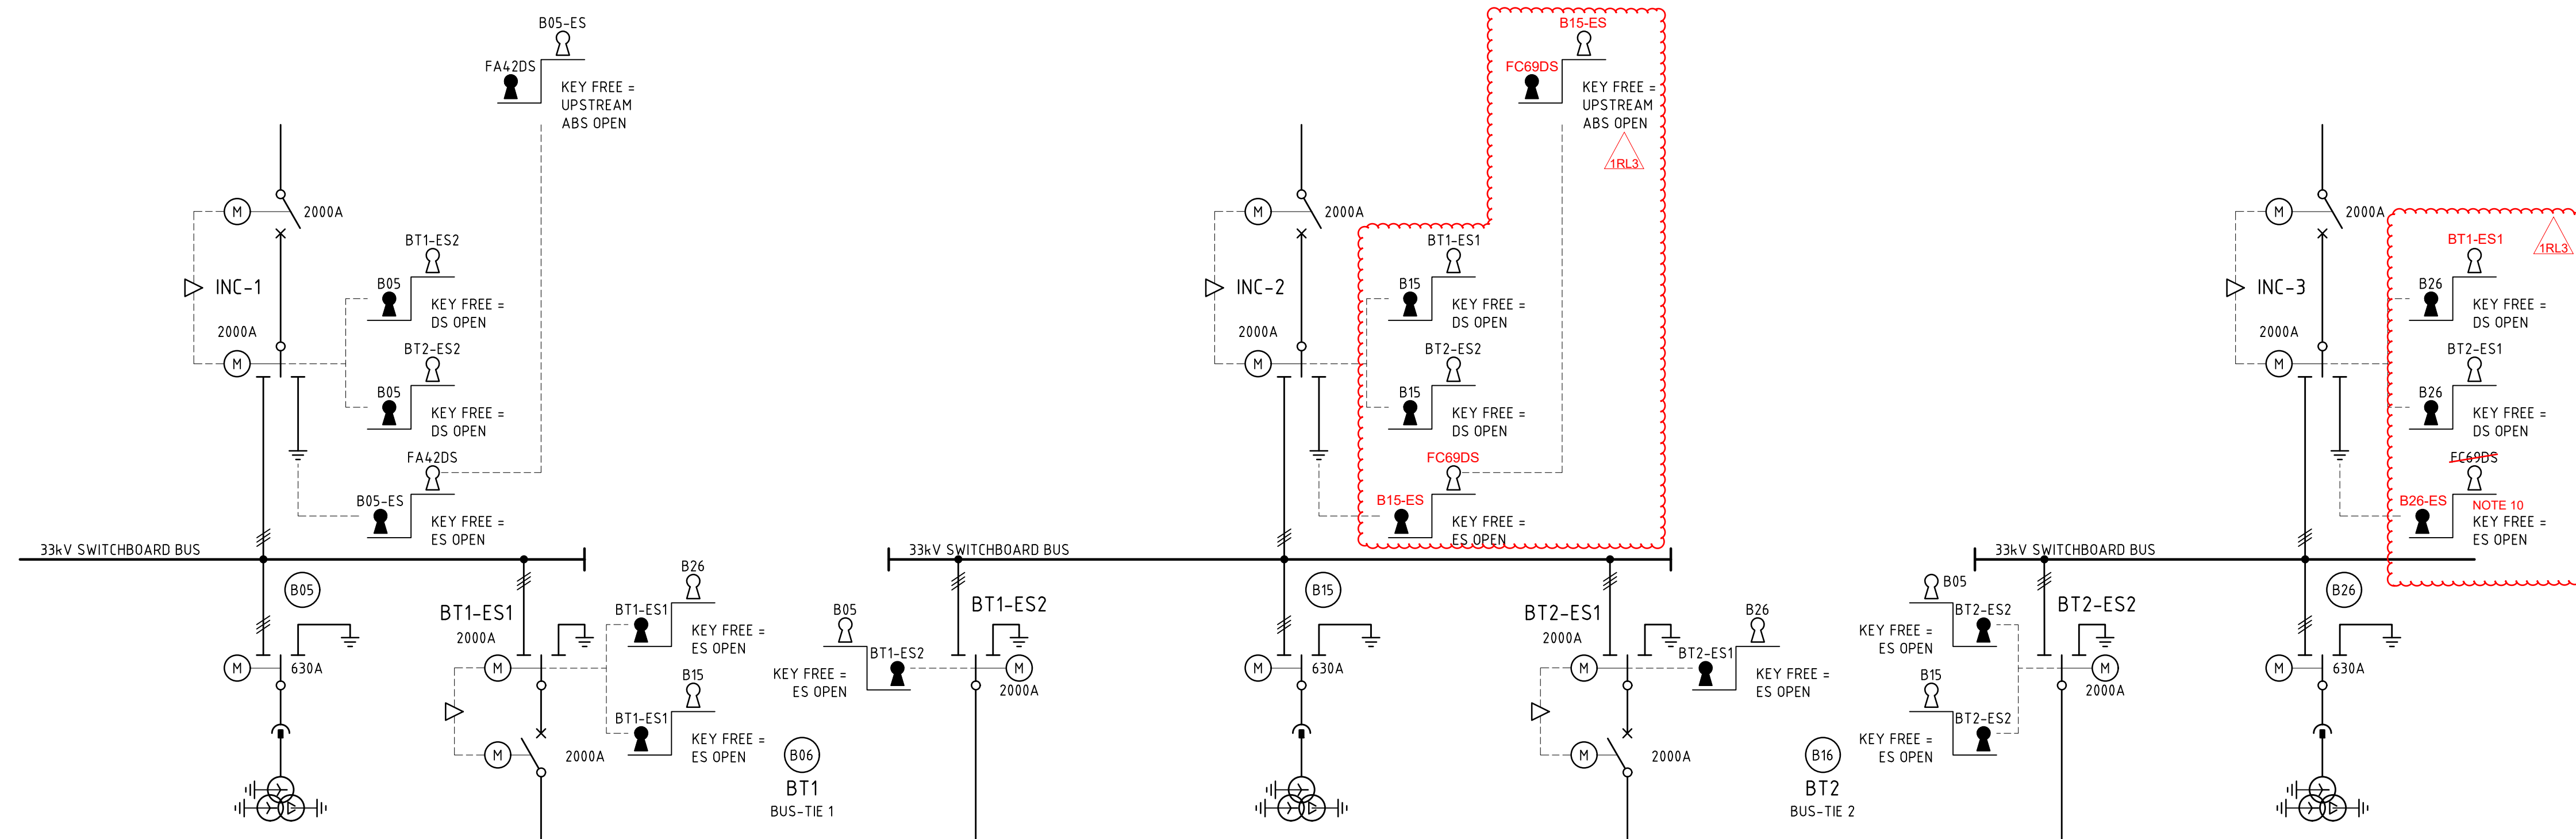
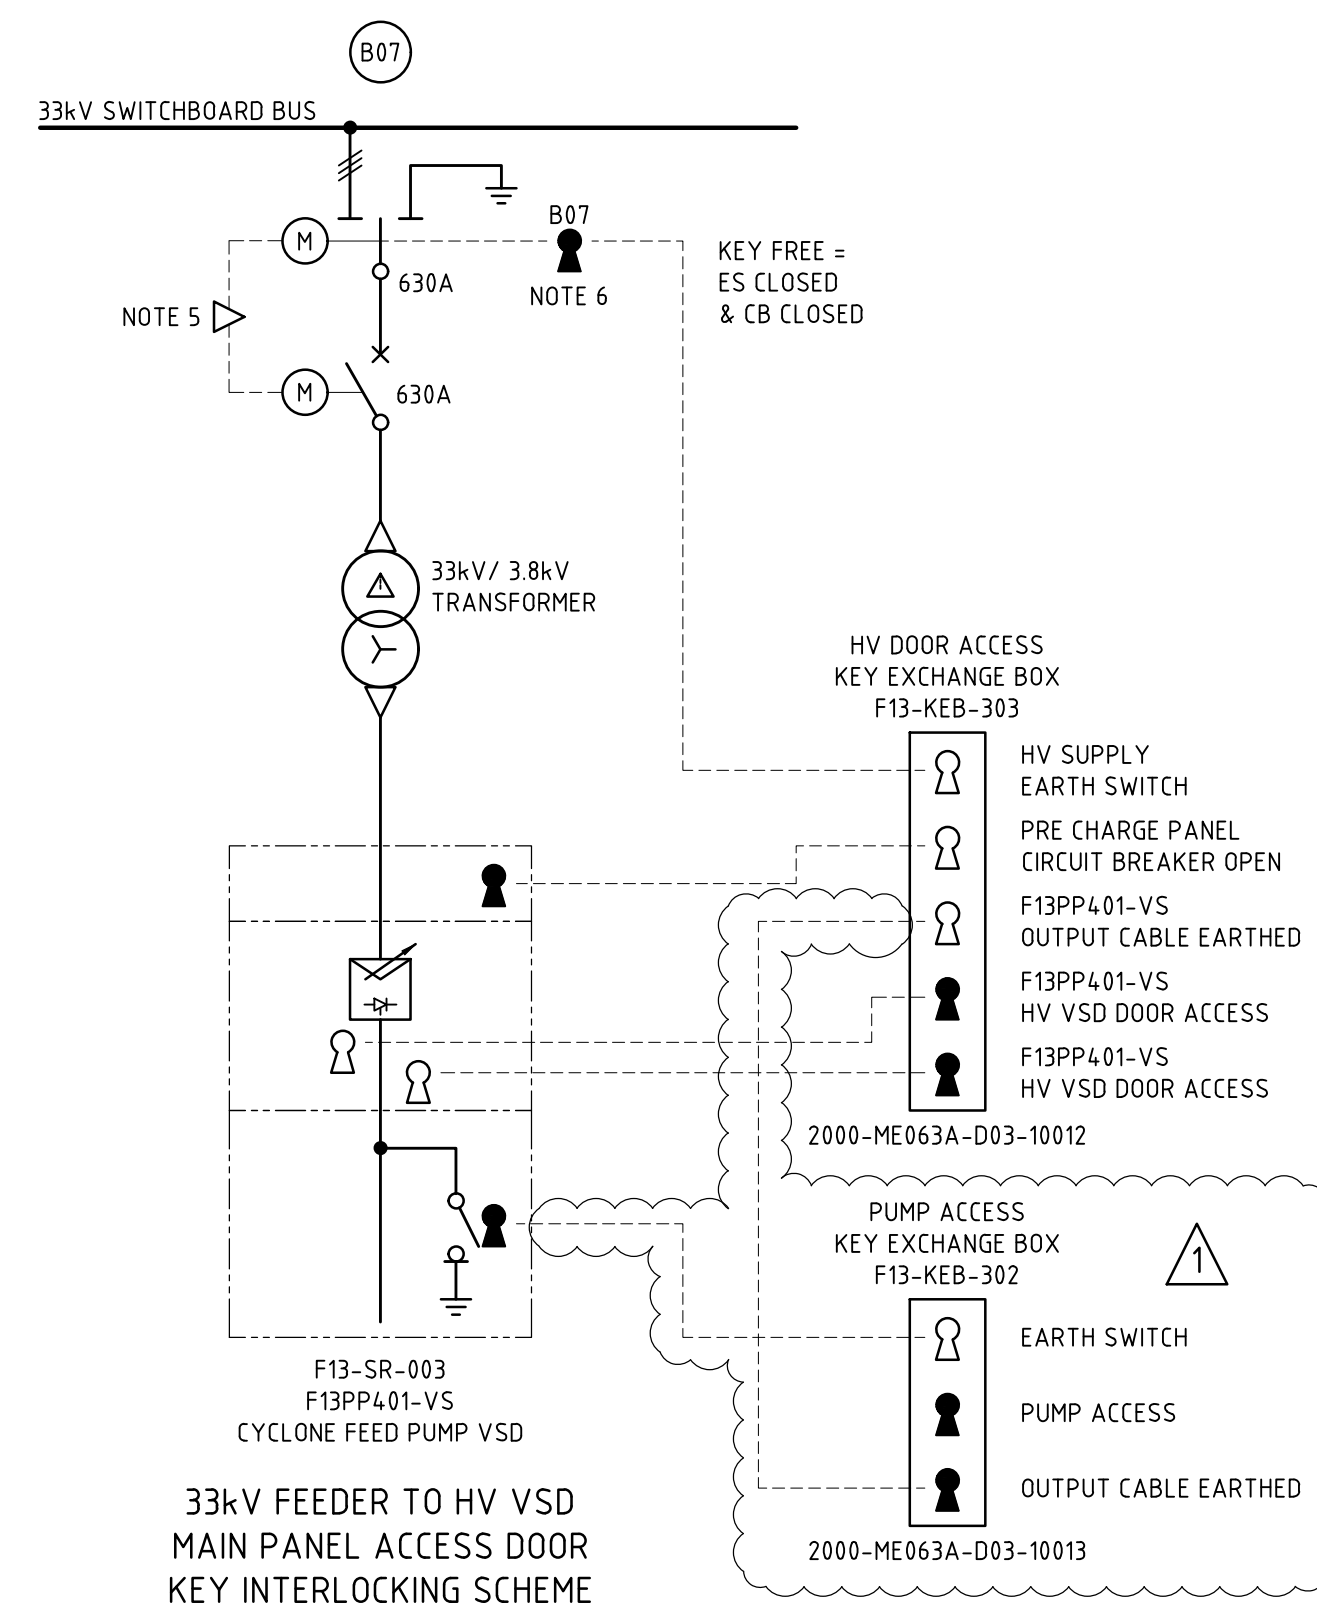


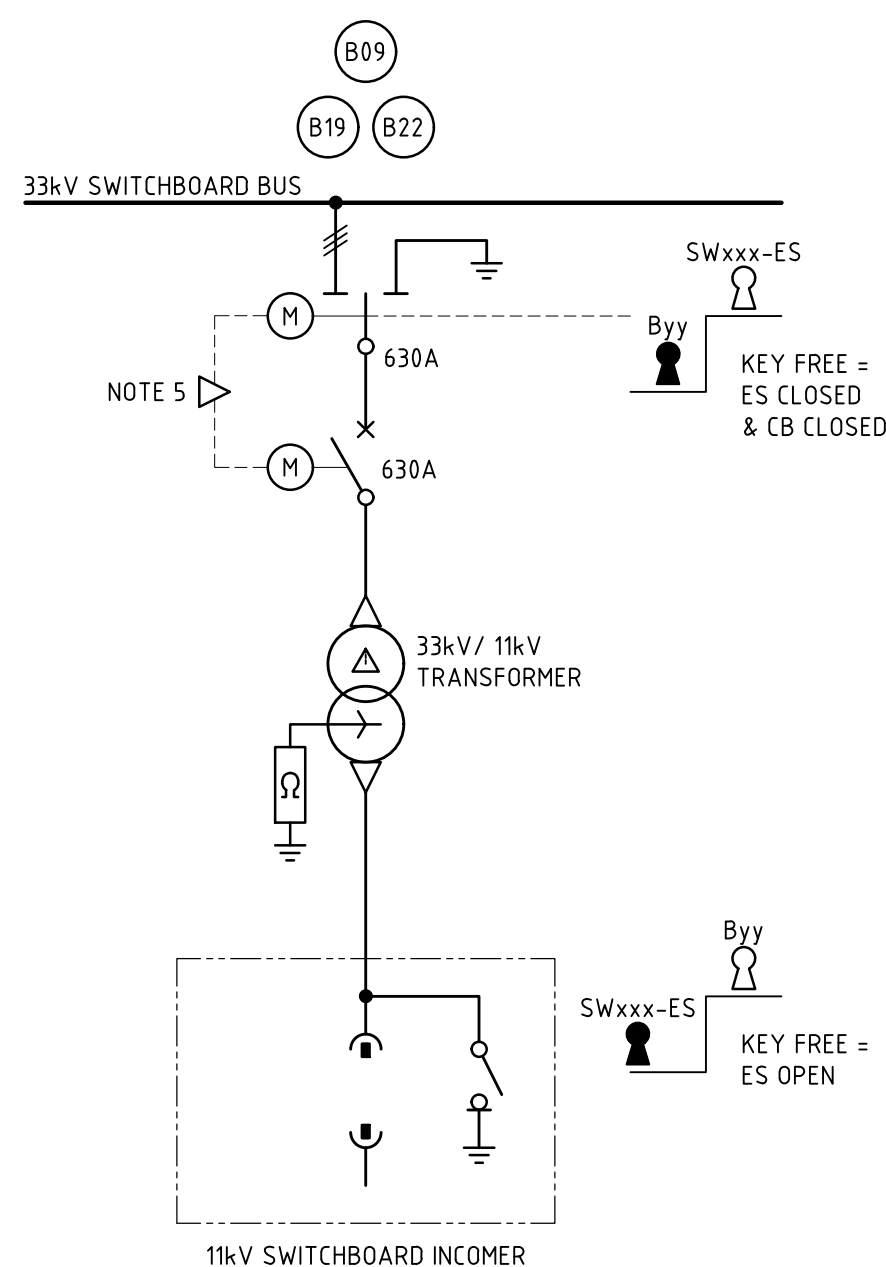

- ## NOTES
1. INCOMER 1 (INC-1) EARTH SWITCH SHALL BE KEY INTERLOCKED WITH BUS-TIE 1 (BT1) EARTH SWITCH BT1-ES2 AND BUS-TIE 2 (BT2) EARTH SWITCH BT2-ES2 SUCH THAT THESE EARTH SWITCHES MAY ONLY BE CLOSED WITH THE INCOMER 1 (INC-1) DISCONNECTOR LOCKED IN AN OPEN STATE .
 2. INCOMER 2 (INC-2) DISCONNECTOR SHALL BE KEY INTERLOCKED WITH BUS-TIE 1 (BT1) EARTH SWITCH BT1-ES1 AND BUS-TIE 2 (BT2) EARTH SWITCH BT2-ES2 SUCH THAT THESE EARTH SWITCHES MAY ONLY BE CLOSED WITH THE INCOMER 2 (INC-2) DISCONNECTOR LOCKED IN AN OPEN STATE.
 3. INCOMER 3 (INC-3) DISCONNECTOR SHALL BE KEY INTERLOCKED WITH BUS-TIE 1 (BT1) EARTH SWITCH BT1-ES1 AND BUS-TIE 2 (BT2) EARTH SWITCH BT2-ES1 SUCH THAT THESE EARTH SWITCHES MAY ONLY BE CLOSED WITH THE INCOMER 3 (INC-3) DISCONNECTOR LOCKED IN AN OPEN STATE.
 4. EARTHED KEY CONDITION ONLY VALID WHEN THE EARTH SWITCH & CIRCUIT BREAKER ARE CLOSED.
 5. 415V SWITCHROOM TRANSFORMER ROOM DOOR SHALL BE FORETRSS KEY INTERLOCKED (KEYED ALIKE) WITH THE UPSTREAM 33kV FEEDER EARTH SWITCH.
 6. 33kV EARTH SWITCH SHALL BE FORETRSS KEY INTERLOCKED WITH THE VSD HV COMPARTMENT DOORS VIA THE KEY EXCHANGE BOX.
 7. UPSTREAM 33kV OVERHEAD LINE POLE MOUNTED DISCONNECTOR SWITCH SHALL BE KEY INTERLOCKED WITH THE 33kV INCOMER EARTH SWITCH SUCH THAT THE UPSTREAM 33kV OVERHEAD LINE DISCONNECTOR SWITCH CAN ONLY BE CLOSED WHEN THE 33kV INCOMER EARTH SWITCH IS OPEN.
 8. AN ELECTRICAL INTERLOCK PREVENTS OPERATION OF THE THREE-POSITION SWITCH WHEN THE CIRCUIT BREAKER IS CLOSED, TO PREVENT THE THREE-POSITION SWITCH FROM SWITCHING ON LOAD.
 9. TRANSFORMER ENCLOSURE DOOR STATUS SHALL BE MONITORED BY THE DCS. OPENING OF DOOR SHALL RAMP STOP THE RELEVANT SWITCHROOM AREA AND OPEN THE UPSTREAM CB.
- 

1
10. EARTH SWITCH NO LONGER IN USE AND NOT INTERLOCKED WITH ANY UPSTREAM DISCONNECTING DEVICES. KEY IS LOCKED IN A BOLTED BOX ON THE B26 FEEDER TIER.
- 

1

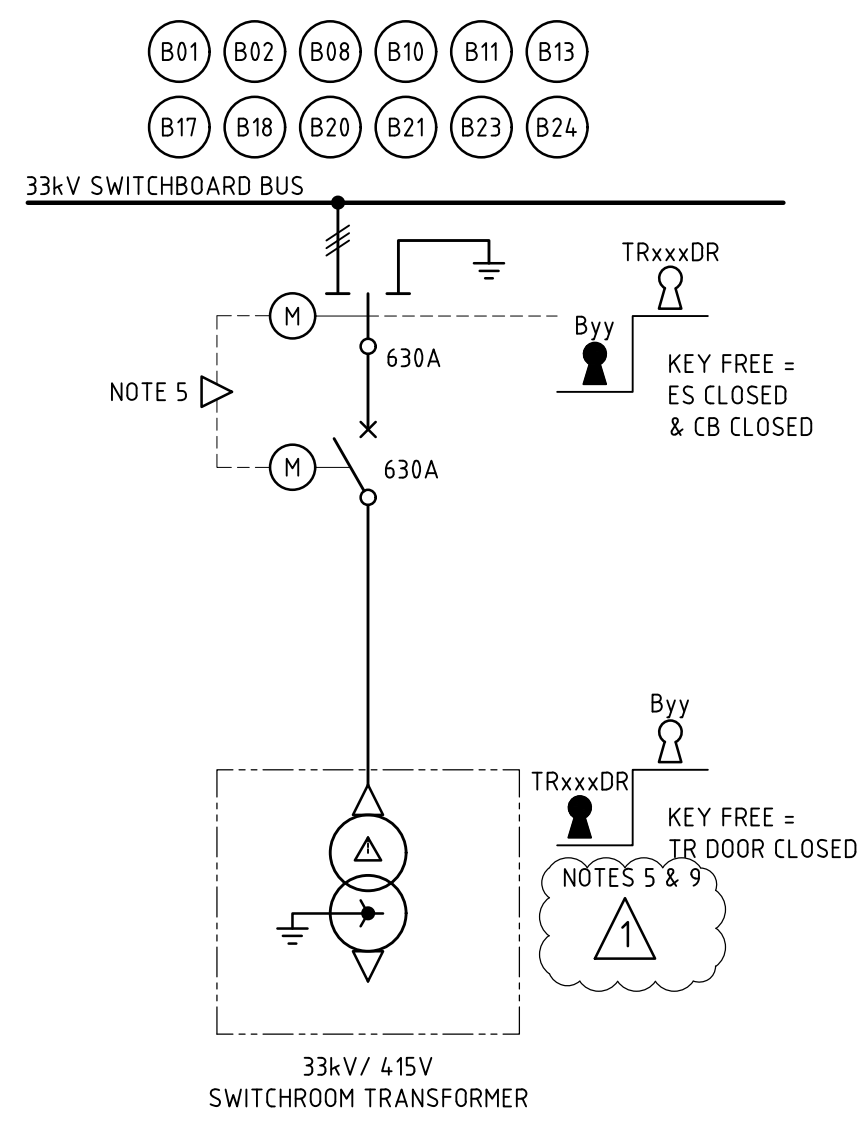

- ## LEGEND
- | | |
|--|---|
|  | MECHANICAL OR ELECTRICAL INTERLOCK DEVICE |
|  | KEY FREE |
|  | KEY CAPTIVE |
| <div>
</div> | KEY EXCHANGE BOX |

[illegible]

PRIMERO
primero.com.au | DESIGN | CONSTRUCT | OPERATE
PRIMERO PROJECT NUMBER: 23517

PROJECT:	NORTHERN STAR RESOURCES LTD KCGM GROWTH PROJECT
TITLE:	GENERAL FIMISTON SITE F00-SW-010 33kV SWITCHBOARD ELECTRICAL INTERLOCKING SINGLE LINE DIAGRAM SHEET 1

SHEET	SCALE	DRG No.	REVISION
A1	NONE	2000-F00-SLD-EL-10051	1RL3