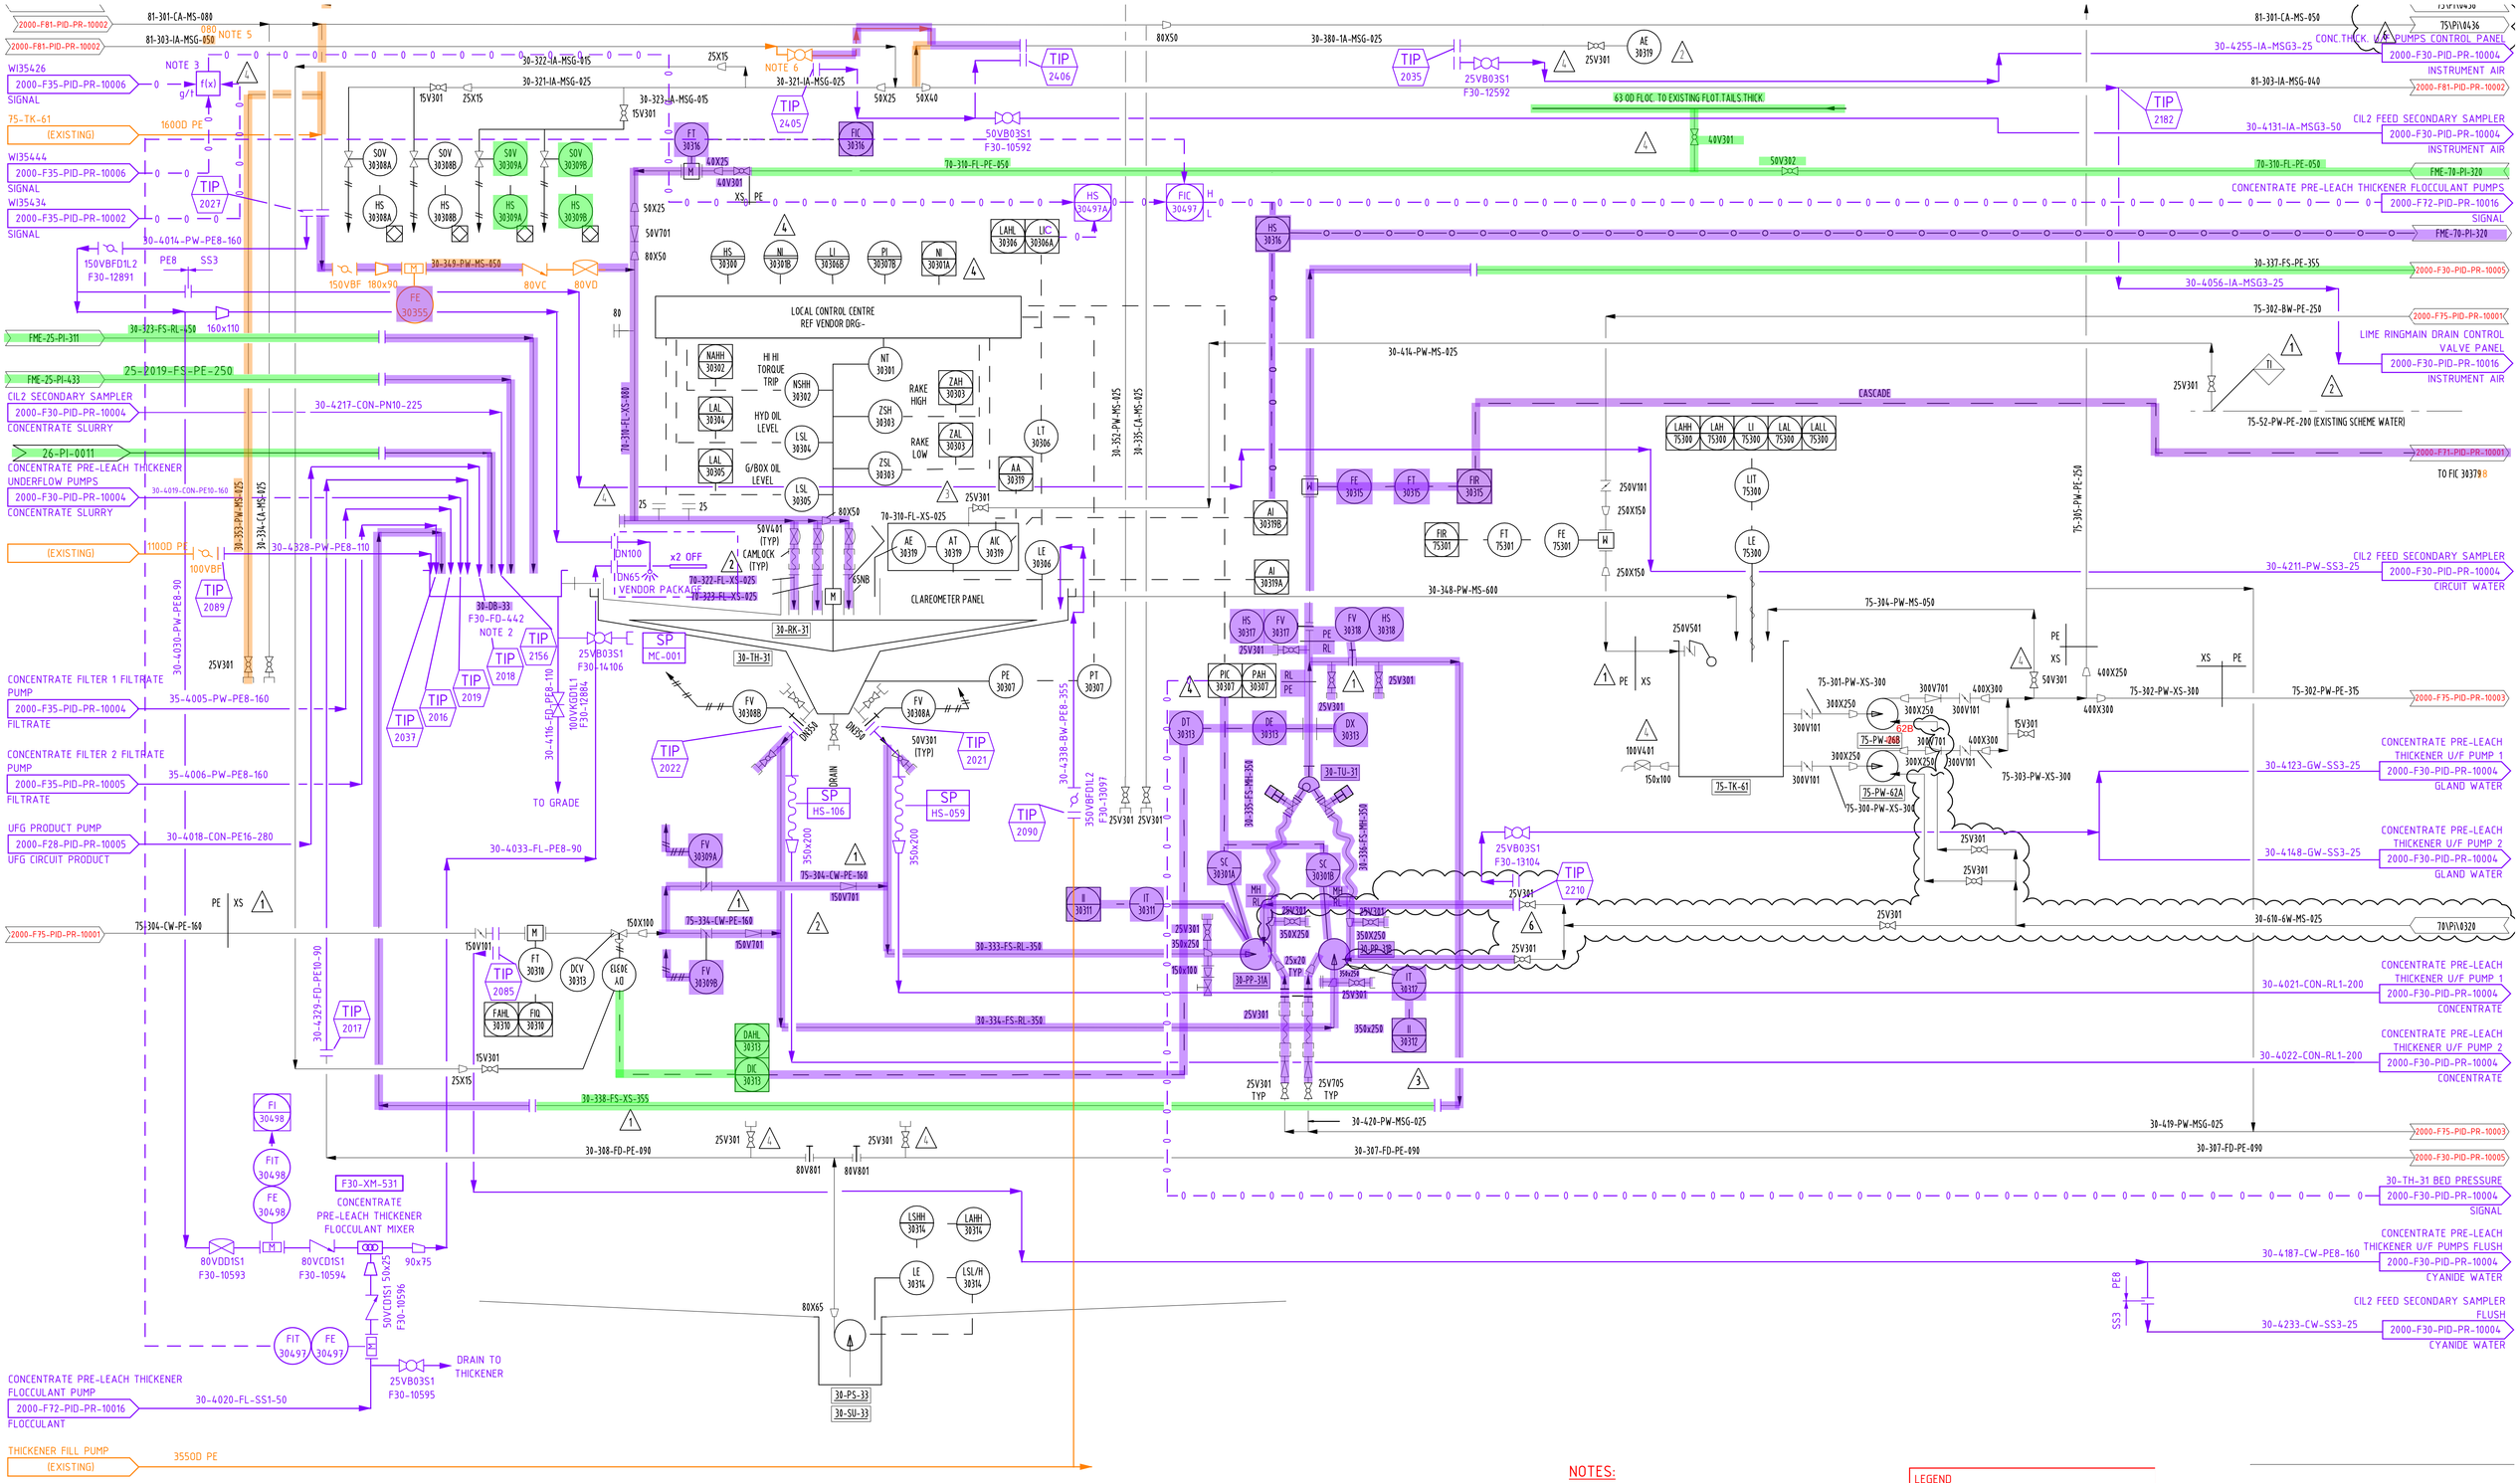


F30-FD-442	CONCENTRATE PRE-LEACH THICKENER FEED BOX	NOTE 2
30-DB-33	FLOTATION TAILINGS THICK. FEED BOX	
30-PP-31A/B	FLOTATION TAILS THICKENER U/FLOW PUMP	
30-PS-33	FLOTATION TAILINGS WASHDOWN PUMP	
30-RK-31	FLOTATION TAILS. THICKENER RAKE MECHANISM	
30-SU-33	CONCENTRATE LOADOUT AREA FLOTATION TAILINGS WASHDOWN SUMP	

CONCENTRATE PRE-LEACH THICKENER	
30-TH-31	FLOTATION TAILINGS THICKENER
30-TU-31	TECH TAYLOR VALVE
75-PW-18A/B	CIRCUIT WATER PUMP
75-TK-18	CIRCUIT WATER TANK

F30-PP-415	CONCENTRATE PRE-LEACH THICKENER UNDERFLOW PUMP 1
F30-PP-416	CONCENTRATE PRE-LEACH THICKENER UNDERFLOW PUMP 2
F30-SA-441	CONCENTRATE PRE-LEACH THICKENER UNDERFLOW PRIMARY SAMPLER
F30-SA-442	CONCENTRATE PRE-LEACH THICKENER UNDERFLOW SECONDARY SAMPLER

F30-HP-441	CONCENTRATE PRE-LEACH THICKENER UNDERFLOW SAMPLE RETURN HOPPER
F30-PP-441	CONCENTRATE PRE-LEACH THICKENER UNDERFLOW SAMPLE RETURN PUMP
F30-XM-531	CONCENTRATE PRE-LEACH THICKENER FLOCULLANT INLINE MIXER

NOTES:

1. REFER TO 2000-F24-PR-10003 FOR GLAND [redacted] DETAIL
2. EXISTING FEEDBOX REMOVED AND REPLAC [redacted] W FEEDBOX
3. CASCADE MODE INPUT FOR FIC30497 USING MANUALLY INPUT FLOCCULANT DOSAGE IN G/T
4. RUBBER LINED PREFORMED SLURRY HOSE 350x200
5. EXISITNG I [redacted] MENT AIR LINE IS DN80 IN PIPERACK WITH
6. VALVE TO [redacted] 30-380. TIP-2405 TO TIE INTO VALVE AND RECONNEC [redacted] TING LINE 30-380.

LEGEND

- EXISTING
- NON-EXISTENT
- STAGE 1 - NEW
- STAGE 1 - REMOVE
- STAGE 1 - DECOMMISSIONED (OTHERS)
- STAGE 2 - NEW
- STAGE 2 - REMOVE
- STAGE 2 - DECOMMISSIONED (OTHERS)