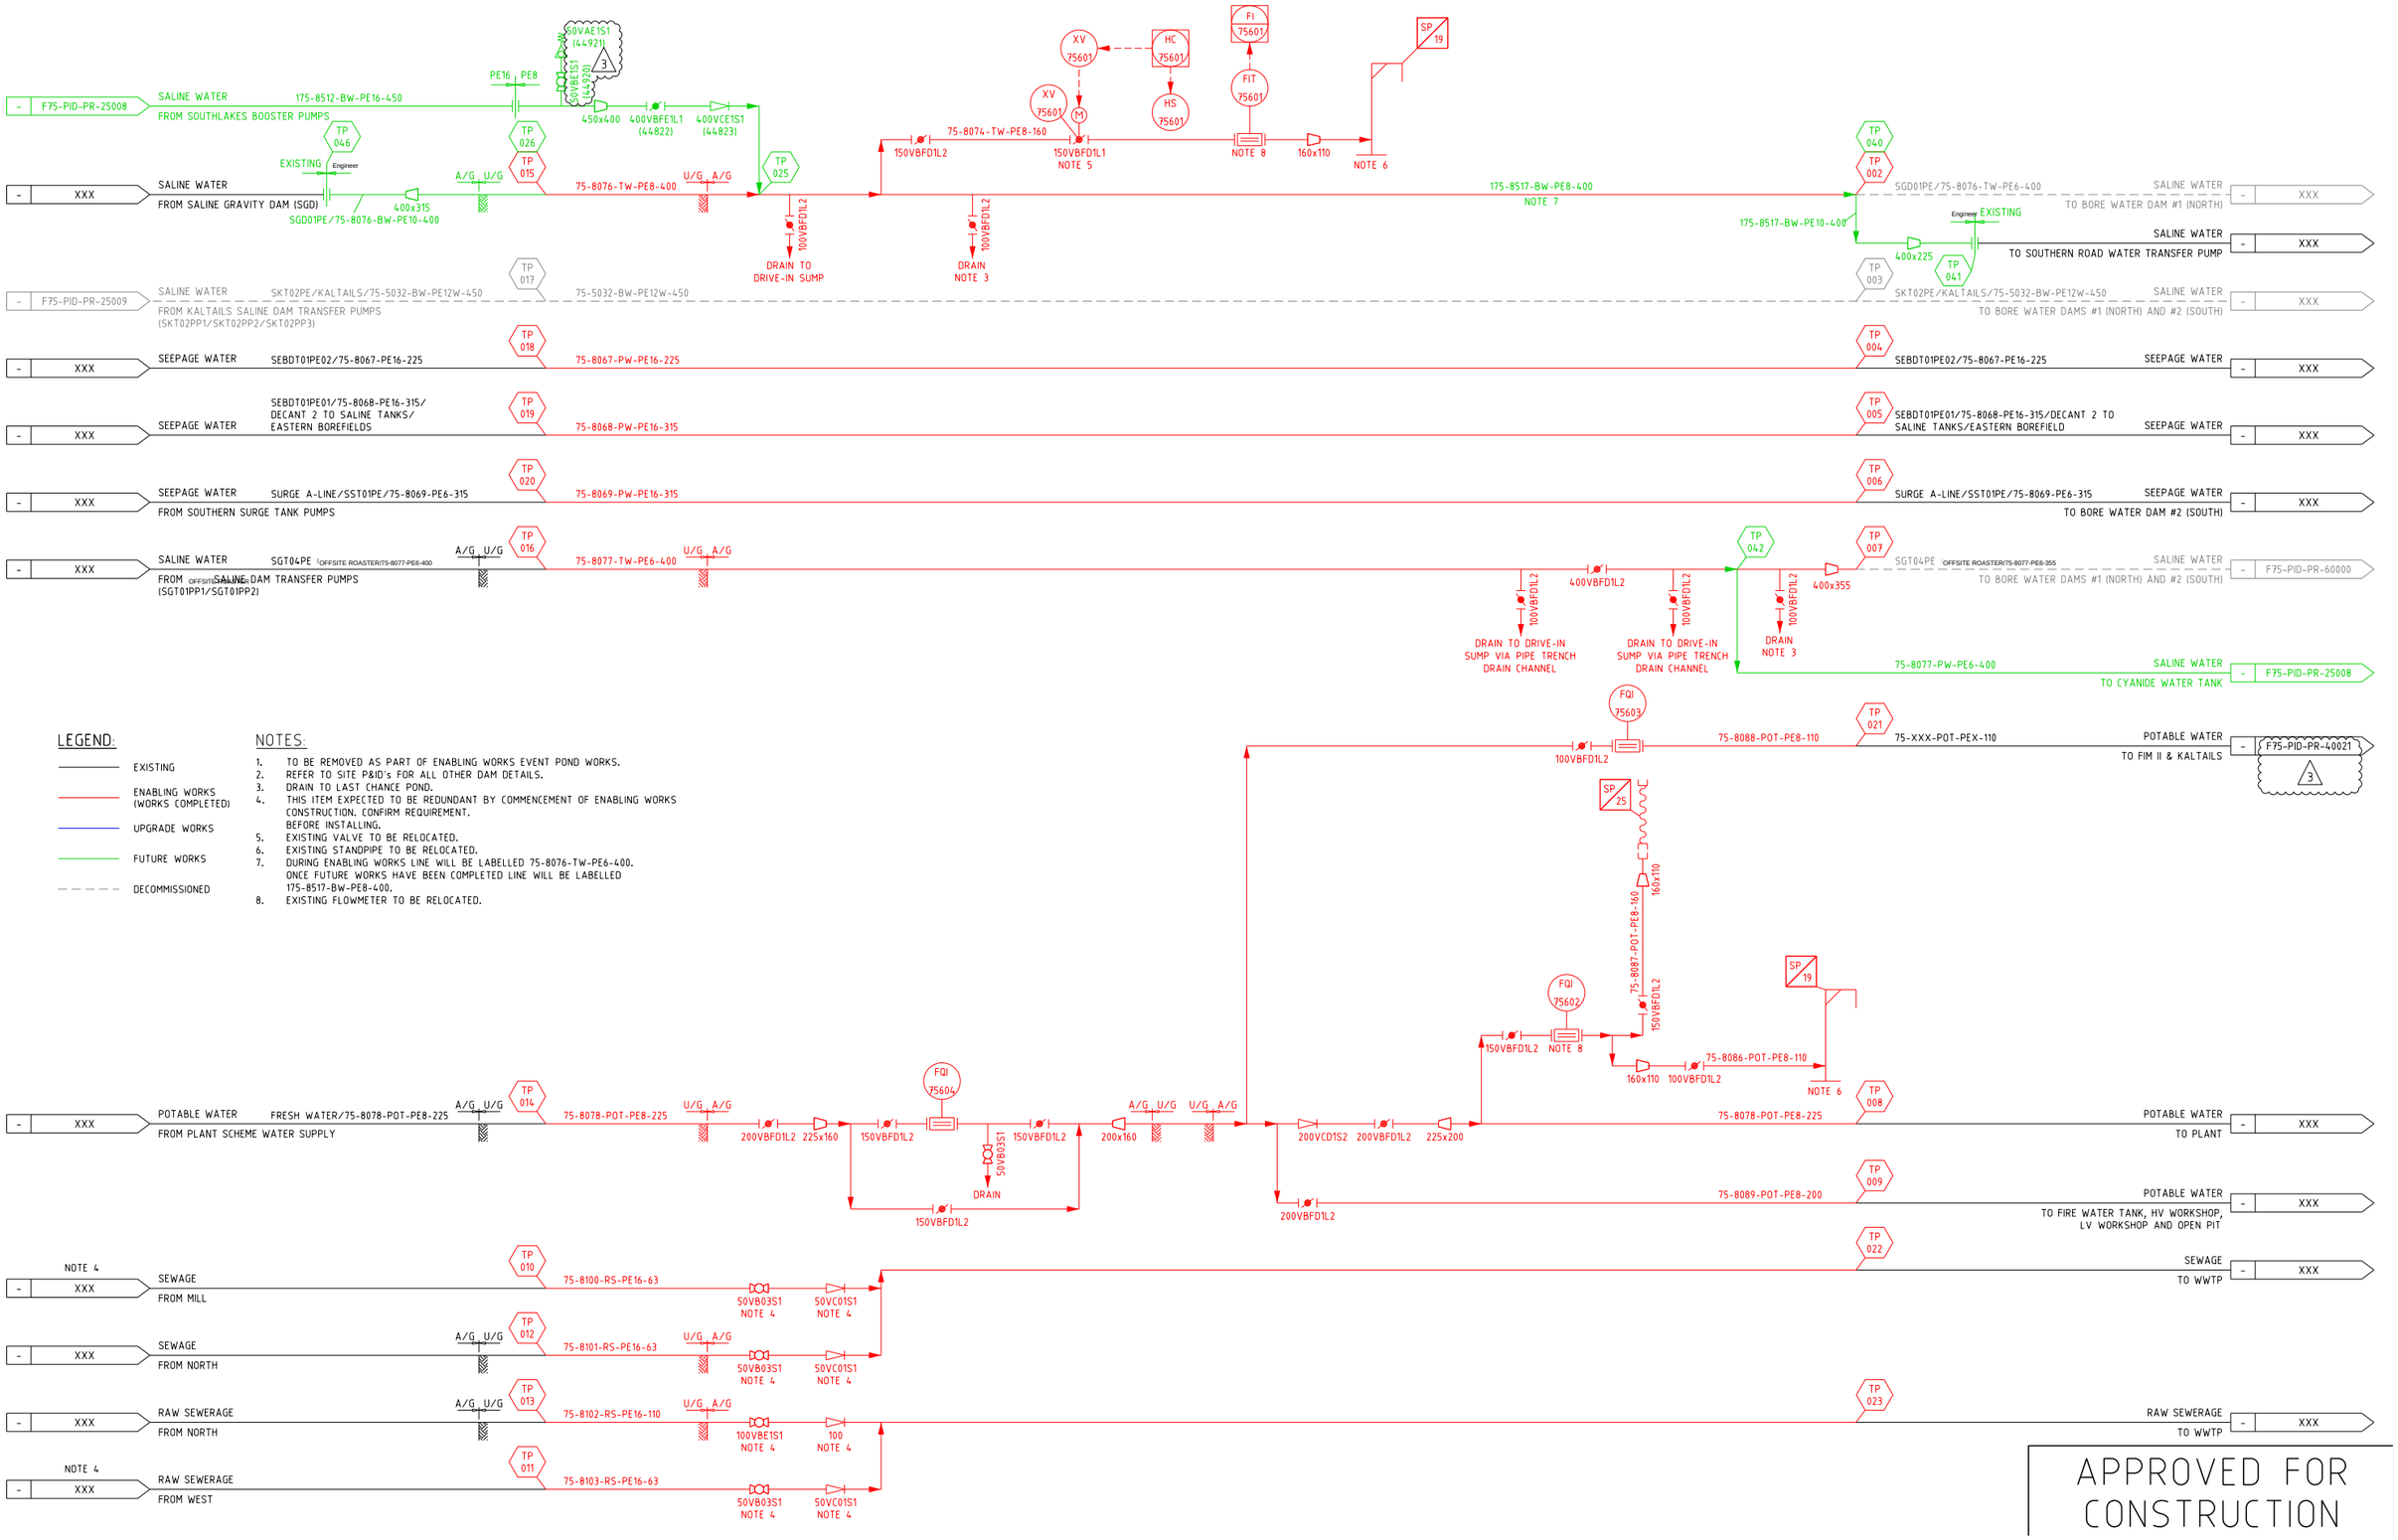

LEGEND:
EXISTING
ENABLING WORKS (WORKS COMPLETED)
UPGRADE WORKS
FUTURE WORKS
DECOMMISSIONED
NOTES:
1. TO BE REMOVED AS PART OF ENABLING WORKS EVENT POND WORKS.
2. REFER TO SITE P&ID's FOR ALL OTHER DAM DETAILS.
3. DRAIN TO LAST CHANCE POND.
4. THIS ITEM EXPECTED TO BE REDUNDANT BY COMMENCEMENT OF ENABLING WORKS CONSTRUCTION. CONFIRM REQUIREMENT. BEFORE INSTALLING.
5. EXISTING VALVE TO BE RELOCATED.
6. EXISTING STANDPIPE TO BE RELOCATED.
7. DURING ENABLING WORKS LINE WILL BE LABELLED 75-8076-TW-PE6-400. ONCE FUTURE WORKS HAVE BEEN COMPLETED LINE WILL BE LABELLED 175-8517-BW-PE8-400.
8. EXISTING FLOWMETER TO BE RELOCATED.
F75-PID-PR-25008
SALINE WATER
FROM SOUTHLAKES BOOSTER PUMPS
175-8512-BW-PE16-450
PE16
PE8
50VAE1S1 (44921)
50VBE1S1 (44920)
450x400
400VBFE1L1 (44822)
400VCE1S1 (44823)
TP 046
TP 026
TP 015
EXISTING
Engineer
A/G U/G
XXX
SALINE WATER
FROM SALINE GRAVITY DAM (SGD)
400x315
SGD01PE/75-8076-BW-PE10-400
75-8076-TW-PE8-400
U/G A/G
TP 025
150VBFD1L2
75-8074-TW-PE8-160
XV 75601
HC 75601
FI 75601
FIT 75601
HS 75601
150VBFD1L1
NOTE 5
NOTE 8
160x110
SP 19
NOTE 6
100VBFD1L2
DRAIN TO DRIVE-IN SUMP
DRAIN
NOTE 3
175-8517-BW-PE8-400
NOTE 7
TP 040
TP 002
SGD01PE/75-8076-TW-PE6-400
SALINE WATER
TO BORE WATER DAM #1 (NORTH)
175-8517-BW-PE10-400
400x225
TP 041
SALINE WATER
TO SOUTHERN ROAD WATER TRANSFER PUMP
TP 017
TP 003
F75-PID-PR-25009
SALINE WATER
FROM KALTAILS SALINE DAM TRANSFER PUMPS
(SKT02PP1/SKT02PP2/SKT02PP3)
SKT02PE/KALTAILS/75-5032-BW-PE12W-450
75-5032-BW-PE12W-450
SALINE WATER
TO BORE WATER DAMS #1 (NORTH) AND #2 (SOUTH)
TP 018
TP 004
SEEPAGE WATER
SEBDT01PE02/75-8067-PE16-225
75-8067-PW-PE16-225
TP 019
TP 005
SEBDT01PE01/75-8068-PE16-315/
DECANT 2 TO SALINE TANKS/
EASTERN BOREFIELDS
75-8068-PW-PE16-315
SEBDT01PE01/75-8068-PE16-315/DECANT 2 TO SALINE TANKS/EASTERN BOREFIELD
TP 020
TP 006
SURGE A-LINE/SST01PE/75-8069-PE6-315
75-8069-PW-PE16-315
FROM SOUTHERN SURGE TANK PUMPS
TO BORE WATER DAM #2 (SOUTH)
TP 016
TP 007
SGT04PE
OFFSITE ROASTER/75-8077-PE6-400
OFFSITE ROASTER/75-8077-PE6-355
75-8077-TW-PE6-400
FROM OFFSITE SALINE DAM TRANSFER PUMPS
(SGT01PP1/SGT01PP2)
TP 042
400VBFD1L2
400x355
DRAIN TO DRIVE-IN SUMP VIA PIPE TRENCH DRAIN CHANNEL
DRAIN
75-8077-PW-PE6-400
F75-PID-PR-60000
F75-PID-PR-25008
TO CYANIDE WATER TANK
FQI 75603
TP 021
75-8088-POT-PE8-110
75-XXX-POT-PEX-110
POTABLE WATER
TO FIM II & KALTAILS
F75-PID-PR-40021
SP 25
160x110
75-8087-POT-PE8-160
FQI 75602
NOTE 8
150VBFD1L2
160x110
100VBFD1L2
75-8086-POT-PE8-110
NOTE 6
TP 014
FRESH WATER/75-8078-POT-PE8-225
75-8078-POT-PE8-225
FQI 75604
200VBFD1L2
225x160
150VBFD1L2
50VB03S1
DRAIN
200x160
200VCD1S2
225x200
TP 008
POTABLE WATER
FROM PLANT SCHEME WATER SUPPLY
TO PLANT
TP 009
75-8089-POT-PE8-200
TO FIRE WATER TANK, HV WORKSHOP, LV WORKSHOP AND OPEN PIT
NOTE 4
TP 010
SEWAGE
FROM MILL
75-8100-RS-PE16-63
50VB03S1
NOTE 4
50VC01S1
NOTE 4
TP 022
TO WWTP
TP 012
75-8101-RS-PE16-63
FROM NORTH
TP 013
RAW SEWERAGE
75-8102-RS-PE16-110
100VBE1S1
100
TP 023
TP 011
75-8103-RS-PE16-63
FROM WEST
APPROVED FOR CONSTRUCTION