
LEGEND:

- EXISTING
- NEW
- FUTURE
- DECOMMISSIONED

NOTES:

1. PIPE ON TOP OF TSF TO BE FLANGED EVERY 40m.
2. LOCATED AT DECANT DAM 4.
3. VALVE TO BE INSTALLED WITHOUT A HANDLE.
4. DIFFERENTIAL FLOW CALCULATION FOR LEAK DETECTION.
5. DIESEL POWERED PUMP TO BE USED DURING COMMISSIONING WORKS. CONTROL OF ELECTRIC PUMP TO BE FUTURE BY OTHERS.

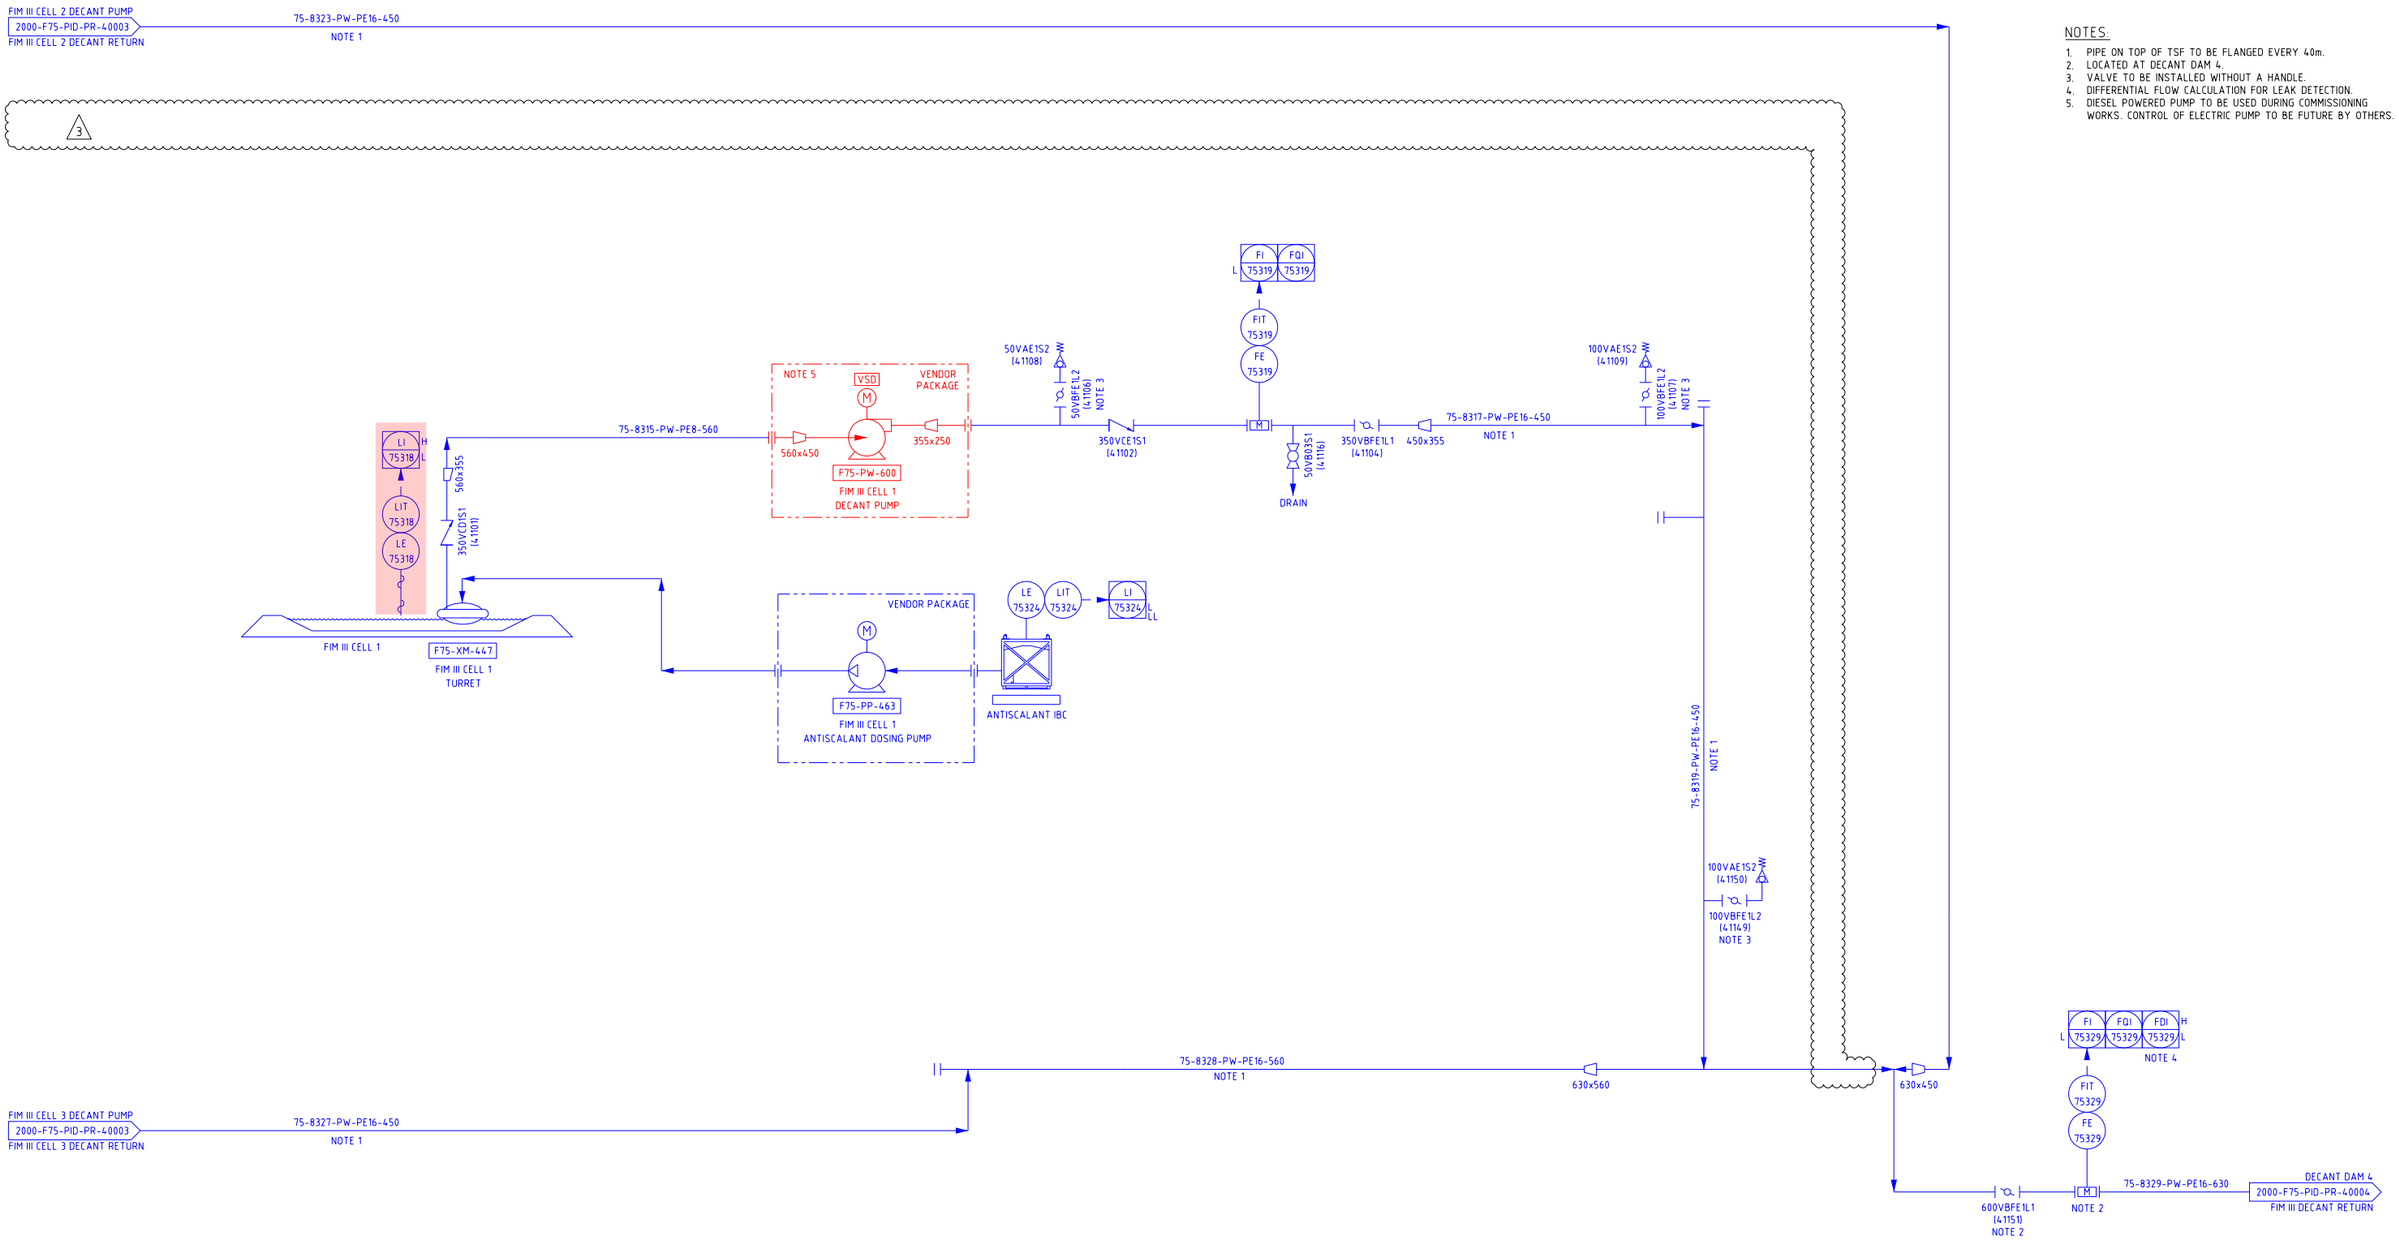

APPROVED FOR CONSTRUCTION