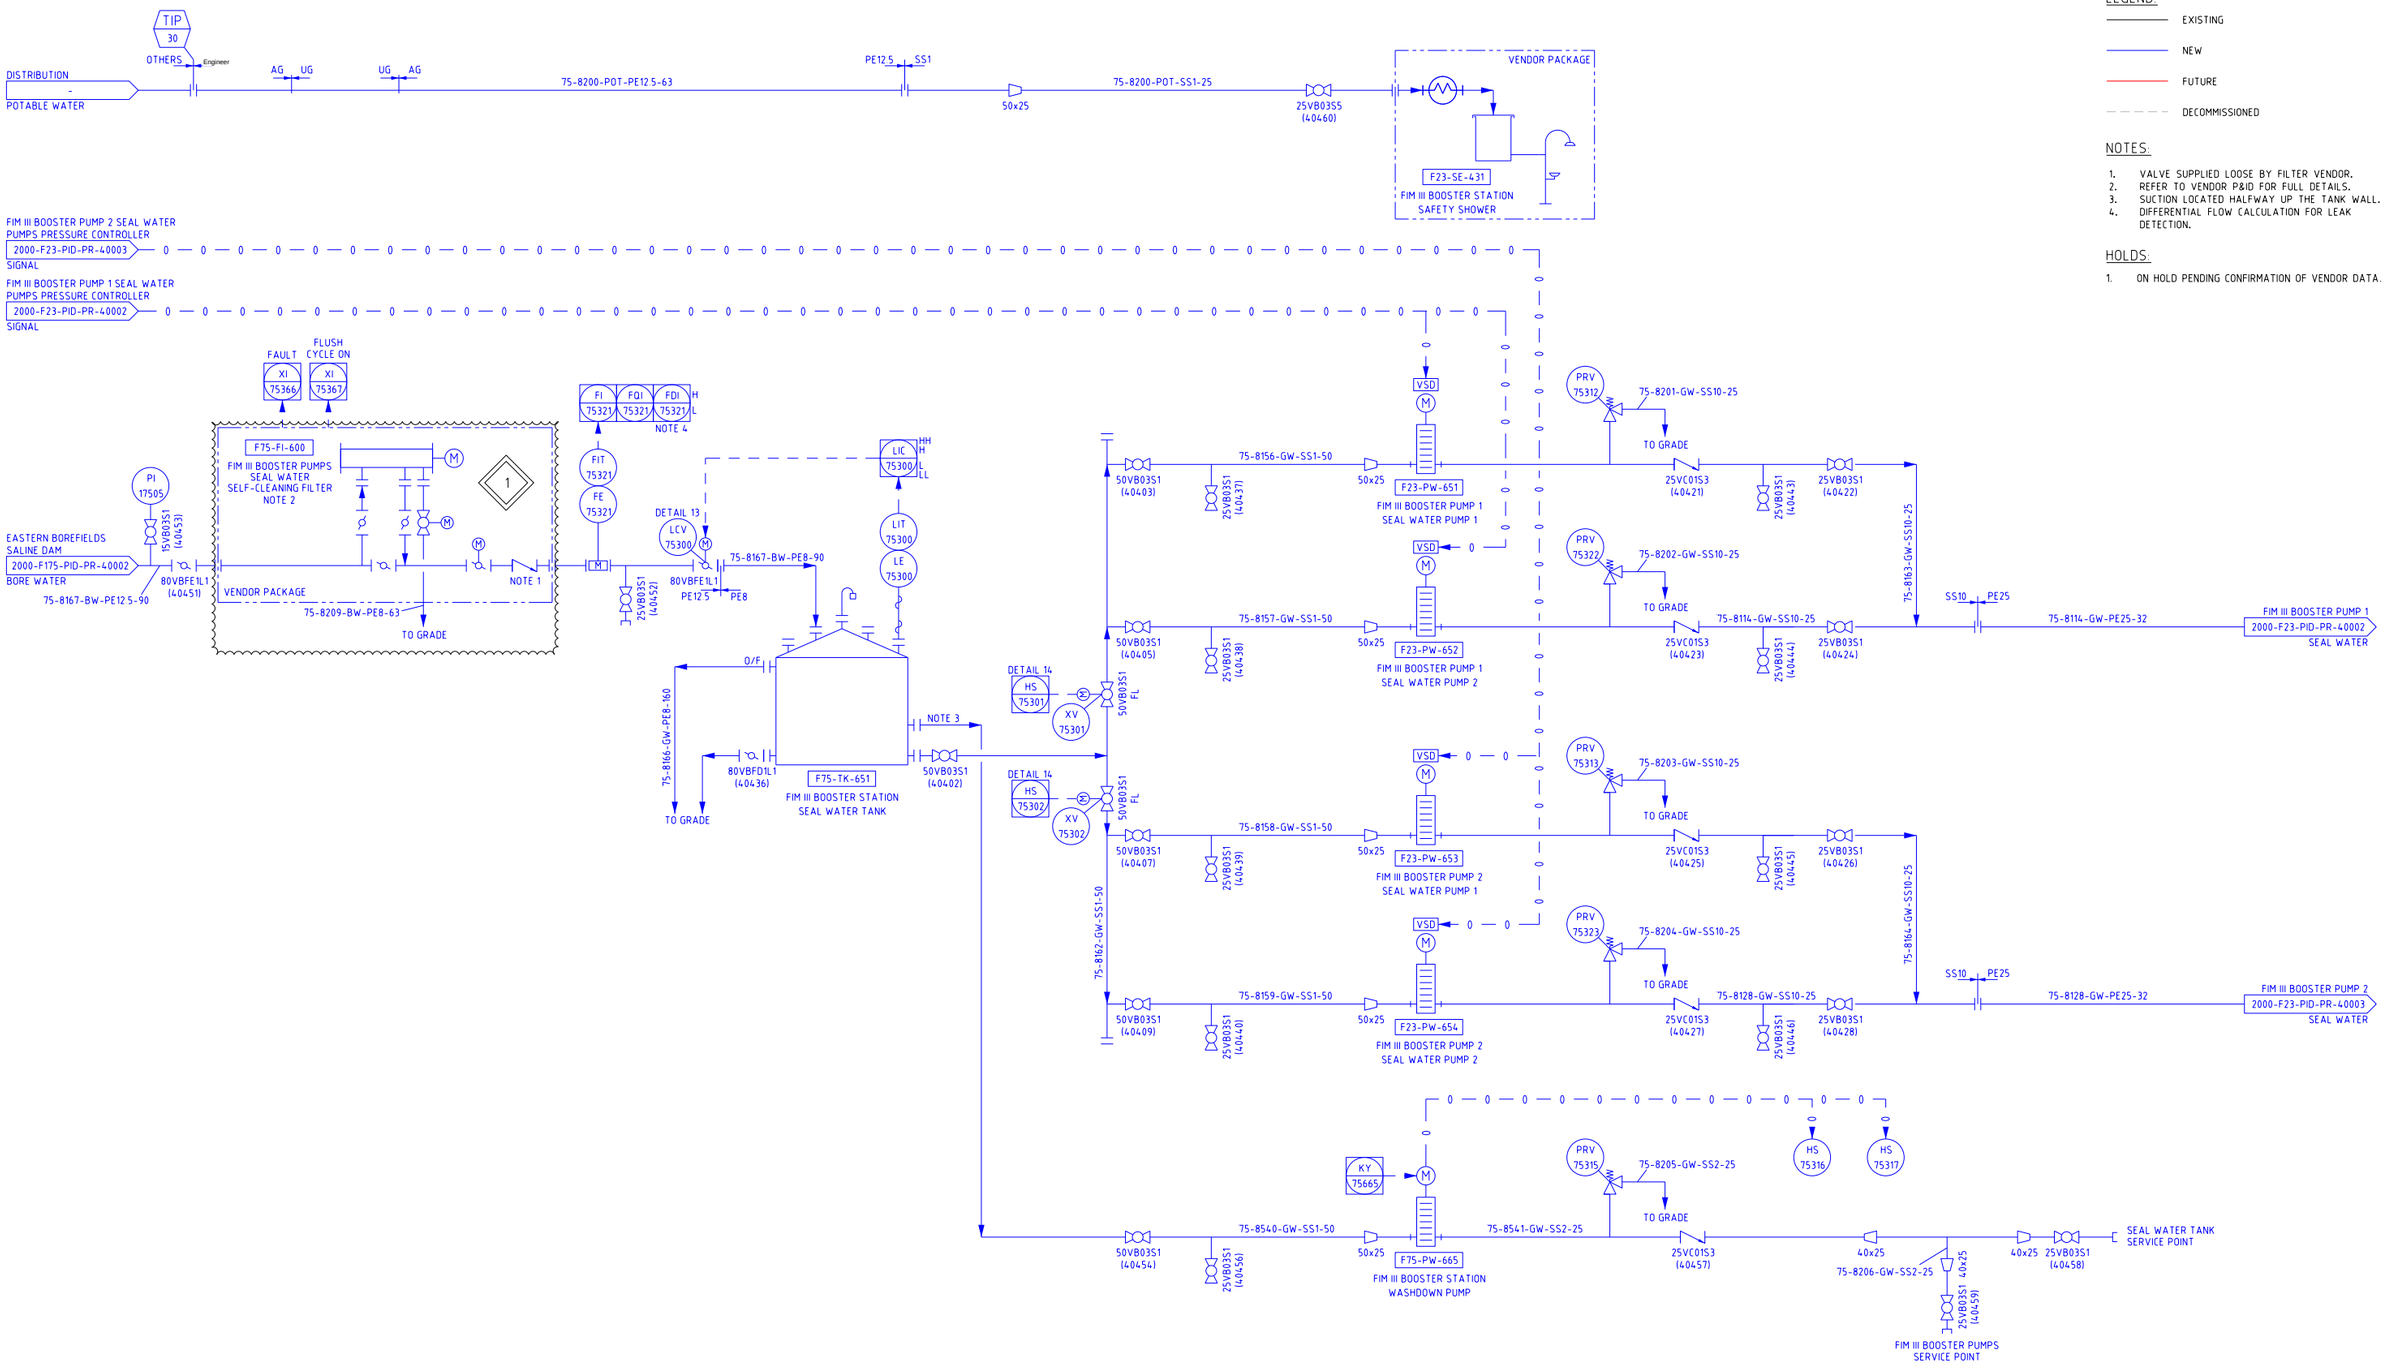


LEGEND:

- EXISTING
- NEW
- FUTURE
- DECOMMISSIONED

NOTES:

1. VALVE SUPPLIED LOOSE BY FILTER VENDOR.
2. REFER TO VENDOR P&ID FOR FULL DETAILS.
3. SUCTION LOCATED HALFWAY UP THE TANK WALL.
4. DIFFERENTIAL FLOW CALCULATION FOR LEAK DETECTION.

HOLDS:

1. ON HOLD PENDING CONFIRMATION OF VENDOR DATA.

APPROVED FOR CONSTRUCTION