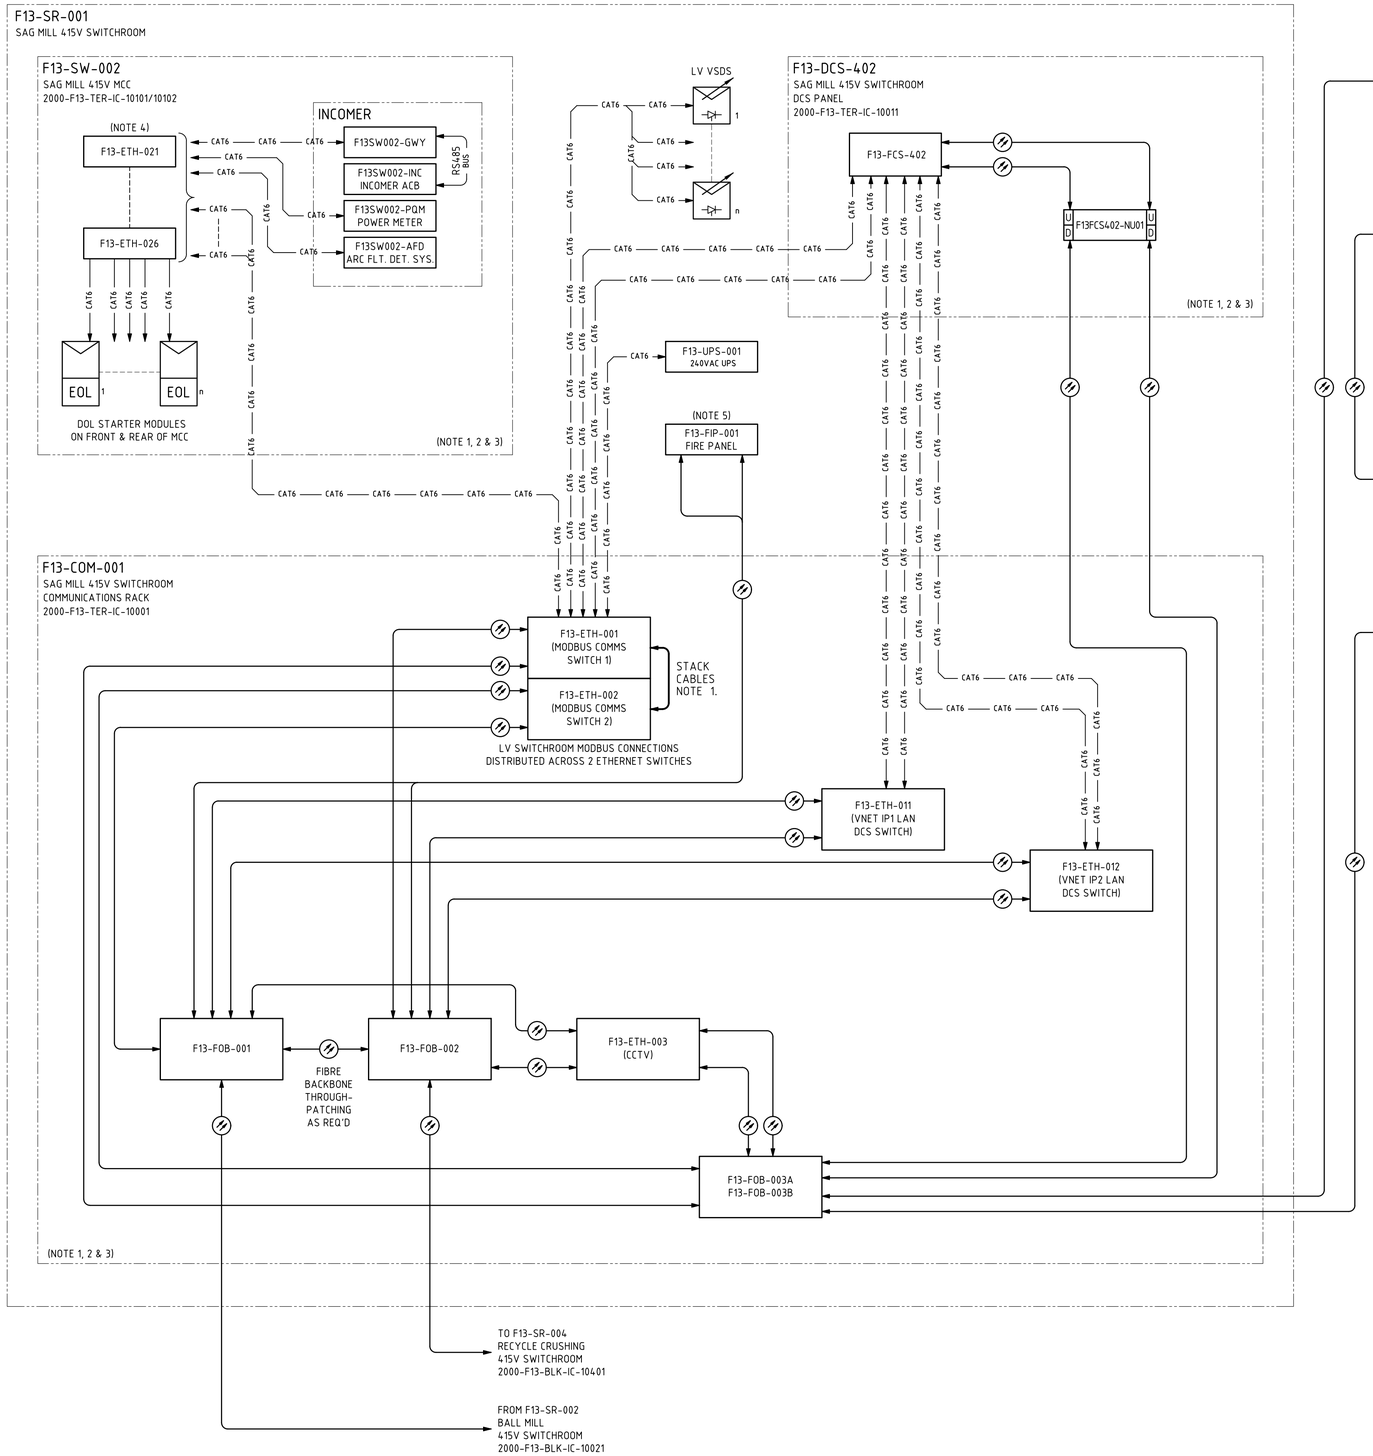


NOTES

1. FOR INTERNAL FIBRE OPTIC, CAT6 PATCH LEAD (& STACK CABLING IN SWITCHROOM COMMS CABINETS) EQUIPMENT CONNECTION DETAILS REFER TO SPECIFIC TERMINATION DIAGRAMS.
2. REFER TO SPECIFIC COMMUNICATIONS TERMINATION DRAWINGS FOR EXTERNAL EQUIPMENT CONNECTION DETAIL.
3. COM CABINET, DCS PANEL, RIO PANEL, MCC & SWITCHBOARD HARDWARE/INTERCONNECTIONS (E.G. NIO NODE) & INTER-FOBOT PATCHING NOT SHOWN FOR CLARITY. REFER TO SPECIFIC COMMUNICATIONS TERMINATION DRGS FOR DETAIL.
4. ETHERNET SWITCHES LOCATED IN CABLE ZONE OF 415VAC MCC, FRONT & BACK - AS REQUIRED.
5. FIRE INDICATION PANELS SHALL BE ON A FIBRE OPTIC RING AND WILL TIE-IN TO EXISTING MAIN PLANT FIRE ANNUNCIATOR PANEL. FIP CONNECTS TO FIBRE INFRASTRUCTURE VIA 2 FIBRE OPTIC PATCH CABLES.

LEGEND

- FOB — FIBRE OPTIC BREAK OUT TRAY
- ETH — ETHERNET SWITCH
  HIRSCHMANN = DCS NETWORKS
  CISCO = ALL OTHER NETWORKS
- FCS — YOKOGAWA
  FIELD CONTROL UNIT
- U xxxFCS4xx-NUxx D — YOKOGAWA NODE INTERFACE UNIT
  (DUAL OPTICAL ESB PORTS:
  U = UPLINK, D = DOWNLINK)
  TAG RELATED TO PARENT FCS
- GWY — COMMUNICATIONS GATEWAY
- MC — FIBRE TO CAT6
  MEDIA CONVERTER
- xxx — EQUIPMENT OR VENDOR PACKAGE
  PANELS AS NOTED WITHIN BLOCK.
- EOL — MCC MODULE
  DOL INTELLIGENT ELECTRONIC
  DEVICE/OVERLOAD
- UPS — UNINTERRUPTIBLE POWER SUPPLY
- VSD - VARIABLE SPEED DRIVE
  (WALL MOUNTED)
- MULTI CORE FIBRE OPTIC CABLE OR
  DUPLEX PATCH LEADS
- CAT6 — CAT6 ETHERNET CABLE CONNECTION

NORTHERN STAR RESOURCES

Approved	X
Approved as Noted	
Not Approved	
For Information Only	

Signed [redacted] Date 15/10/2025

ACCEPTANCE DOES NOT RELIEVE THE SUPPLIER / CONTRACTOR OF ITS RESPONSIBILITY OR LIABILITIES UNDER THE PURCHASE ORDER / CONTRACT

2000-F13-BLK-IC-10001_Rev1

F13-SR-001 - 415V switchroom & N-IO panels - communications block diagram

O:\CAD PROJECTS\235 NORTHERN STAR RESOURCES LTD\23517 KCGM GROWTH PROJECT\03 DELIVERABLES\IC\F13 - MILLING & CLASSIFICATION\2000-F13-BLK-IC-10001.DWG 01OCT25 10:09AM HOTSEAT04