




F13UPS004-ISL
240VAC UPS
MAINTENANCE
BYPASS SWITCH
10 kW



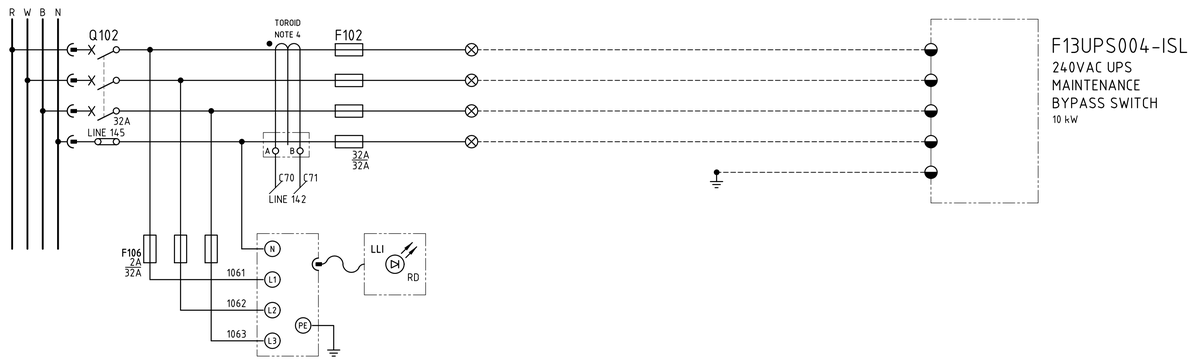




CABLE ZONE
24VDC TERMINALS

24VDC LOOPED POWER
NEXT MODULE
PREV MODULE

| | | |
|---|---|---|
| Q120 | 4A | F13SW114-2530 |
| 1 | | F13SW114-2540 |
| 2 | | F13SW114-2540 |
| 3 | | |
| 4 | | |
| 5 | | |
| 6 | | |
| 7 | | |
| 8 | ⏚ | EARTH |

NOTE 2

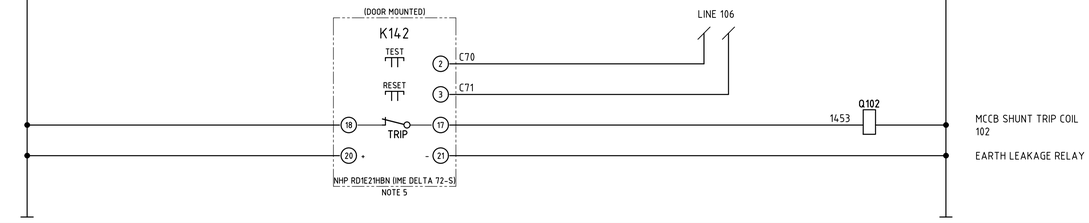



## NOTES

1. TERMINALS ON TERMINAL STRIPS ABOVE 50VAC SHALL HAVE A SEPARATE PERSPEX SHROUD AND SHALL BE LABELLED "DANGER xxxVAC".
2. WIRE NUMBER FERRULES ON TERMINAL STRIP SHALL BE PREFIXED WITH EQUIPMENT NUMBER e.g. F13UPS004-1200, UNLESS OTHERWISE NOTED.
3. EACH WIRE SHALL BE IDENTIFIED AT BOTH ENDS WITH FERRULES.
4. NHP TDGB2
   In:70A IΔn min:0.03A TOROID TO SUIT CABLE DIAMETER.
5. EARTH LEAKAGE RELAY (ELV) USER INTERFACE TO BE MOUNTED ON MCC MODULE DOOR. RELAY ENERGISED (NORMALLY CLOSED CONTACT OPEN) IN NORMAL OPERATION.

## LEGEND

| | |
|---|---|
| 00/01/00 | DCS DIGITAL INPUT |
| 00/02/00 | DCS DIGITAL OUTPUT |
| ⊗ | MCC TERMINAL |
| ◓ | VSD TERMINAL |
| ◒ | FIELD TERMINAL |
| ◑ | DCS OR I/O TERMINAL |
| ◧ | MARSHALLING TERMINAL |
| ⊗ x | DEVICE TERMINAL |
| ⊗ cc | INDICATION LAMP<br>cc = COLOUR |

## TERMINATION LEGEND

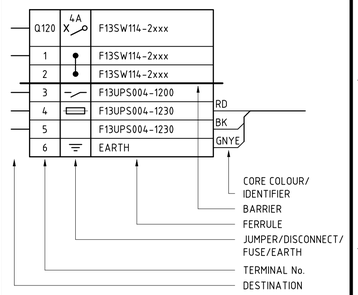


# 2000-F13-SCM-EL-10406_Rev2

F13-SW-114 f13UPS004-isl 240VAC UPS maintenance bypass sw schematic and termination diagram

O:\CAD PROJECTS\235 NORTHERN STAR RESOURCES LTD\235I7 KCGM GROWTH PROJECT\03 DELIVERABLES\E\LF13 - MILLING & CLASSIFICATION\2000-F13-SCM-EL-10406.DWG 07SEP26 10:16AM ROBINLAW