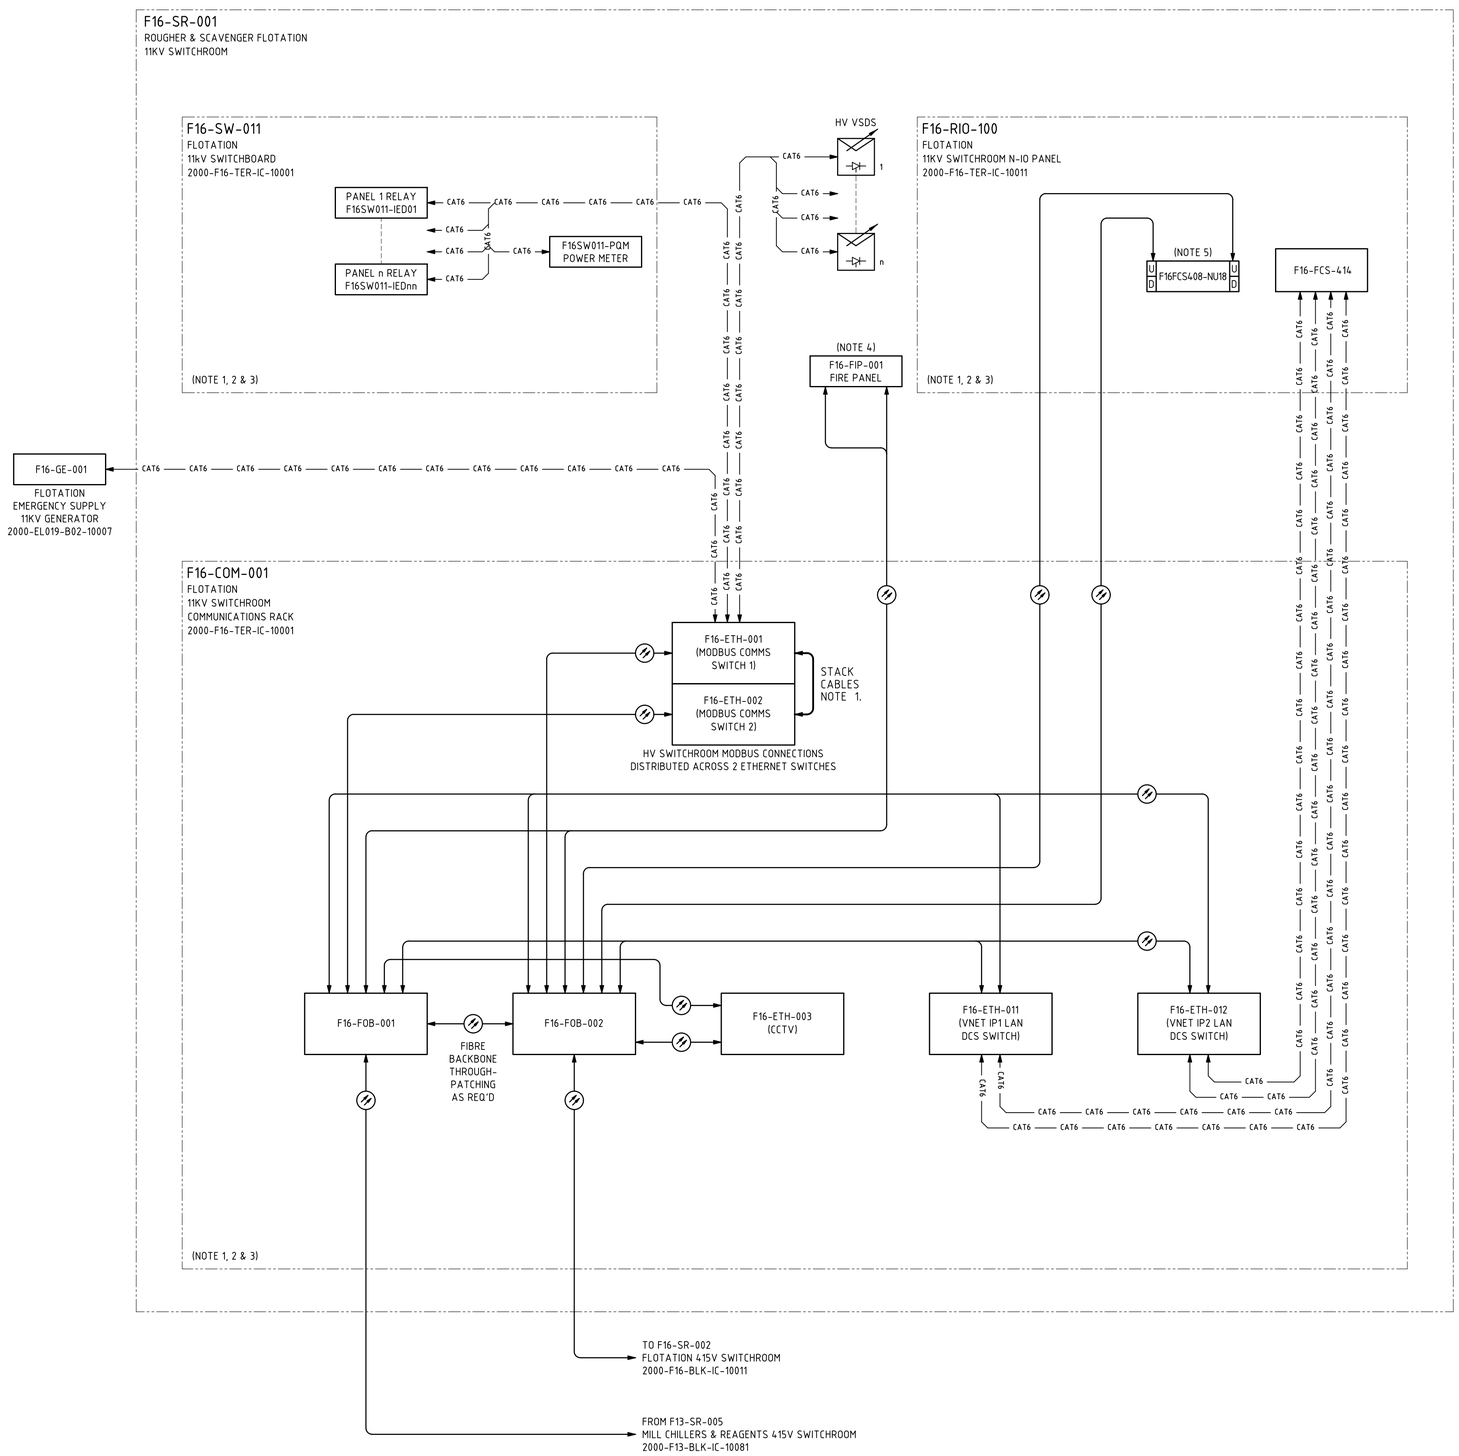


NOTES

1. FOR INTERNAL FIBRE OPTIC, CAT6 PATCH LEAD (& STACK CABLING IN SWITCHROOM COMMS RACKS) EQUIPMENT CONNECTION DETAILS REFER TO SPECIFIC TERMINATION DIAGRAMS.
2. REFER TO SPECIFIC COMMUNICATIONS TERMINATION DRAWINGS FOR EXTERNAL EQUIPMENT CONNECTION DETAIL.
3. COM RACK, DCS PANEL, RIO PANEL, MCC & SWITCHBOARD HARDWARE/INTERCONNECTIONS (E.G. NIO NODE) & INTER-FOBOT PATCHING NOT SHOWN FOR CLARITY. REFER TO SPECIFIC COMMUNICATIONS TERMINATION DRGS FOR DETAIL.
4. FIRE INDICATION PANELS SHALL BE ON A FIBRE OPTIC RING AND WILL TIE-IN TO EXISTING MAIN PLANT FIRE ANNUNCIATOR PANEL. FIP CONNECTS TO FIBRE INFRASTRUCTURE VIA 2 FIBRE OPTIC PATCH CABLES.
5. F16FCS408-NU18 NODE INTERFACE UNIT WITHIN F16-RIO-100 CONNECTS VIA INTER-SWITCHROOM FIBRE OPTIC BACKBONE TO F16-FCS-408 IN THE FLOTATION 415V SWITCHROOM DCS PANEL (F16-DCS-408)

NORTHERN STAR RESOURCES LIMITED

Approved	X
Approved as Noted	
Not Approved	
For Information Only	

Sig [redacted] Date 22/09/2025

ACCEPTANCE DOES NOT RELIEVE THE SUPPLIER / CONTRACTOR OF ITS RESPONSIBILITY OR LIABILITIES UNDER THE PURCHASE ORDER / CONTRACT

LEGEND

FOB	FIBRE OPTIC BREAK OUT TRAY
ETH	ETHERNET SWITCH HIRSCHMANN = DCS NETWORKS CISCO = ALL OTHER NETWORKS
FCS	YOKOGAWA FIELD CONTROL UNIT
U xxxFCS4xx-NUxx D	YOKOGAWA NODE INTERFACE UNIT (DUAL OPTICAL ESB PORTS: U = UPLINK, D = DOWNLINK) TAG RELATED TO PARENT FCS
GE	GENERATOR SET
GWY	COMMUNICATIONS GATEWAY
MC	FIBRE TO CAT6 MEDIA CONVERTER
xxx	EQUIPMENT OR VENDOR PACKAGE PANELS AS NOTED WITHIN BLOCK.
EOL	MCC MODULE DOL INTELLIGENT ELECTRONIC DEVICE/OVERLOAD
UPS	UNINTERRUPTIBLE POWER SUPPLY
	VSD - VARIABLE SPEED DRIVE (WALL MOUNTED)
	MULTI CORE FIBRE OPTIC CABLE OR DUPLEX PATCH LEADS
CAT6	CAT6 ETHERNET CABLE CONNECTION

2000-F16-BLK-IC-10001_Rev2

F16-SR-001 11kV switchroom - communications block diagram

O:\CAD PROJECTS\235 NORTHERN STAR RESOURCES LTD\23517 KCGM GROWTH PROJECT\03 DELIVERABLES\IC\F16 - ROUGHER & SCAVENGER FLOTATION\2000-F16-BLK-IC-10001.DWG 09SEP25 6:35AM HOTSEAT04