
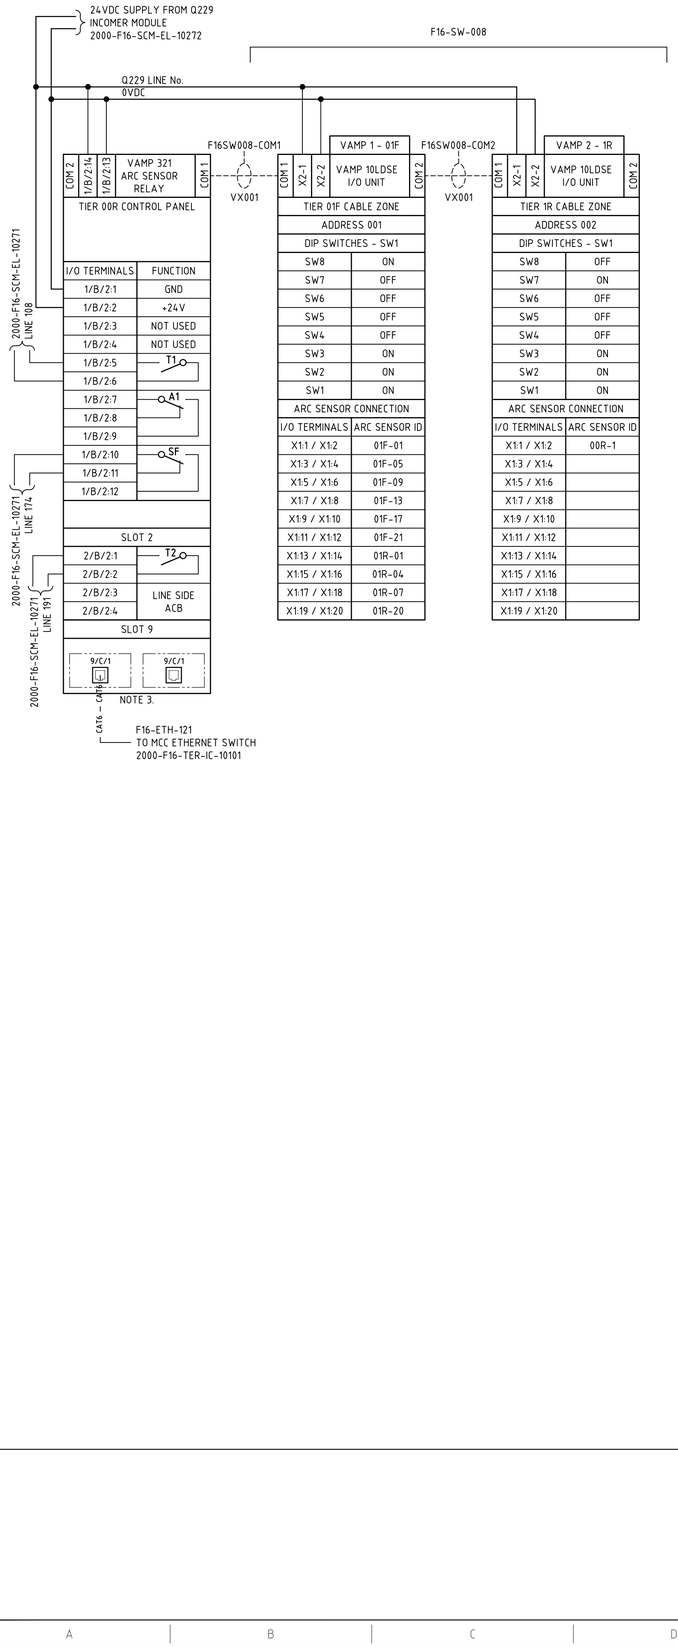



## NOTES

1. CABLE NUMBER FOR ARC FLASH SENSOR VA1DA SHALL BE THE EQUIPMENT NUMBER FOLLOWED BY COM FOR COMMUNICATION AND A SEQUENTIAL NUMBER e.g. F16SW008-COMx.
2. EACH CABLE SHALL BE IDENTIFIED AT BOTH ENDS WITH CABLE NUMBER.
3. VAMP 321 ARC FAULT PROTECTION RELAY SHALL BE MOUNTED TO THE DOOR OF THE PANEL INCOMER CONTROL CUBICLE.
4. VAM 10LDSE INTERFACE SHALL BE MOUNTED ON THE CABLE ZONE DOOR.
5. MAXIMUM 16 VAM10LDSE I/O UNITS IN SERIES.
6. MAXIMUM LENGTH OF VX001 CABLE BETWEEN 2 UNITS (I/O UNITS OR VAMP321 UNIT) IS 30m & TOTAL LENGTH OF THE BUS CABLE FROM THE START TO THE END OF 100m SHALL NOT BE EXCEEDED.

## LEGEND




| DIP SWITCHES KEY VAMP 10LDSE | | |
|---|---|---|
| | ON | OFF |
| SW8 | 1 | 0 |
| SW7 | 2 | 0 |
| SW6 | 4 | 0 |
| SW5 | 8 | 0 |
| SW4 | 16 | 0 |
| SW3 | L> | L> + I> |
| SW2 | LATCH | NON LATCHING |
| SW1 | L> INT | L> EXT |

L = LIGHT / I = CURRENT

# 2000-F16-SCM-EL-10273_Rev2

F16-SW-008 - F16-SW-008 arc flash system - schematic and diagram

O:\CAD PROJECTS\235 NORTHERN STAR RESOURCES LTD\235177 KCGM GROWTH PROJECT\03 DELIVERABLES\ELV\F16 - ROUGHER & SCAVENGER FLOTATION\2000-F16-SCM-EL-10273.DWG 03SEP26 2:05PM ROBINLAW