



Docusign Envelope ID: 8EFFCCD0-5FBC-4D60-9EC2-D85F36275E8D

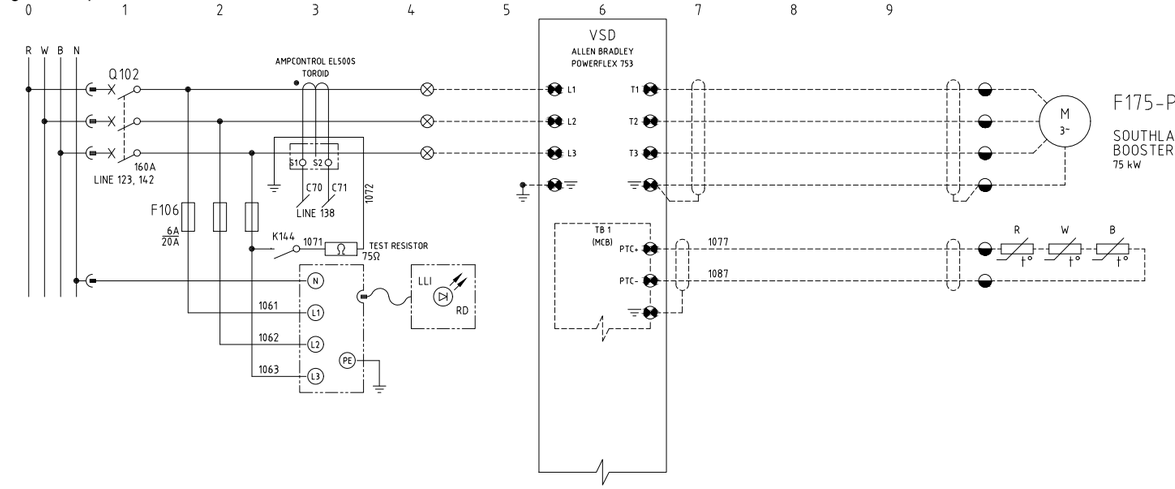

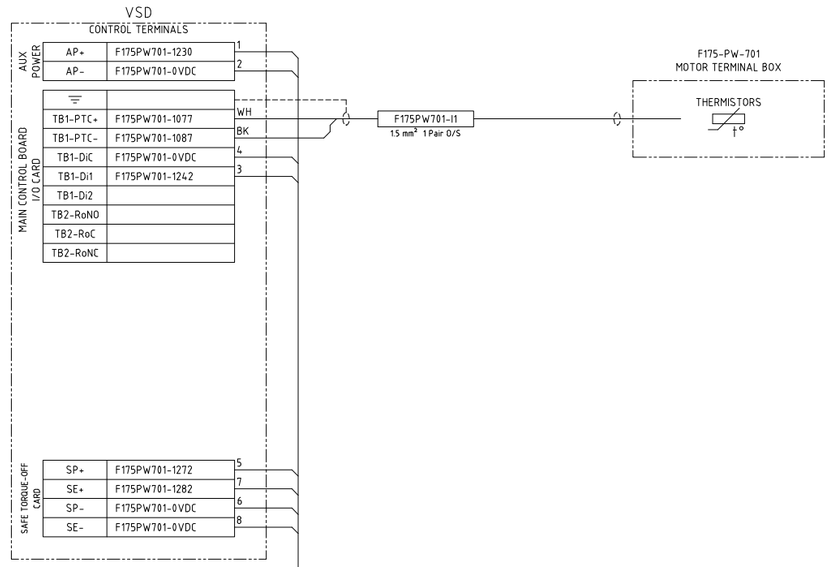

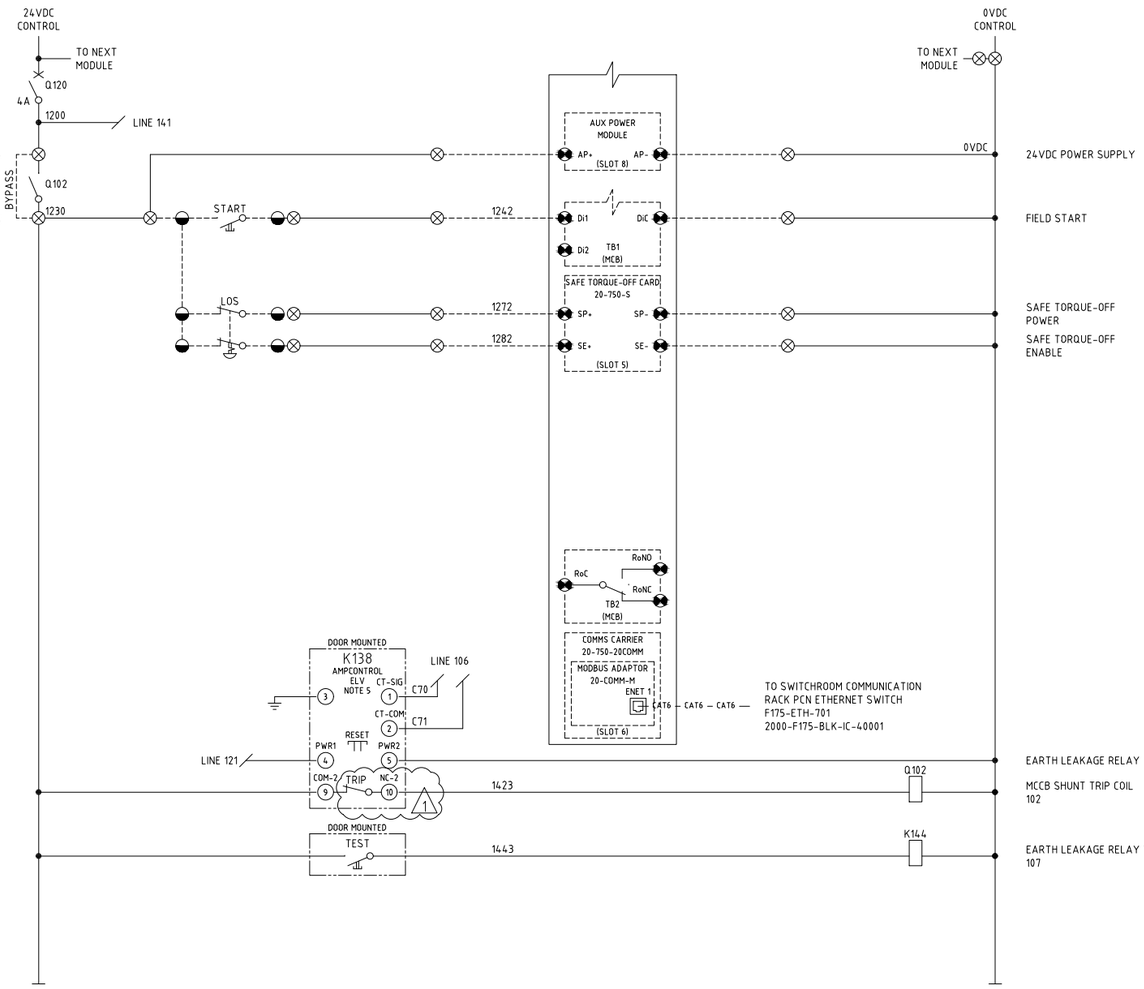

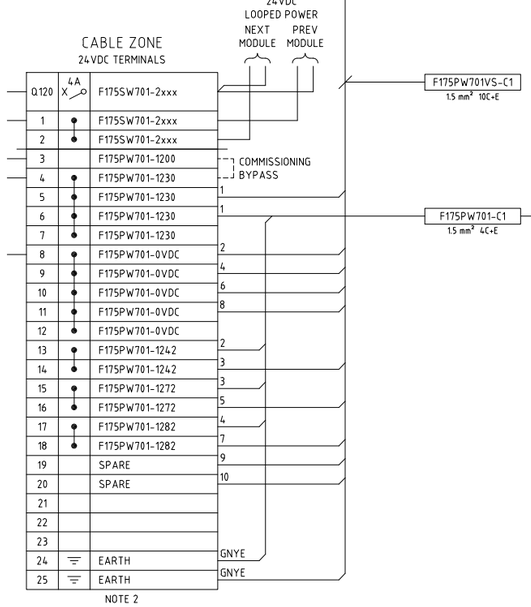


NOTES

1. TERMINALS ON TERMINAL STRIPS ABOVE 50VAC SHALL HAVE A SEPARATE PERSPEX SHROUD AND SHALL BE LABELLED "DANGER xxxVAC".
2. WIRE NUMBER FERRULES ON TERMINAL STRIP SHALL BE PREFIXED WITH EQUIPMENT NUMBER e.g. FxxPPxxx-1200.
3. EACH WIRE SHALL BE IDENTIFIED AT BOTH ENDS WITH FERRULES.
4. THE ELV RELAY REQUIRES A SEPARATELY PURCHASED EL500S TOROID FOR MEASUREMENT OF THE EARTH LEAKAGE CURRENT. EL500S TOROIDS ARE AVAILABLE IN THE FOLLOWING WINDOW SIZES: 25mm, 60mm & 112mm.
5. EARTH LEAKAGE RELAY (ELV) USER INTERFACE TO BE MOUNTED ON MCC MODULE DOOR.
   RELAY SETTINGS SET TO:
   TRIP LEVEL = "1A" (POSITION 0).
   TRIP DELAY = "100ms" (POSITION 1).


LEGEND

- 00/01/00 — DCS DIGITAL INPUT
- 00/02/00 — DCS DIGITAL OUTPUT
- MCC TERMINAL
- VSD TERMINAL
- FIELD TERMINAL
- DCS OR I/O TERMINAL
- MARSHALLING TERMINAL
- (x) — DEVICE TERMINAL
- (cc) — INDICATION LAMP, cc = COLOUR

DCS LEGEND

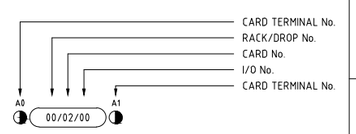

TERMINATION LEGEND

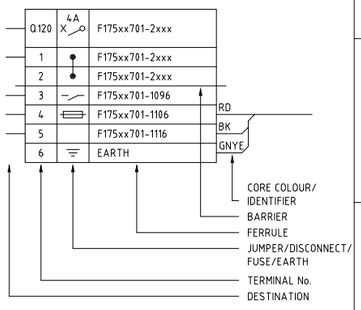

APPROVED FOR CONSTRUCTION

REFERENCES	DWG No	REV	DATE	REVISION	DRN	CHK	TECH APP	PROJ APP
F175-SW-701 LV MOTOR CONTROL CENTRE 24VDC DISTRIBUTION SCHEMATIC DIAGRAM	2000-F175-SCM-EL-40004	1	13.JUN.25	RE-APPROVED FOR CONSTRUCTION	TG	KVN	KVN	TH
F175-SW-701 LV MOTOR CONTROL CENTRE SINGLE LINE DIAGRAM	2000-F175-SLD-EL-40001	0	21.MAY.25	APPROVED FOR CONSTRUCTION	TG	JYW	KVN	TH

NORTHERN STAR RESOURCES LIMITED

DRA PACIFIC (PTY) LIMITED

DRAWN	T GROOM	13.MAR.2025
CHECKED	J WACE	10.APR.2025
DESIGNED	J WACE	10.APR.2025
TECH APP	K VAN NAMEN	10.APR.2025
PROJ APP	T GROOM	21.MAY.2025
CLIENT APP		

PROJECT: KCGM
FIM TSF PROJECT

TITLE: SOUTHLAKES BOOSTER STATION
F175-PW-701 SOUTHLAKE BOOSTER PUMP 1
CONTROL SCHEMATIC DIAGRAM

A1 | SCALE NTS | DRG No. 2000-F175-SCM-EL-40011 | REV 1