


Docusign Envelope ID: 8EFFCCD0-5FBC-4D60-9EC2-D85F36275E8D

F175-HF-701

SOUTHLAKES BOOSTER STATION
LV MCC
ACTIVE HARMONIC FILTER
60 A

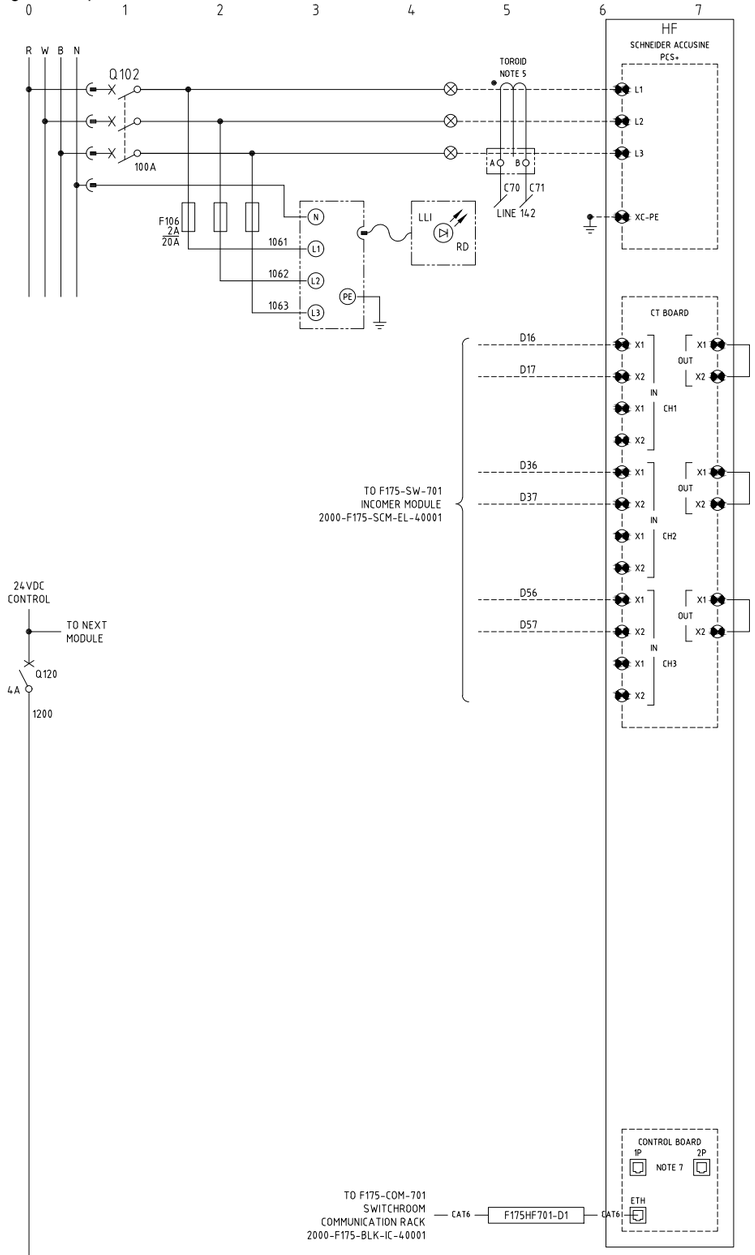

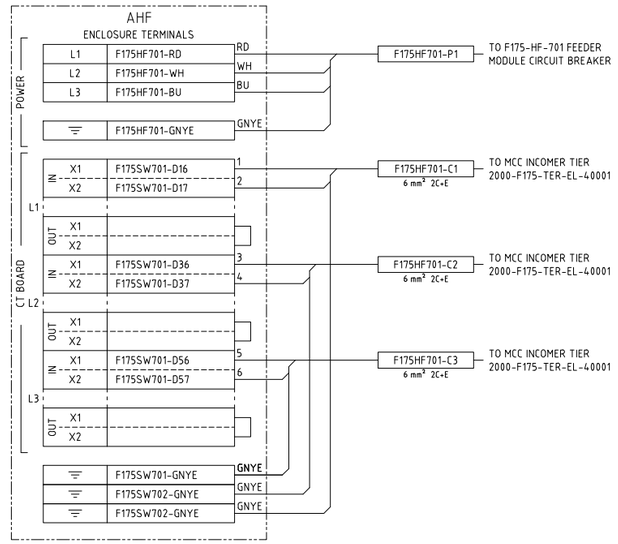


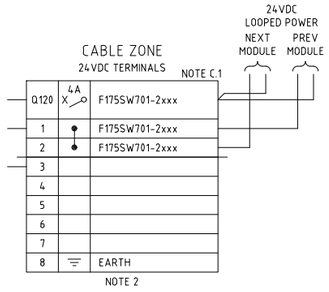


NOTES

1. TERMINALS ON TERMINAL STRIPS ABOVE 50VAC SHALL HAVE A SEPARATE PERSPEX SHROUD AND SHALL BE LABELLED "DANGER xxxVAC".
2. WIRE NUMBER FERRULES ON TERMINAL STRIP SHALL BE PREFIXED WITH EQUIPMENT NUMBER e.g. F175HF701-1200.
3. EACH WIRE SHALL BE IDENTIFIED AT BOTH ENDS WITH FERRULES.
4. NHP TDG×2 TOROID TO SUIT CABLE DIAMETER (TOROID MIN. 30mA).
5. EARTH LEAKAGE RELAY USER INTERFACE TO BE MOUNTED ON MCC MODULE DOOR.
   RELAY SETTINGS SET TO:
   IΔn ="1A".
   DELAY = "100ms".
   RANGES = "x1".
   FAILSAFE MODE = "Ne".
   RESET = "MAN".
6. REFER TO CABLE SCHEDULE 2000-F175-LST-EL-40003.
7. P1 & P2 PORTS ARE FACTORY FITTED WITH RJ45 TERMINATOR.


LEGEND



DCS LEGEND

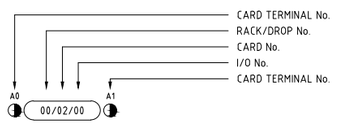

TERMINATION LEGEND

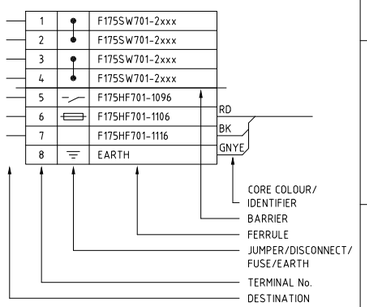

CONSTRUCTION NOTES

C.1 TO BE DETERMINED BY MCC VENDOR

APPROVED FOR CONSTRUCTION

REFERENCES	DWG No	REV	DATE	REVISION	DRN	CHK	TECH APP	PROJ APP
F175-SW-701 – LV MOTOR CONTROL CENTRE SINGLE LINE DIAGRAM	2000-F175-SLD-EL-40001	1	13.JUN.25	RE-APPROVED FOR CONSTRUCTION	TG	JYW	KVN	TH
GENERAL NOTES AND STANDARD DRAWINGS INDEX	2000-F00-STD-EL-10001	0	21.MAY.25	APPROVED FOR CONSTRUCTION	TG	JYW	KVN	TH

Initial / Initial / Initial / DS

NORTHERN STAR RESOURCES LIMITED

DRA PACIFIC (PTY) LIMITED

DRAWN	J. GROOM	13.MAR.2025
CHECKED	J.WEE	10.APR.2025
DESIGNED	J.WEE	10.APR.2025
TECH APP	K.VAN NAMEN	10.APR.2025
PROJ APP	T.HARRIDGE	21.MAY.2025
CLIENT APP	E8201606A17B4A9...	

Signed by: J. GROOM, J.WEE, J.WEE, K.VAN NAMEN, T.HARRIDGE, E8201606A17B4A9...

PROJECT: KCGM
FIM TSF PROJECT

TITLE: SOUTHLAKES BOOSTER STATION
F175-HF-701 LV MCC ACTIVE HARMONIC FILTER FEEDER
CONTROL SCHEMATIC DIAGRAM

A1 | SCALE NTS | DRG No. 2000-F175-SCM-EL-40015 | REV 1