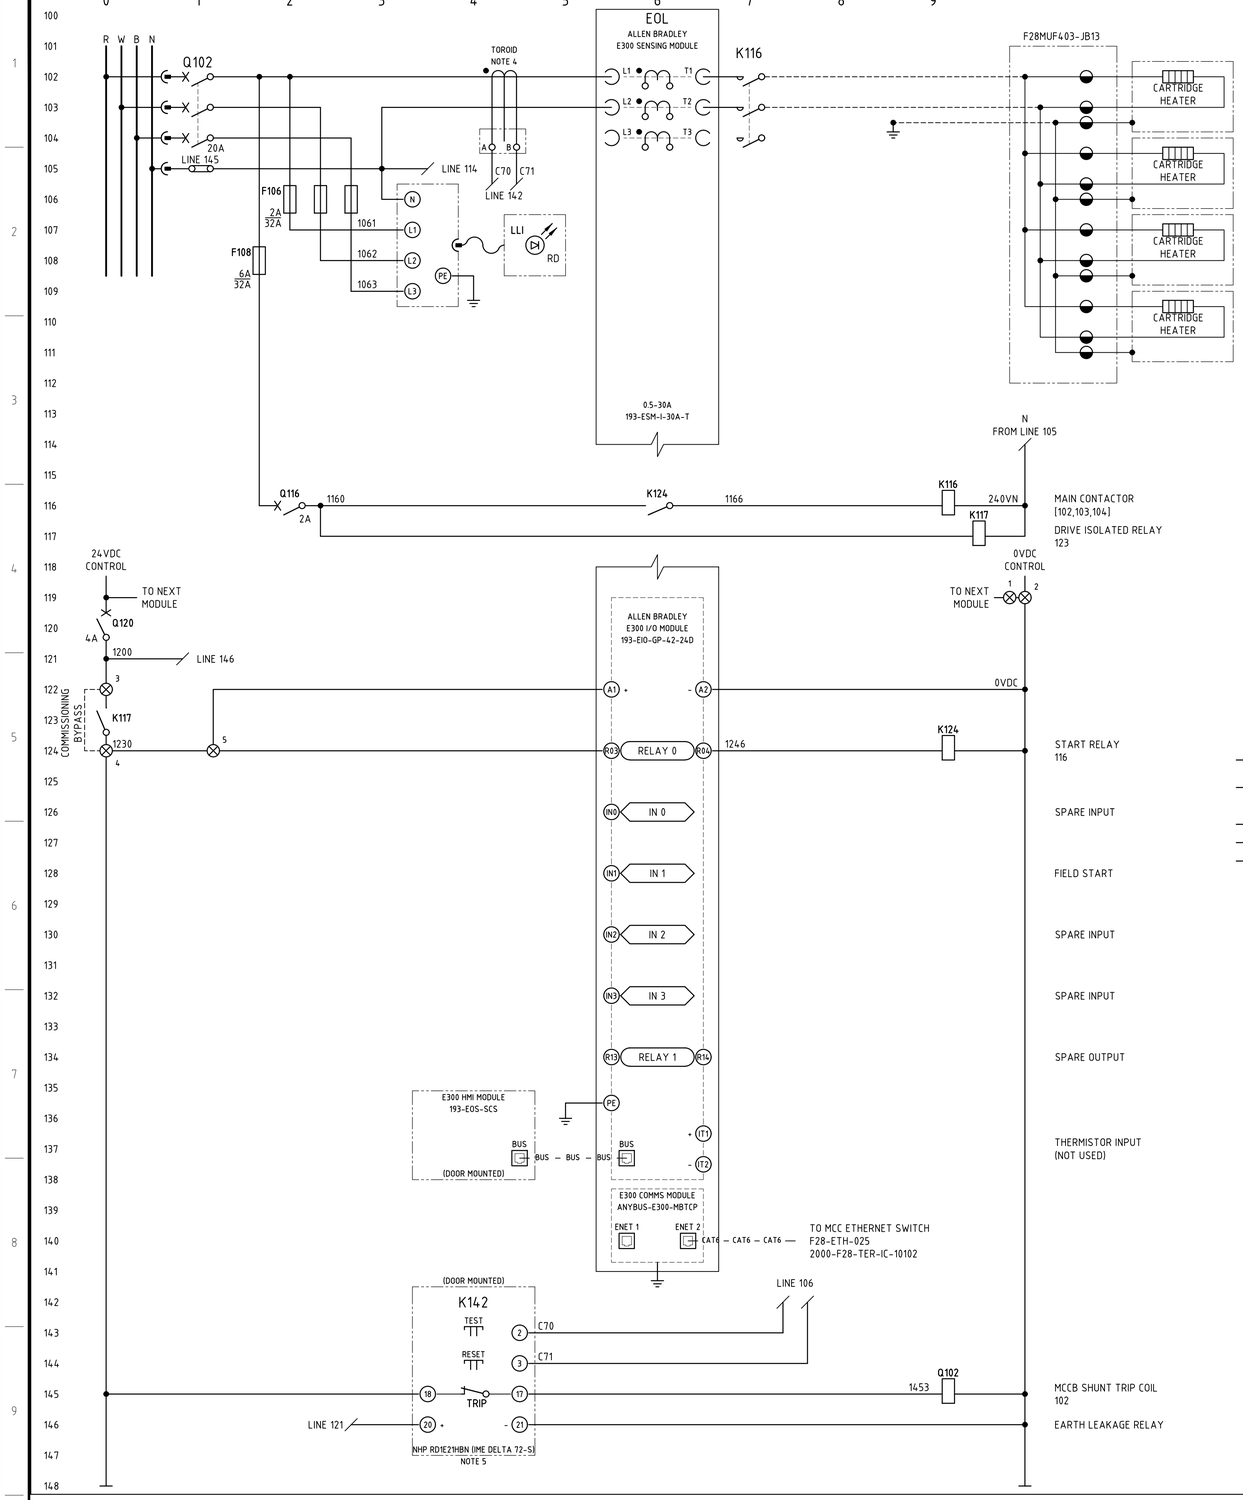


F28-HT-484
UFG MILL 3
BEARING OLS
HEATERS
2.4 kW

CABLE ZONE
24VDC TERMINALS

24VDC LOOPED POWER
NEXT MODULE
PREV MODULE

Q120	4A	F12SW001-2720
1		F12SW001-2730
2		F12SW001-2730
3		F28HT484-1200
4		F28HT484-1230
5		
6		
7		
8		
9		
10		
11		
12		
13	⏚	EARTH

COMMISSIONING BYPASS

NOTE 2

NOTES

1. TERMINALS ON TERMINAL STRIPS ABOVE 50VAC SHALL HAVE A SEPARATE PERSPEX SHROUD AND SHALL BE LABELLED "DANGER xxxVAC".
2. WIRE NUMBER FERRULES ON TERMINAL STRIP SHALL BE PREFIXED WITH EQUIPMENT NUMBER e.g. F28HT484-1200, UNLESS OTHERWISE NOTED.
3. EACH WIRE SHALL BE IDENTIFIED AT BOTH ENDS WITH FERRULES.
4. NHP TDGB2
   IN:70A IΔN MIN:0.03A TOROID TO SUIT CABLE DIAMETER.
5. EARTH LEAKAGE RELAY (ELV) USER INTERFACE TO BE MOUNTED ON MCC MODULE DOOR. RELAY ENERGISED (NORMALLY CLOSED CONTACT OPEN) IN NORMAL OPERATION.

LEGEND

- 00/01/00 — DCS DIGITAL INPUT
- 00/02/00 — DCS DIGITAL OUTPUT
- ⊗ — MCC TERMINAL
- ◕ — VSD TERMINAL
- ◒ — FIELD TERMINAL
- ◑ — DCS OR I/O TERMINAL
- ◧ — MARSHALLING TERMINAL
- (x) — DEVICE TERMINAL
- ⊗cc — INDICATION LAMP, cc = COLOUR

TERMINATION LEGEND

Q120	4A	F28SW009-2xxx
1		F28SW009-2xxx
2		F28SW009-2xxx
3		F28HT484-1200
4		F28HT484-1230
5		F28HT484-1230
6	⏚	EARTH

RD
BK
GNYE

CORE COLOUR/ IDENTIFIER
BARRIER
FERRULE
JUMPER/DISCONNECT/ FUSE/EARTH
TERMINAL No.
DESTINATION

2000-F28-SCM-EL-10218_Rev2

F28-SW-009 - F28-HT-484 UFG mill 3 bearing ols heater - schematic and termination diagram

O:\CAD PROJECTS\235 NORTHERN STAR RESOURCES LTD\23517 KCGM GROWTH PROJECT\03 DELIVERABLES\ELV\F28 - ULTRAFINE GRINDING 2 & 3\2000-F28-SCM-EL-10218.DWG 25SEP26 2:48PM ROBIN.LAW