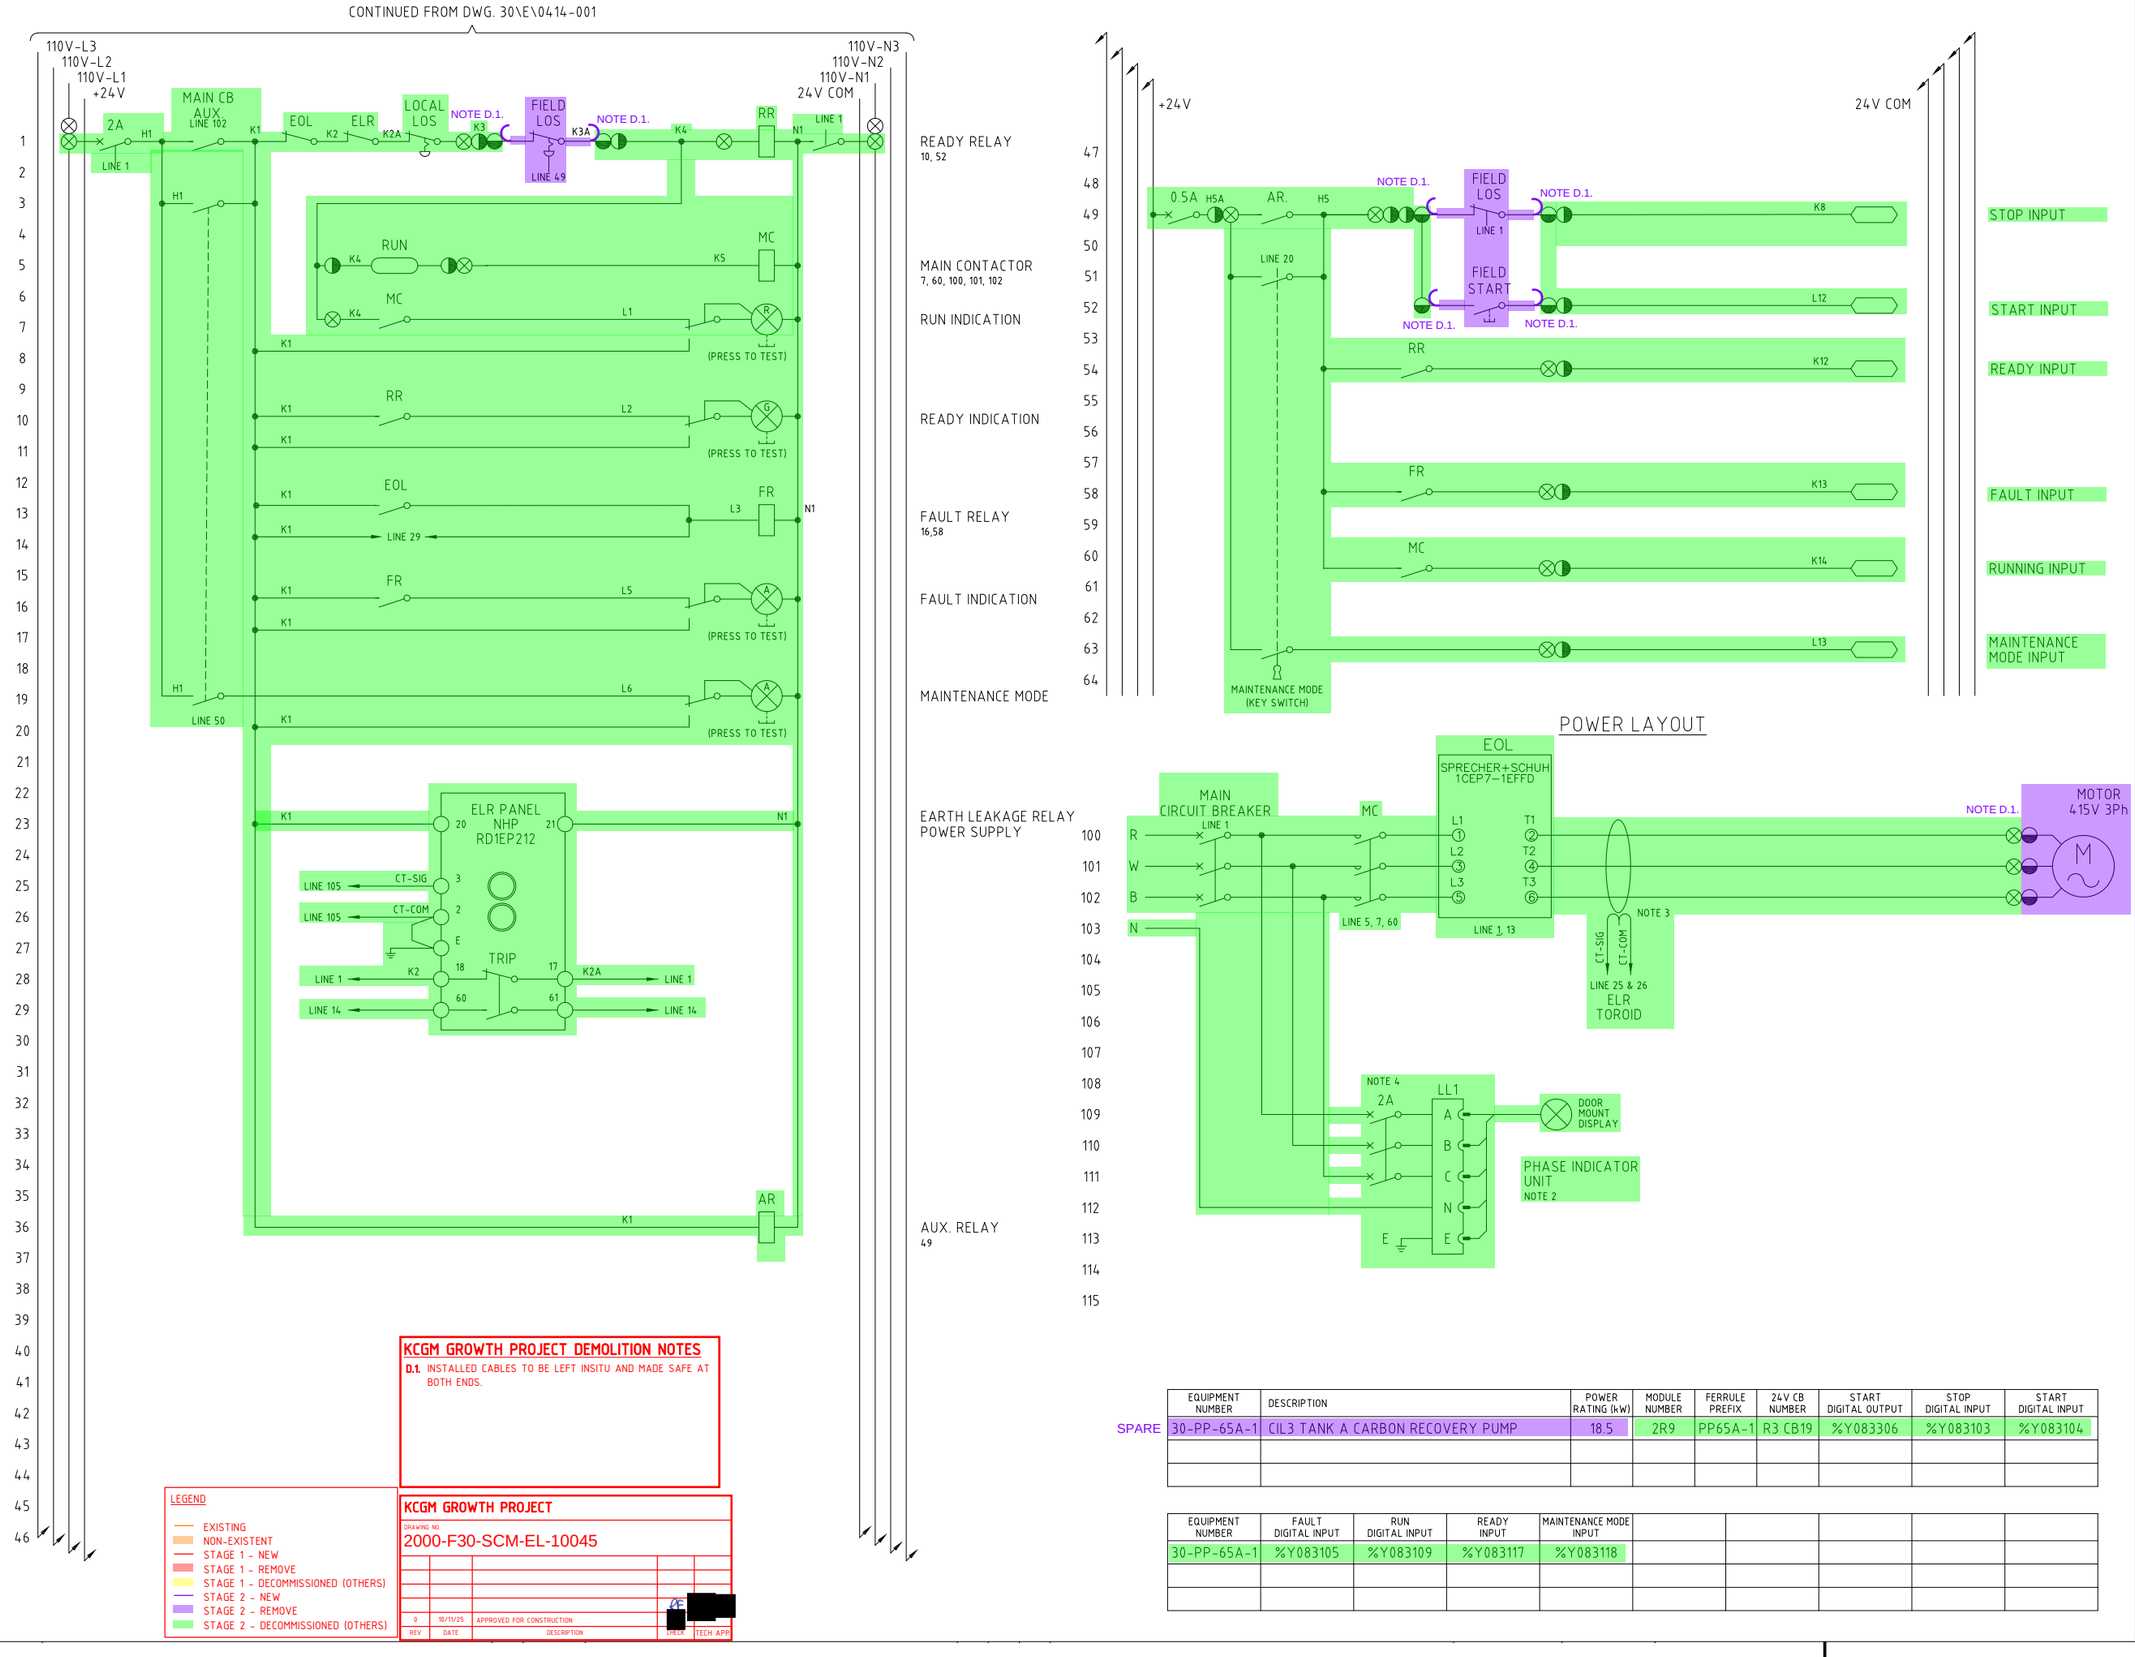


KCGM GROWTH PROJECT DEMOLITION NOTES

D.1. INSTALLED CABLES TO BE LEFT INSITU AND MADE SAFE AT BOTH ENDS.

LEGEND

- EXISTING
- NON-EXISTENT
- STAGE 1 - NEW
- STAGE 1 - REMOVE
- STAGE 1 - DECOMMISSIONED (OTHERS)
- STAGE 2 - NEW
- STAGE 2 - REMOVE
- STAGE 2 - DECOMMISSIONED (OTHERS)

KCGM GROWTH PROJECT

DRAWING NO. 2000-F30-SCM-EL-10045

REV	DATE	DESCRIPTION	CHECK	TECH APP
0	10/11/25	APPROVED FOR CONSTRUCTION	AE [redacted]	

SPARE

EQUIPMENT NUMBER	DESCRIPTION	POWER RATING (kW)	MODULE NUMBER	FERRULE PREFIX	24V CB NUMBER	START DIGITAL OUTPUT	STOP DIGITAL INPUT	START DIGITAL INPUT
30-PP-65A-1	CIL3 TANK A CARBON RECOVERY PUMP	18.5	2R9	PP65A-1	R3 CB19	%Y083306	%Y083103	%Y083104

EQUIPMENT NUMBER	FAULT DIGITAL INPUT	RUN DIGITAL INPUT	READY INPUT	MAINTENANCE MODE INPUT				
30-PP-65A-1	%Y083105	%Y083109	%Y083117	%Y083118				

LEGEND

TERMINALS

- MOTOR CONTROL CENTRE (MCC)
- FIELD
- TELEMETRY/PLC
- FIELD EQUIPMENT CONTROL PANEL
- LINE CONDITIONER
- SOFT STARTER TERMINAL
- VARIABLE SPEED DRIVE
- DISTRIBUTION BOARD
- HV MOTOR CONTROL CENTRE
- TERMINAL STRIP CONNECTION
- MISC. ELECTRICAL DEVICE REFER NOTES FOR SPECIFIC DESC.

DIGITAL FUNCTIONS

- PLC INPUT
- PLC INPUT WITH ALARM FUNCTION
- PLC OUTPUT

ANALOGUE FUNCTION

- 4-20mA PLC INPUT
- 4-20mA PLC OUTPUT

ANCILLARY EQUIPMENT

- CIRCUIT BREAKER
- COMBINATION FUSE SWITCH
- ISOLATOR
- PUSH BUTTON
- LOS (LOCK OFF STOP)
- PULL WIRE SWITCH
- NORMALLY CLOSED CONTACT
- LIMIT SWITCH
- CONTACTOR CONTACT
- NORMALLY OPEN CONTACT
- TIMER CONTACT
- FUNCTION CONTACT
  - P - PRESSURE
  - t° - TEMPERATURE
  - F - FLOW
  - L - FLOAT
- SIREN
- HORN
- RELAY
- LINK
- THERMISTOR
- INDICATION LAMP R - RED, G - GREEN, A - AMBER
- PLUG CONNECTION

NOTES

1. ALL WIRES EXCEPT CONTROL SUPPLIES & THOSE WITHIN FORM 4 MODULES SHALL BE FERRULED WITH PREFIX LISTED IN ABOVE TABLE.
2. PHASE INDICATOR DETAILS: - NHP REM LIVE RL-24i
3. EARTH LEAKAGE RELAY:- NHP TOROID 60mm TDGH2
4. PROTECTION FOR PHASE INDICATOR: DEPEND UPON FAULT LEVEL, USE OF FUSE OR BREAKER SHALL BE ADOPTED

2000-F30-SCM-EL-10045_Rev0

Substation no. 68 MCC 30-SW-64 30-pp-65a-1 CIL3 tank a carbon recovery pump schematic and termination diagram