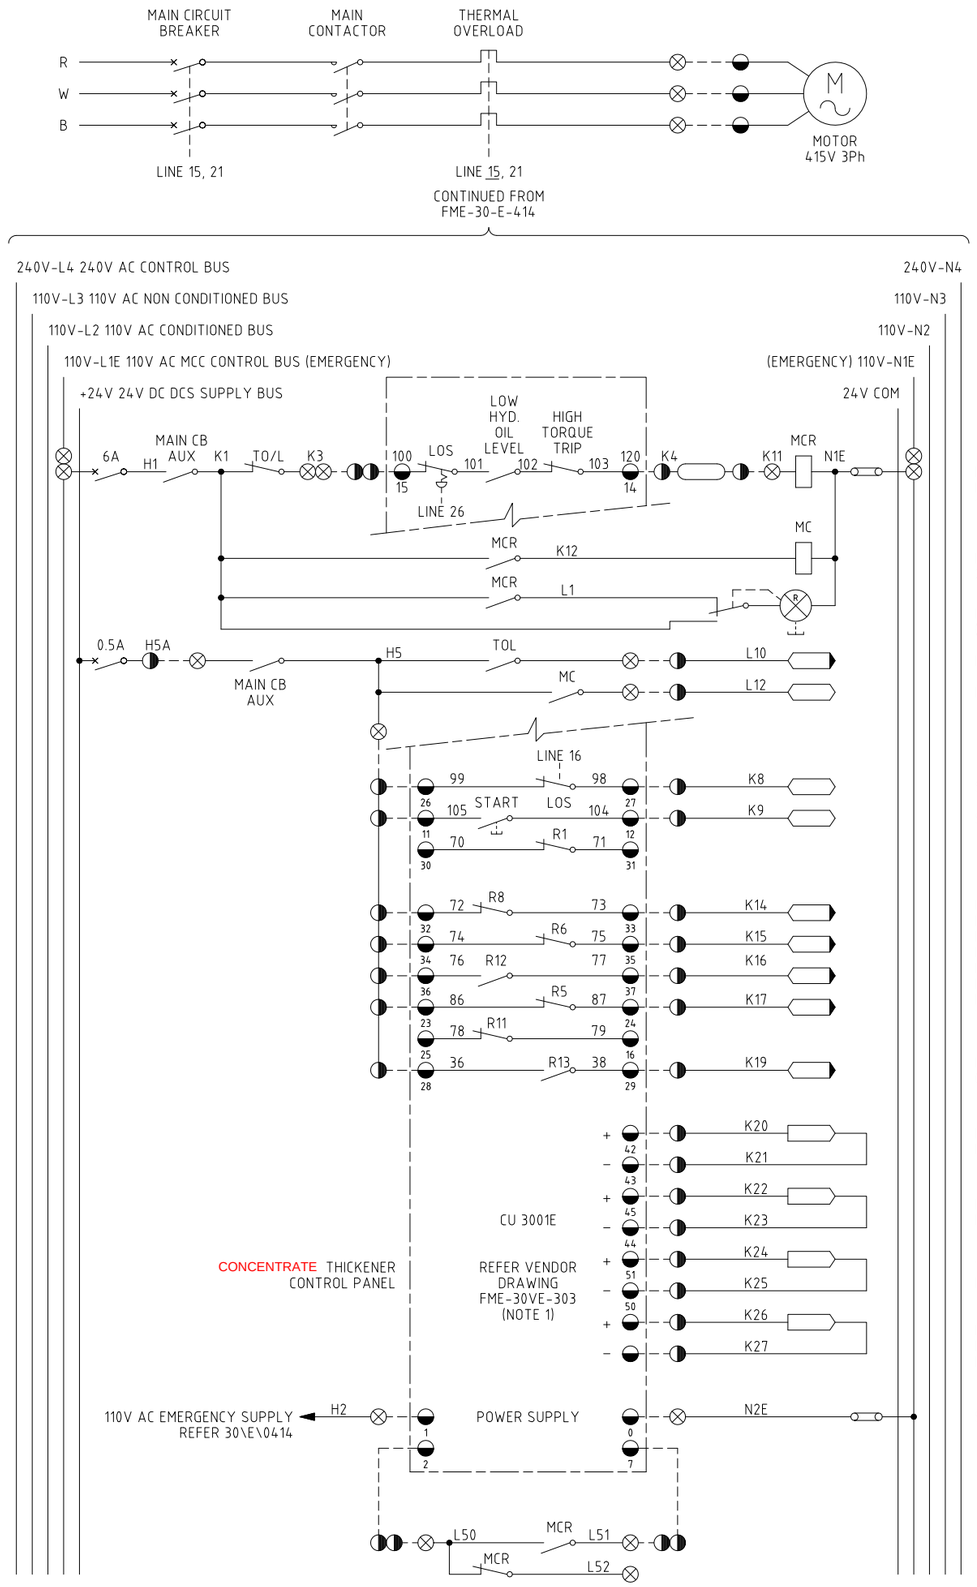


DRIVE No.	NAME	MODULE No.	FERRULE PREFIX	DCS START OUTPUT	DCS STOP INPUT	DCS START INPUT	DCS FAULT INPUT	DCS RUN INPUT
30-TH-61	FLOTATION TAILINGS THICKENER No.3		TH61	%Z055221	%Z053401	%Z053402	%Z053403	%Z053404
	CONCENTRATE THICKENER							

DRIVE No.	RAKE FULLY LOWERED INPUT	RAKE FULLY RAISED INPUT	LOW HYD. OIL LEVEL INPUT	HI TORQUE TRIP INPUT	LOW G/BOX OIL LEVEL INPUT	BED LEVEL INPUT	BED PRESSURE INPUT	TORQUE VALUE INPUT	RAKE POSITION INPUT
30-TH-61	%Z053405	%Z053406	%Z053408	%Z053407	%Z053409	REFER LOOP 30\E\0470	REFER LOOP 30\E\0470	REFER LOOP 30\E\0470	REFER LOOP 30\E\0471

MAIN CONTACTOR RELAY
18, 19, 49, 50

MAIN CONTACTOR
22

RUN INDICATION
(PRESS TO TEST)

FAULT INPUT

RUN INPUT

DRIVE No.	DB No	DCS PANEL	24V CB No
30-TH-61	30-PC-62	DF	B19

STOP INPUT

START INPUT

RAKE FULLY LOWERED INPUT
RAKE FULLY RAISED INPUT
LOW HYD. OIL LEVEL INPUT
HIGH TORQUE TRIP INPUT

LOW G/BOX OIL LEVEL ALARM

ALL INPUTS OPEN ON ALARM

BED LEVEL INPUT

BED PRESS INPUT

TORQUE VALUE INPUT

RAKE POSITION INPUT
NOTE 3

START RELAY

LEGEND

- STAGE 1 - NEW
- STAGE 1 - REMOVE
- STAGE 1 - DECOMMISSIONED (OTHERS)
- STAGE 2 - NEW
- STAGE 2 - REMOVE
- STAGE 2 - DECOMMISSIONED (OTHERS)

KCGM GROWTH PROJECT

DRAWING NO.
2000-F30-SCM-EL-10065

REV	DATE	DESCRIPTION	CHECK	TECH APP
0	10/11/25	APPROVED FOR CONSTRUCTION	RF	MB/DM

	110V-L1E
	110V-L1E
	110V-N1E
	110V-N1E
	H2
	N2E
	K3
	K3
	K11
	H5
	H5A
	L10
	L12
	L50
	L51
	L52

MCC TERMINAL ARRANGEMENT

LEGEND

TERMINALS

- MOTOR CONTROL CENTRE (MCC)
- FIELD
- PROCESS CONTROL CUBICLE (30-PC-62)
- LINE CONDITIONER
- VARIABLE SPEED DRIVE
- DISTRIBUTION BOARD

DIGITAL FUNCTIONS

- DCS INPUT
- DCS INPUT WITH ALARM FUNCTION
- DCS OUTPUT

ANALOGUE FUNCTION

- 4-20mA INPUT
- 4-20mA OUTPUT

ANCILLARY EQUIPMENT

- CONTACT - NORMALLY CLOSED
- CONTACT - NORMALLY OPEN
- LIMIT SWITCH
- CONTACTOR
- PUSH BUTTON
- LOS (LOCK OFF STOP)
- RELAY
- LINK
- CIRCUIT BREAKER
- THERMISTOR
- INDICATION LAMP R RED, G GREEN, A AMBER
- SIREN
- HORN

NOTES

1. 30-TH-61 WAS PREVIOUSLY FINAL TAILS THICKENER 30-RK-32.
2. ALL WIRES EXCEPT CONTROL SUPPLIES & THOSE WITHIN FORM 4 MODULES SHALL BE FERRULED WITH PREFIX LISTED IN ABOVE TABLE.
3. RAKE POSITION TO BE RETROFITTED TO EXISTING THICKENER ON SITE.

CLIENT APPROVED for CONSTRUCTION

DATE: 14.02.95 SIGNED: [redacted]

2000-F30-SCM-EL-10065_Rev0

Substation no. 68 MCC 30-SW-62 30-TH-61 CIL3 concentrate thickener schematic and termination diagram