
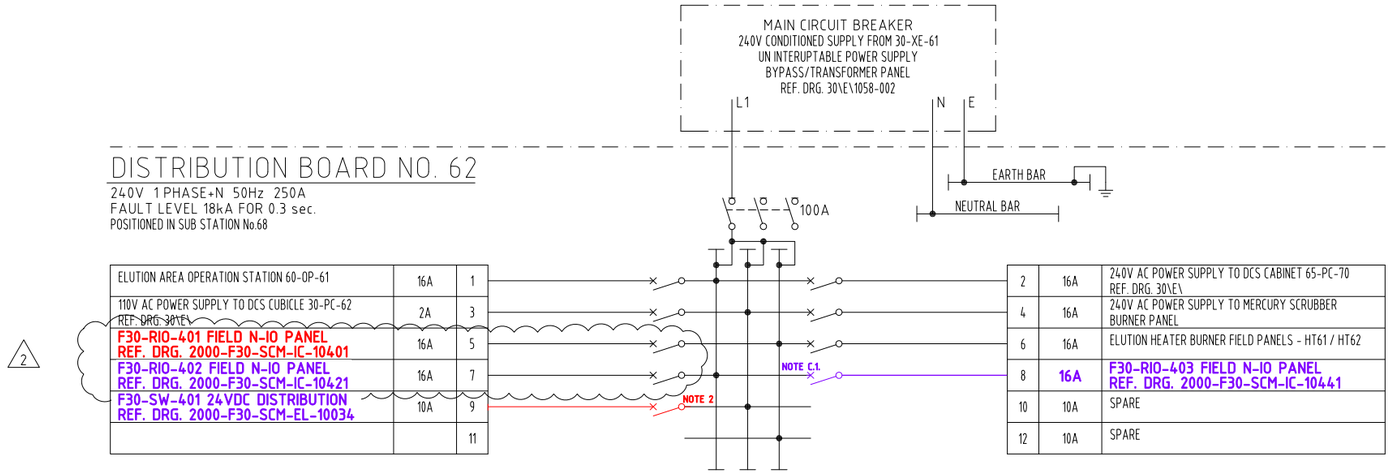


LEGEND

LOCATION

SUB STATION 68
30-DB-62

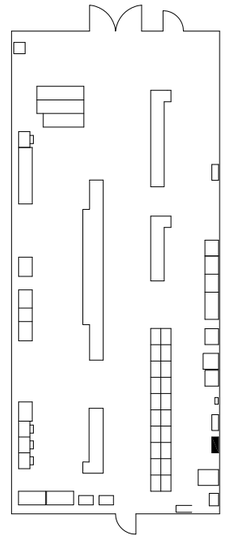

NOTES

1. CIRCUIT BREAKERS SHALL BE TERRASAKI DIN-T 9kA RATED.
2. EXISTING INSTALL (BY OTHERS).

KCGM GROWTH PROJECT CONSTRUCTION NOTES

C.1. INSTALL NEW 16A MCB INTO DISTRIBUTION BOARD SPARE POLE 8.

LEGEND
- STAGE 1 - NEW
- STAGE 1 - REMOVE
- STAGE 1 - DECOMMISSIONED (OTHERS)
- STAGE 2 - NEW
- STAGE 2 - REMOVE
- STAGE 2 - DECOMMISSIONED (OTHERS)

KCGM GROWTH PROJECT

DRAWING NO.
2000-F30-TLD-EL-10001

REV	DATE	DESCRIPTION	CHECK	TECH APP
0	07/04/25	APPROVED FOR CONSTRUCTION		DM

THIS DRAWING SUPERCEDES 30\E\404

2000-F30-TLD-EL-10001_Rev0

Carbon in leach (CIL3) 240V instrument distribution board no. 62 power schematic