
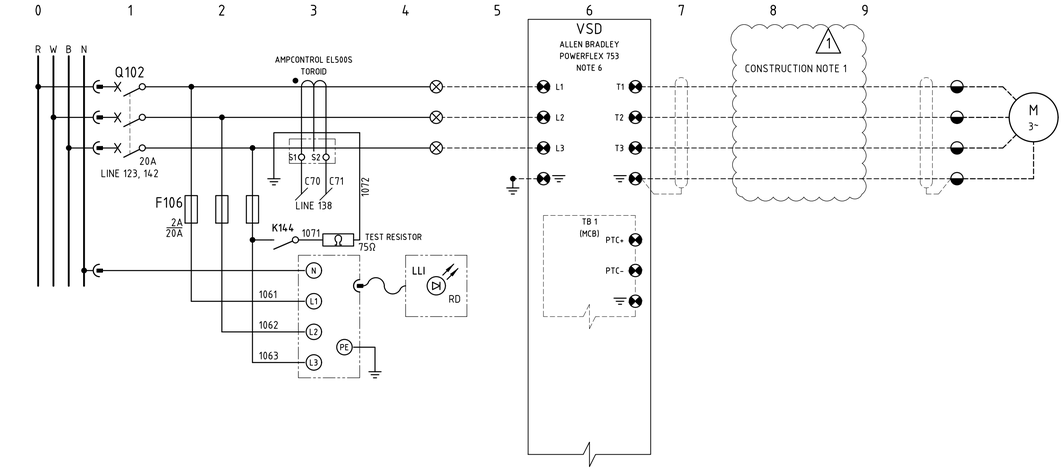


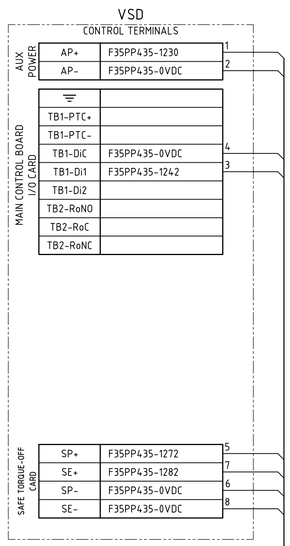

CONSTRUCTION NOTES

1. STAGE 1 F35-PP-448 MOTOR AND LCS CABLES SHALL BE RE-USED FOR THE STAGE 2 NEW F35-PP-435 MOTOR AND LCS. CABLES TO BE RE-LABELLED AT BOTH ENDS TO SUIT THE NEW F35-PP-435 EQUIPMENT.


(REMOVE AS BUILT)


NOTES

1. TERMINALS ON TERMINAL STRIPS ABOVE 50VAC SHALL HAVE A SEPARATE PERSPEX SHROUD AND SHALL BE LABELLED "DANGER xxxVAC".
2. WIRE NUMBER FERRULES ON TERMINAL STRIP SHALL BE PREFIXED WITH EQUIPMENT NUMBER e.g. F35PP435-1200 (UNLESS OTHERWISE NOTED).
3. EACH WIRE SHALL BE IDENTIFIED AT BOTH ENDS WITH FERRULES.
4. THE ELV RELAY REQUIRES A SEPARATELY PURCHASED EL500S TOROID FOR MEASUREMENT OF THE EARTH LEAKAGE CURRENT. EL500S TOROIDS ARE AVAILABLE IN THE FOLLOWING WINDOW SIZES: 25mm, 60mm & 112mm.
5. EARTH LEAKAGE RELAY (ELV) USER INTERFACE TO BE MOUNTED ON MCC MODULE DOOR.
   RELAY SETTINGS SET TO:
   TRIP LEVEL ="1A" (POSITION 0).
   TRIP DELAY = "100ms" (POSITION 1).
6. VSD SHALL BE SIZE FRAME 2 AND ABOVE.


LEGEND

- 00/01/00 — DCS DIGITAL INPUT
- 00/02/00 — DCS DIGITAL OUTPUT
- MCC TERMINAL
- VSD TERMINAL
- FIELD TERMINAL
- DCS OR I/O TERMINAL
- MARSHALLING TERMINAL
- DEVICE TERMINAL
- INDICATION LAMP (cc = COLOUR)

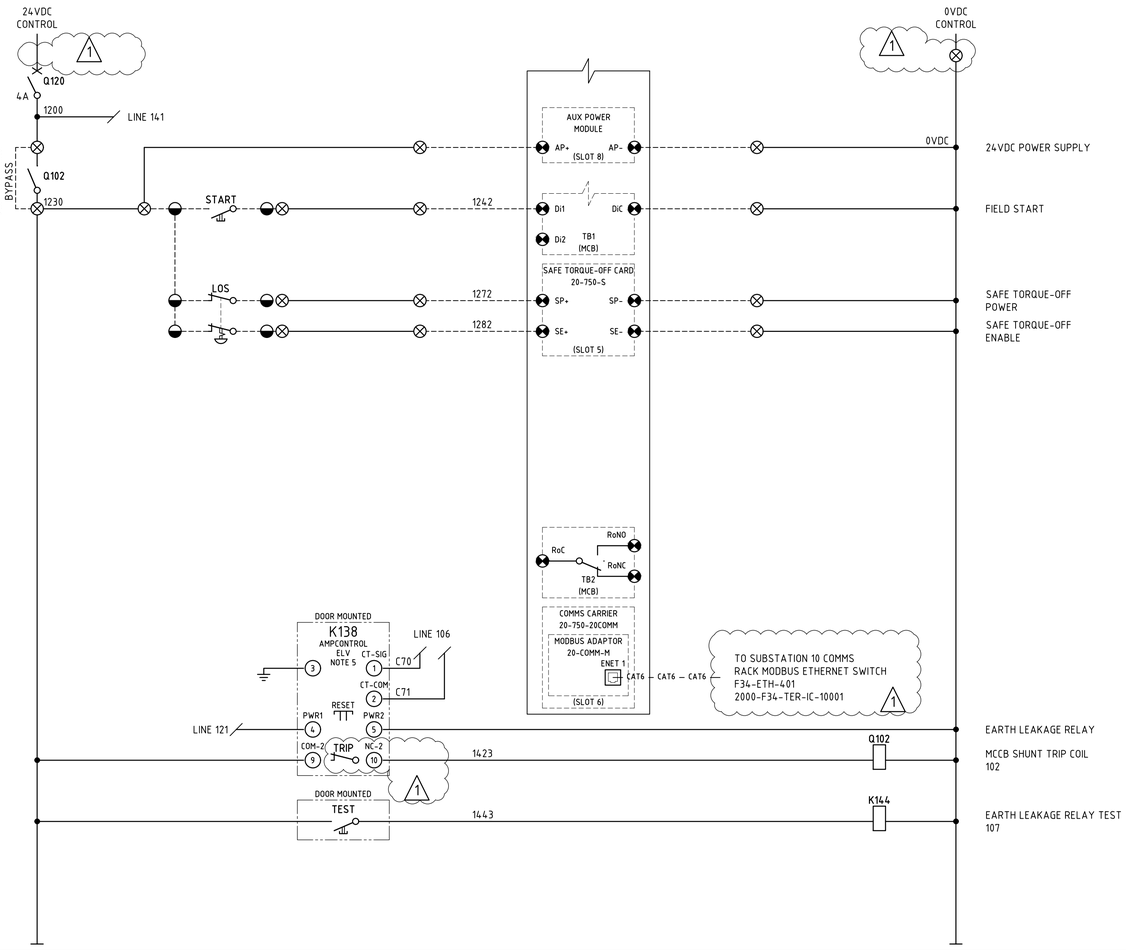

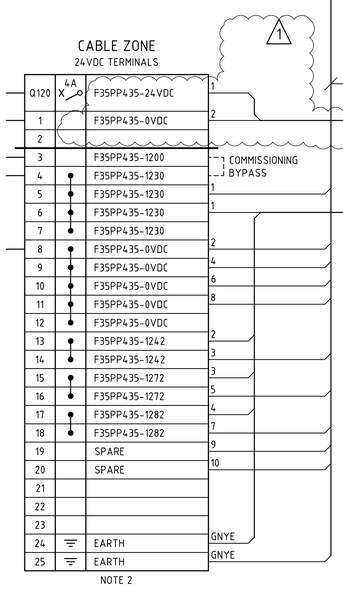

TERMINATION LEGEND

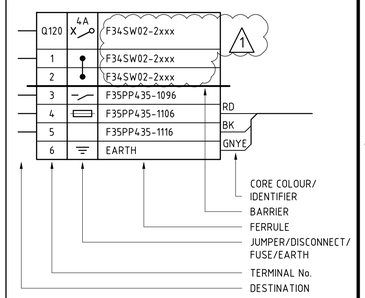

2000-F34-SCM-EL-10002_Rev1

Substation no. 10 MCC 34-SW-02 - F35-PP-435 UFG circuit 1 feed pump - schematic and termination diagram

O:\CAD PROJECTS\235 NORTHERN STAR RESOURCES LTD\235171 KCGM GROWTH PROJECT\03 DELIVERABLES\EL\F34 - ULTRA FINE GRINDING\2000-F34-SCM-EL-10002.DWG 01APR25 9:34AM SAM.KEEL