

Docusign Envelope ID: 1C123F4F-48ED-425D-A3F4-754BD8FC0FD6

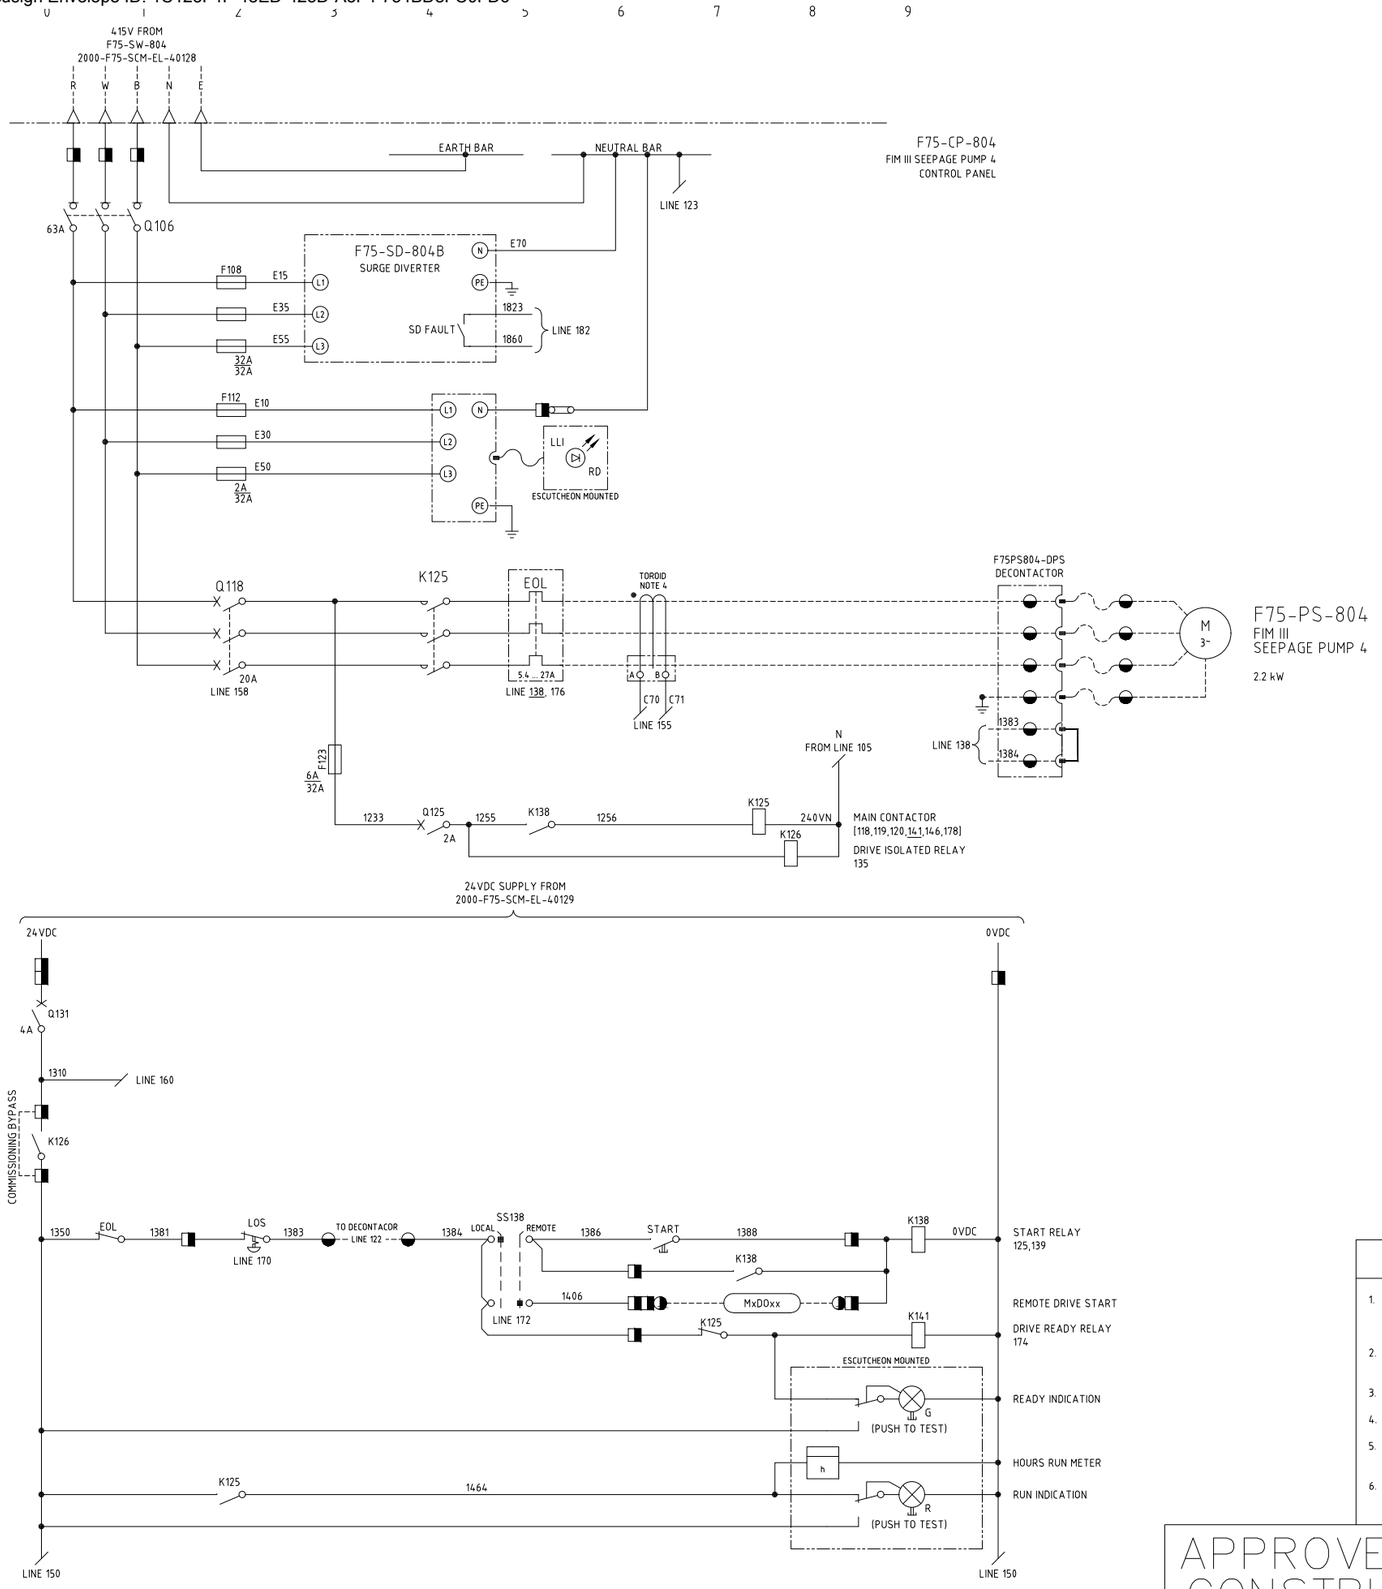

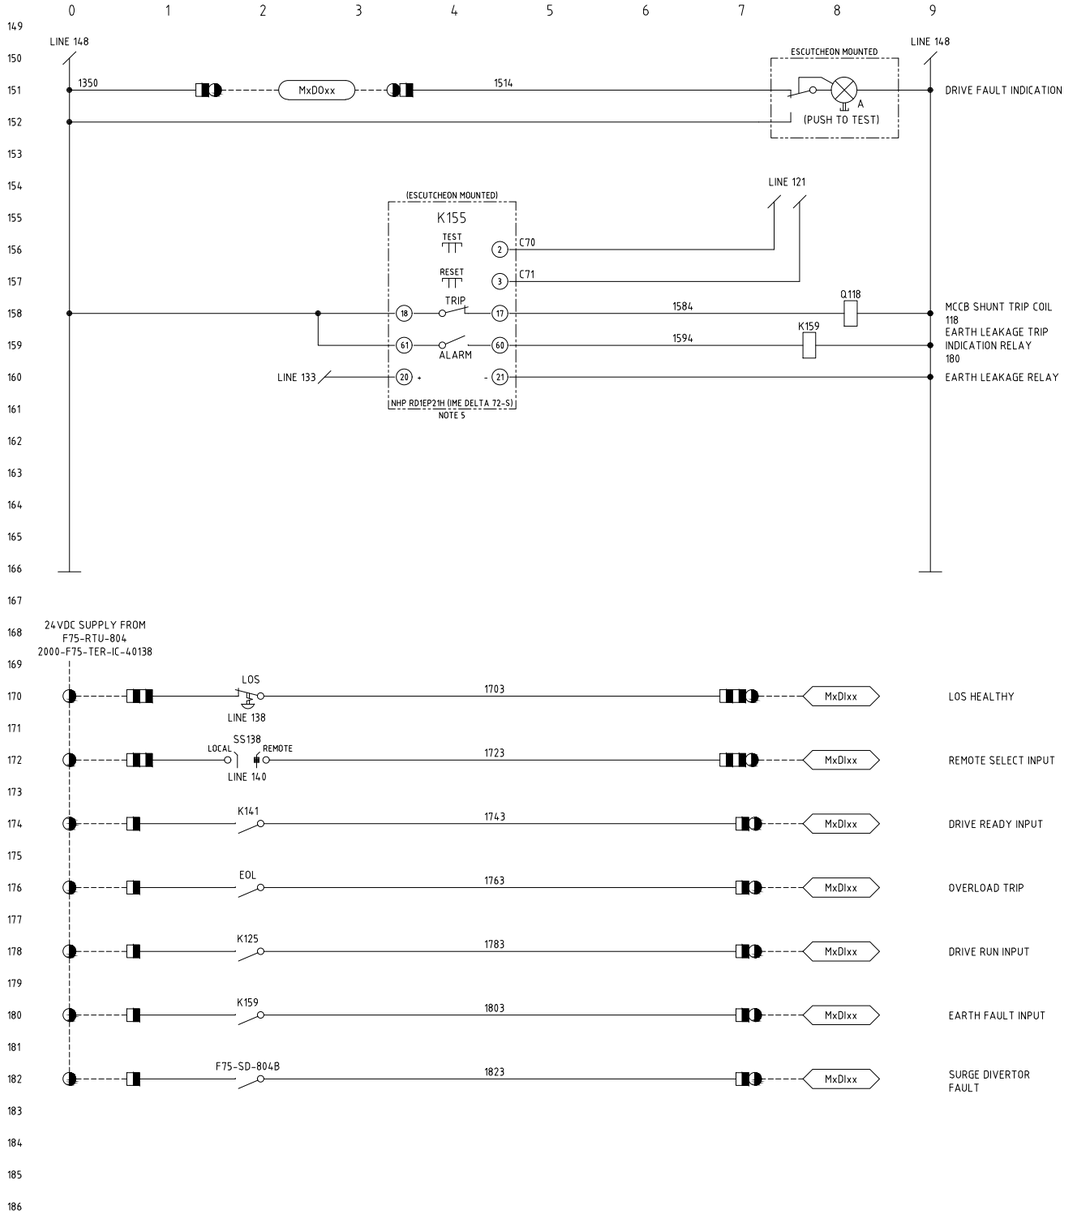


NOTES

1. TERMINALS ON TERMINAL STRIPS ABOVE 50VAC SHALL HAVE A SEPARATE PERSPEX SHROUD AND SHALL BE LABELLED "DANGER xxxVAC".
2. WIRE NUMBER FERRULES ON TERMINAL STRIP SHALL BE PREFIXED WITH EQUIPMENT NUMBER e.g. FxxPSxxx-1200.
3. EACH WIRE SHALL BE IDENTIFIED AT BOTH ENDS WITH FERRULES.
4. NHP TDGx2 TOROID TO SUIT CABLE DIAMETER.
5. EARTH LEAKAGE RELAY USER INTERFACE TO BE MOUNTED ON CONTROL PANEL ESCUTCHEON.
6. REFER 2000-F75-LST-IC-40004 FOR RTU I/O ADDRESSES AND TERMINATION DETAILS.

LEGEND

- MxDIxx — RTU DIGITAL INPUT
- MxDOxx — RTU DIGITAL OUTPUT
- SWITCHBOARD TERMINAL
- VSD TERMINAL
- FIELD TERMINAL
- RTU TERMINAL
- CONTROL PANEL TERMINAL
- DEVICE TERMINAL
- INDICATION LAMP (cc = COLOUR)

TERMINATION LEGEND

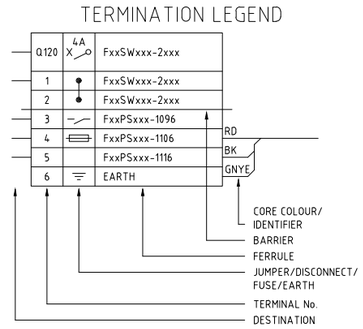

APPROVED FOR CONSTRUCTION

REFERENCES	DWG No	REV	DATE	REVISION
F75-RTU-804 FIM III TSF SWITCHBOARD 6 RTU TERMINATION DIAGRAM SHEET 1	2000-F75-TER-IC-40128			
F75-CP-804 FIM III SEEPAGE PUMP 4 CONTROL PANEL GENERAL ARRANGEMENT SHEET 1	2000-F75-DRG-EL-40135			
F75-CP-804 FIM III SEEPAGE PUMP 4 CONTROL PANEL TERMINATION DIAGRAM	2000-F75-TER-EL-40117			
F75-SW-804 FIM III TSF SWITCHBOARD 6 SCHEMATIC DIAGRAM SHEET 2	2000-F75-SCM-EL-40129			
F75-SW-804 FIM III TSF SWITCHBOARD 6 SCHEMATIC DIAGRAM SHEET 1	2000-F75-SCM-EL-40128			
GENERAL NOTES AND STANDARD DRAWINGS INDEX	2000-F00-STD-EL-10001	O	29.MAY.25	APPROVED FOR CONSTRUCTION

	Signed by	Date
DRAWN	J TORRALBA	03.APR.25
CHECKED	L VAN WEE	03.APR.25
DESIGNED	J TORRALBA	03.APR.25
TECH APP	K VAN NIEKERK	29.APR.25
PROJ APP	T HANDORF	29.MAY.25
CLIENT APP		

NORTHERN STAR RESOURCES LIMITED

DRA PACIFIC (PTY) LIMITED

PROJECT: KCGM
FIM TSF PROJECT

TITLE: FIM III TAILINGS DAM
F75-CP-804 FIM III SEEPAGE PUMP 4 CP
SCHEMATIC DIAGRAM

A1 | SCALE NTS | DRG No. 2000-F75-SCM-EL-40117 | REV O