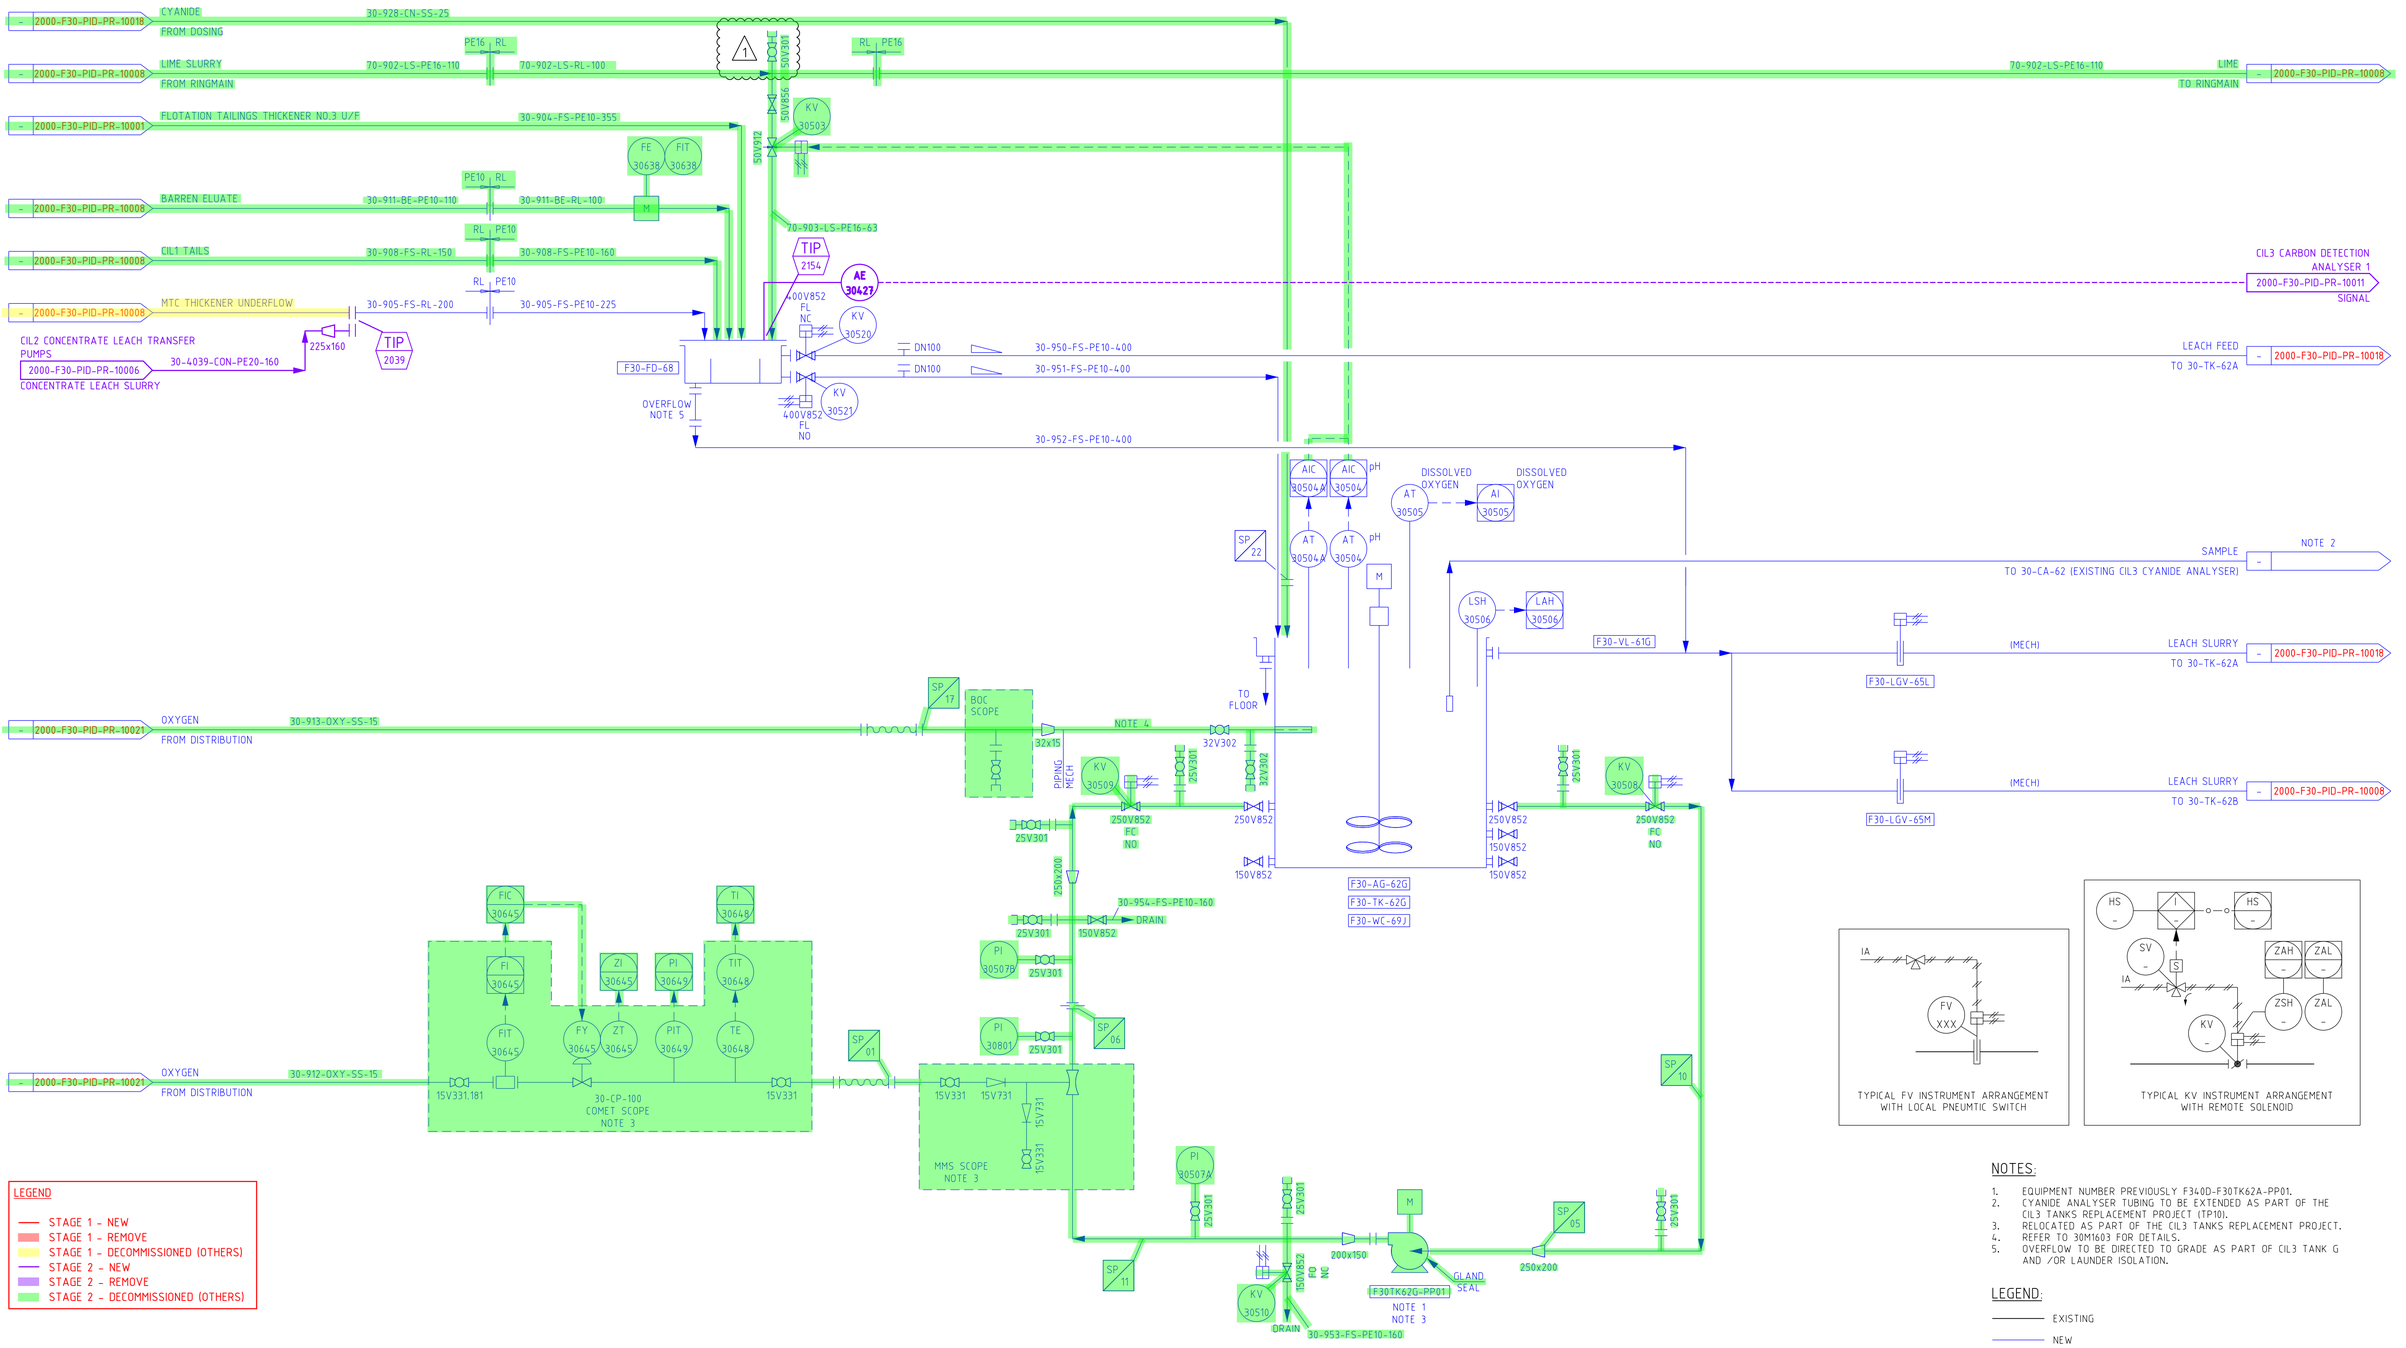

CYANIDE
FROM DOSING
30-928-CN-SS-25
2000-F30-PID-PR-10018
LIME SLURRY
FROM RINGMAIN
70-902-LS-PE16-110
70-902-LS-RL-100
70-902-LS-PE16-110
LIME
TO RINGMAIN
2000-F30-PID-PR-10008
FLOTATION TAILINGS THICKENER NO.3 U/F
30-904-FS-PE10-355
2000-F30-PID-PR-10001
BARREN ELUATE
30-911-BE-PE10-110
30-911-BE-RL-100
CIL1 TAILS
30-908-FS-RL-150
30-908-FS-PE10-160
MTC THICKENER UNDERFLOW
30-905-FS-RL-200
30-905-FS-PE10-225
CIL2 CONCENTRATE LEACH TRANSFER PUMPS
2000-F30-PID-PR-10006
30-4039-CON-PE20-160
CONCENTRATE LEACH SLURRY
225x160
TIP 2039
F30-FD-68
OVERFLOW NOTE 5
70-903-LS-PE16-63
TIP 2154
AE 30427
CIL3 CARBON DETECTION ANALYSER 1
2000-F30-PID-PR-10011
SIGNAL
400V852 FL NC
400V852 FL NO
DN100
30-950-FS-PE10-400
30-951-FS-PE10-400
30-952-FS-PE10-400
LEACH FEED
TO 30-TK-62A
2000-F30-PID-PR-10018
DISSOLVED OXYGEN
pH
SAMPLE
TO 30-CA-62 (EXISTING CIL3 CYANIDE ANALYSER)
NOTE 2
F30-VL-61G
F30-LGV-65L
F30-LGV-65M
(MECH)
LEACH SLURRY
TO 30-TK-62B
2000-F30-PID-PR-10008
OXYGEN
FROM DISTRIBUTION
2000-F30-PID-PR-10021
30-913-OXY-SS-15
30-912-OXY-SS-15
BOC SCOPE
NOTE 4
32x15
32V302
PIPING MECH
250V852 FC NO
250V852
150V852
250x200
30-954-FS-PE10-160
DRAIN
F30-AG-62G
F30-TK-62G
F30-WC-69J
30-CP-100 COMET SCOPE NOTE 3
15V331.181
15V331
15V731
MMS SCOPE NOTE 3
TO FLOOR
F30TK62G-PP01
NOTE 1
NOTE 3
GLAND SEAL
200x150
250x200
30-953-FS-PE10-160
LEGEND
STAGE 1 - NEW
STAGE 1 - REMOVE
STAGE 1 - DECOMMISSIONED (OTHERS)
STAGE 2 - NEW
STAGE 2 - REMOVE
STAGE 2 - DECOMMISSIONED (OTHERS)
TYPICAL FV INSTRUMENT ARRANGEMENT WITH LOCAL PNEUMTIC SWITCH
TYPICAL KV INSTRUMENT ARRANGEMENT WITH REMOTE SOLENOID
NOTES:
1. EQUIPMENT NUMBER PREVIOUSLY F340D-F30TK62A-PP01.
2. CYANIDE ANALYSER TUBING TO BE EXTENDED AS PART OF THE CIL3 TANKS REPLACEMENT PROJECT (TP10).
3. RELOCATED AS PART OF THE CIL3 TANKS REPLACEMENT PROJECT.
4. REFER TO 30M1603 FOR DETAILS.
5. OVERFLOW TO BE DIRECTED TO GRADE AS PART OF CIL3 TANK G AND /OR LAUNDER ISOLATION.
LEGEND:
EXISTING
NEW
DEMOLISH
CIL3 TANK G AGITATOR F30-AG-62G
CIL3 TANK A/G FEED BOX F30-FD-68
CIL3 TANK G INTERTANK ISOLATION GATE A F30-LGV-65L
CIL3 TANK G INTERTANK ISOLATION GATE B F30-LGV-65M
CIL3 OXYGEN INJECTION PUMP F30TK62G-PP01
CIL3 TANK G F30-TK-62G
CIL3 TANK G DISCHARGE LAUNDER F30-VL-61G
CIL3 TANK G OXYGEN INJECTION SPARGE F30-WC-69J
APPROVED FOR CONSTRUCTION