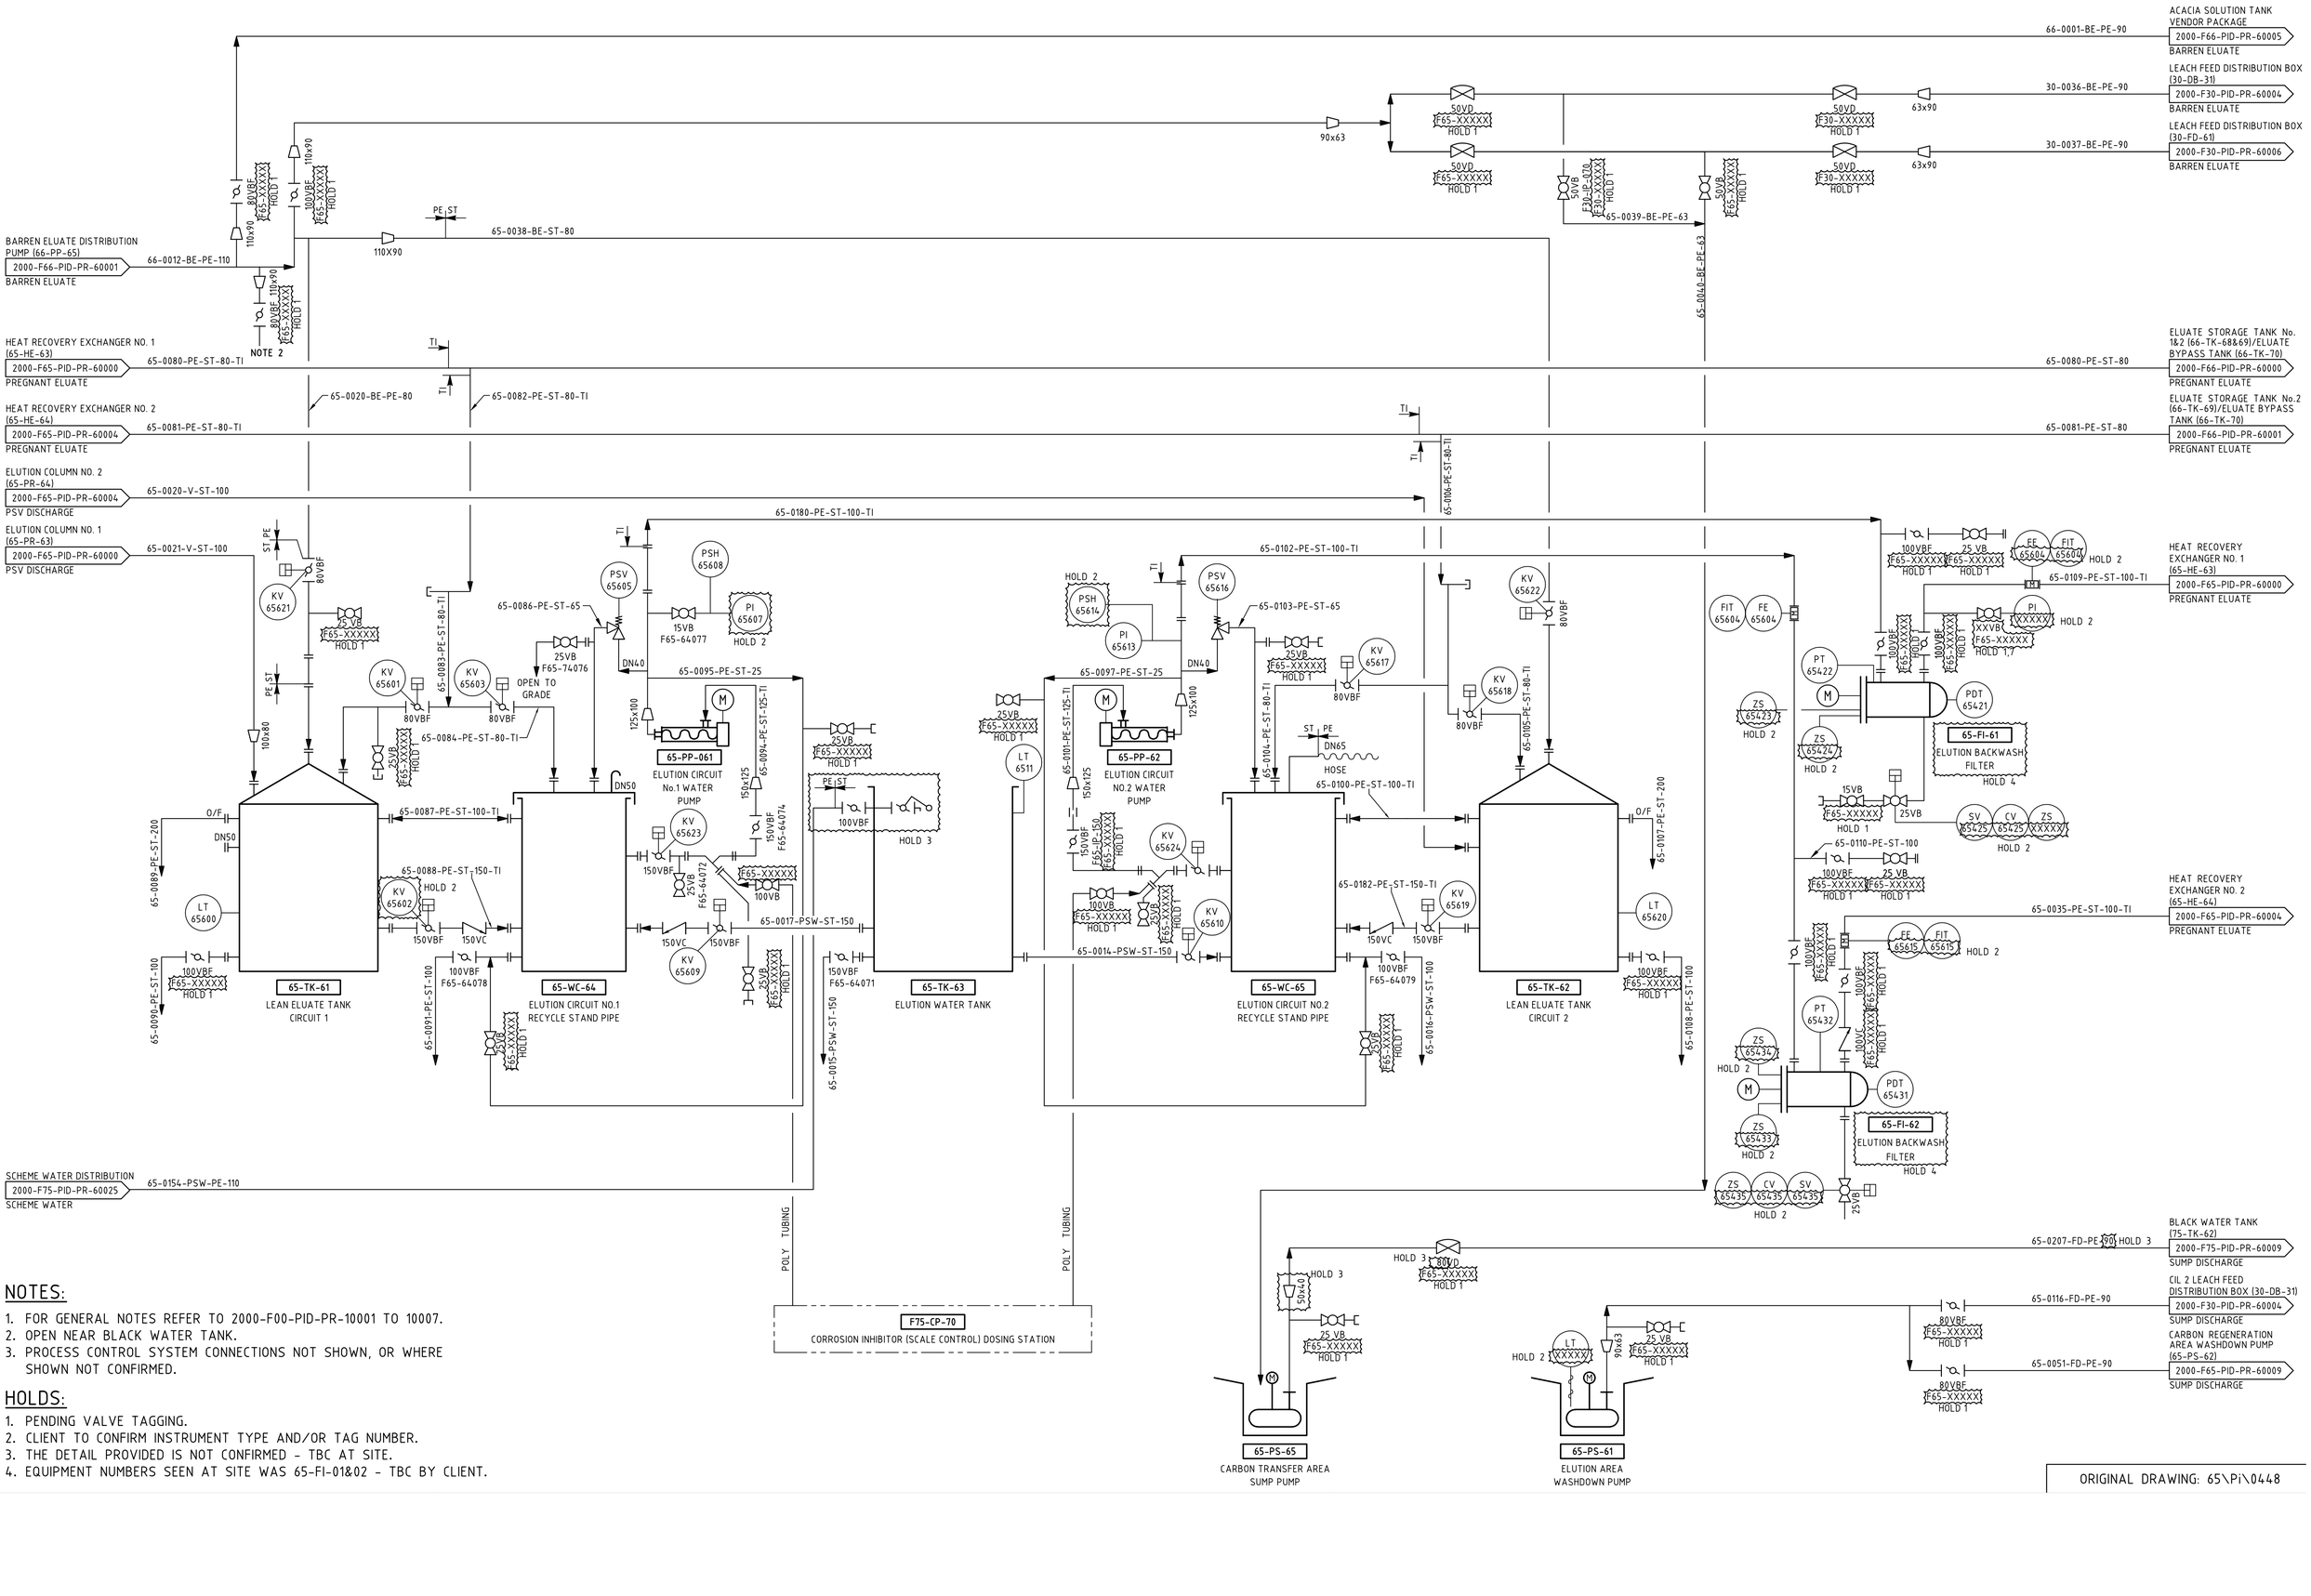

BARREN ELUATE DISTRIBUTION PUMP (66-PP-65)
2000-F66-PID-PR-60001
BARREN ELUATE
66-0012-BE-PE-110
110X90
65-0038-BE-ST-80
NOTE 2
80VBF F65-XXXXX HOLD 1
100VBF F65-XXXXX HOLD 1
90x63
50VD F65-XXXXX HOLD 1
63x90
50VD F30-XXXXX HOLD 1
50VB F30-JP-070 F30-XXXXX HOLD 1
65-0039-BE-PE-63
65-0040-BE-PE-63
66-0001-BE-PE-90
ACACIA SOLUTION TANK VENDOR PACKAGE
2000-F66-PID-PR-60005
BARREN ELUATE
30-0036-BE-PE-90
LEACH FEED DISTRIBUTION BOX (30-DB-31)
2000-F30-PID-PR-60004
BARREN ELUATE
30-0037-BE-PE-90
LEACH FEED DISTRIBUTION BOX (30-FD-61)
2000-F30-PID-PR-60006
BARREN ELUATE
HEAT RECOVERY EXCHANGER NO. 1 (65-HE-63)
2000-F65-PID-PR-60000
PREGNANT ELUATE
65-0080-PE-ST-80-TI
65-0020-BE-PE-80
65-0082-PE-ST-80-TI
65-0080-PE-ST-80
ELUATE STORAGE TANK No. 1&2 (66-TK-68&69)/ELUATE BYPASS TANK (66-TK-70)
2000-F66-PID-PR-60000
PREGNANT ELUATE
HEAT RECOVERY EXCHANGER NO. 2 (65-HE-64)
2000-F65-PID-PR-60004
PREGNANT ELUATE
65-0081-PE-ST-80-TI
65-0106-PE-ST-80-TI
65-0081-PE-ST-80
ELUATE STORAGE TANK No.2 (66-TK-69)/ELUATE BYPASS TANK (66-TK-70)
2000-F66-PID-PR-60001
PREGNANT ELUATE
ELUTION COLUMN NO. 2 (65-PR-64)
2000-F65-PID-PR-60004
PSV DISCHARGE
65-0020-V-ST-100
ELUTION COLUMN NO. 1 (65-PR-63)
2000-F65-PID-PR-60000
PSV DISCHARGE
65-0021-V-ST-100
65-0180-PE-ST-100-TI
65-0102-PE-ST-100-TI
65-0109-PE-ST-100-TI
HEAT RECOVERY EXCHANGER NO. 1 (65-HE-63)
2000-F65-PID-PR-60000
PREGNANT ELUATE
65-0035-PE-ST-100-TI
HEAT RECOVERY EXCHANGER NO. 2 (65-HE-64)
2000-F65-PID-PR-60004
PREGNANT ELUATE
65-0086-PE-ST-65
65-0103-PE-ST-65
65-0083-PE-ST-80-TI
65-0084-PE-ST-80-TI
65-0087-PE-ST-100-TI
65-0088-PE-ST-150-TI
65-0089-PE-ST-200
65-0090-PE-ST-100
65-0091-PE-ST-100
65-0095-PE-ST-25
65-0097-PE-ST-25
65-0094-PE-ST-125-TI
65-0101-PE-ST-125-TI
65-0104-PE-ST-80-TI
65-0105-PE-ST-80-TI
65-0100-PE-ST-100-TI
65-0107-PE-ST-200
65-0110-PE-ST-100
65-0182-PE-ST-150-TI
65-0017-PSW-ST-150
65-0014-PSW-ST-150
65-0015-PSW-ST-150
65-0016-PSW-ST-100
65-0108-PE-ST-100
65-0207-FD-PE-90
65-0116-FD-PE-90
65-0051-FD-PE-90
65-0154-PSW-PE-110
SCHEME WATER DISTRIBUTION
2000-F75-PID-PR-60025
SCHEME WATER
65-TK-61
LEAN ELUATE TANK CIRCUIT 1
65-WC-64
ELUTION CIRCUIT NO.1 RECYCLE STAND PIPE
65-TK-63
ELUTION WATER TANK
65-WC-65
ELUTION CIRCUIT NO.2 RECYCLE STAND PIPE
65-TK-62
LEAN ELUATE TANK CIRCUIT 2
65-PP-061
ELUTION CIRCUIT No.1 WATER PUMP
65-PP-62
ELUTION CIRCUIT NO.2 WATER PUMP
65-FI-61
ELUTION BACKWASH FILTER
65-FI-62
ELUTION BACKWASH FILTER
65-PS-65
CARBON TRANSFER AREA SUMP PUMP
65-PS-61
ELUTION AREA WASHDOWN PUMP
F75-CP-70
CORROSION INHIBITOR (SCALE CONTROL) DOSING STATION
POLY TUBING
POLY TUBING
BLACK WATER TANK (75-TK-62)
2000-F75-PID-PR-60009
SUMP DISCHARGE
CIL 2 LEACH FEED DISTRIBUTION BOX (30-DB-31)
2000-F30-PID-PR-60004
SUMP DISCHARGE
CARBON REGENERATION AREA WASHDOWN PUMP (65-PS-62)
2000-F65-PID-PR-60009
SUMP DISCHARGE
KV 65601
KV 65603
KV 65621
KV 65623
KV 65602
KV 65609
KV 65624
KV 65610
KV 65617
KV 65618
KV 65622
KV 65619
LT 6511
LT 65600
LT 65620
PSV 65605
PSH 65608
PI 65607
PSV 65616
PSH 65614
PI 65613
FE 65604
FIT 65604
PT 65422
PDT 65421
PT 65432
PDT 65431
FE 65615
FIT 65615
SV 65425
CV 65425
ZS 65425
ZS 65436
ZS 65433
ZS 65435
CV 65435
SV 65435
HOLD 1
HOLD 2
HOLD 3
HOLD 4
NOTES:
1. FOR GENERAL NOTES REFER TO 2000-F00-PID-PR-10001 TO 10007.
2. OPEN NEAR BLACK WATER TANK.
3. PROCESS CONTROL SYSTEM CONNECTIONS NOT SHOWN, OR WHERE SHOWN NOT CONFIRMED.
HOLDS:
1. PENDING VALVE TAGGING.
2. CLIENT TO CONFIRM INSTRUMENT TYPE AND/OR TAG NUMBER.
3. THE DETAIL PROVIDED IS NOT CONFIRMED - TBC AT SITE.
4. EQUIPMENT NUMBERS SEEN AT SITE WAS 65-FI-01&02 - TBC BY CLIENT.
ORIGINAL DRAWING: 65\Pi\0448