
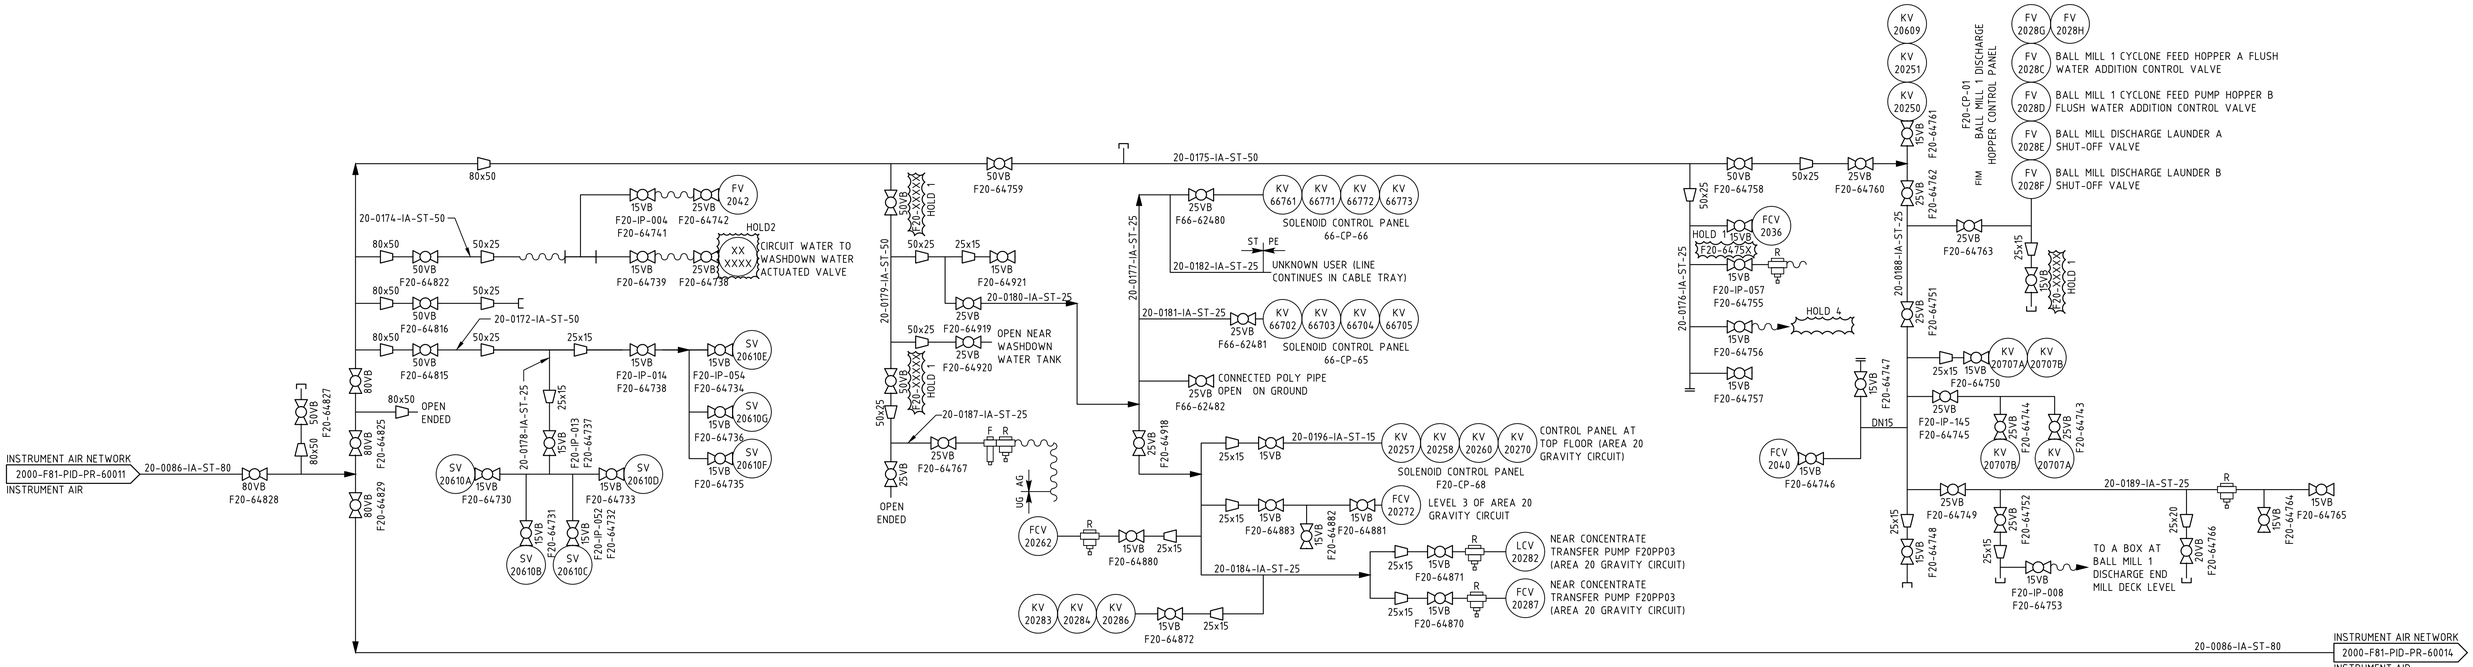


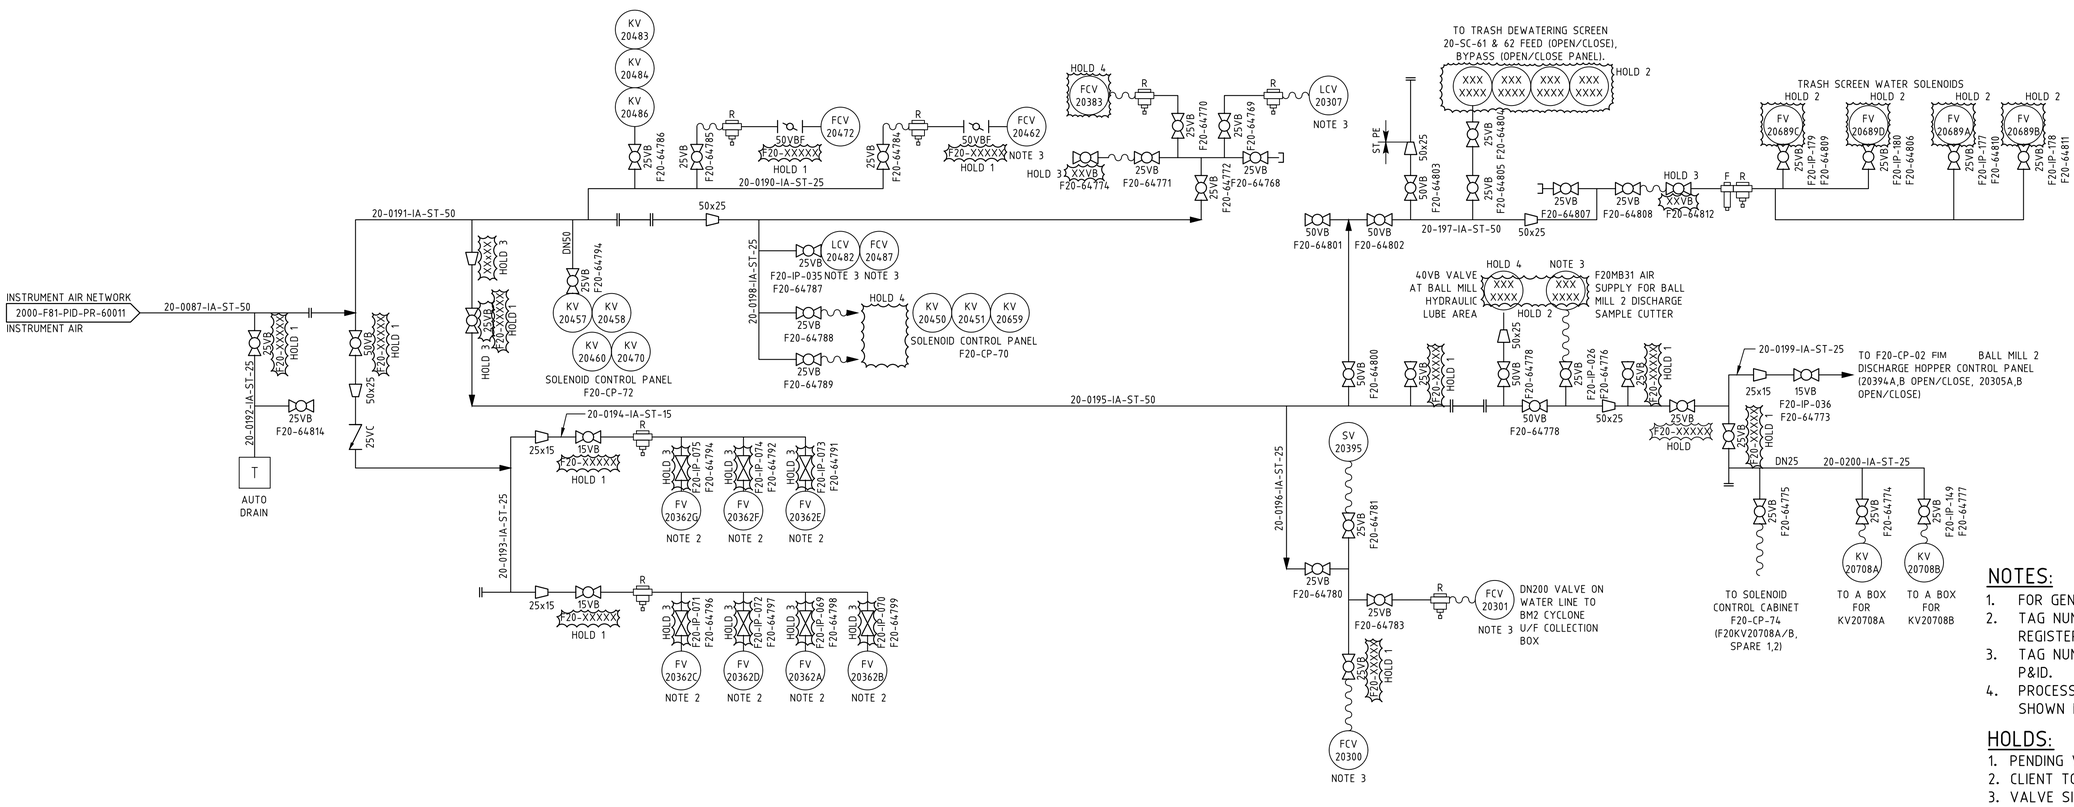

NOTES:

1. FOR GENERAL NOTES REFER TO 2000-F00-PID-PR-10001 TO 10007.
2. TAG NUMBER NOT SEEN IN FIELD AND IS AS PER ISOLATION POINT REGISTER.
3. TAG NUMBER NOT SEEN IN FIELD AND IS AS PER ORIGINAL PLANT P&ID.
4. PROCESS CONTROL SYSTEM CONNECTIONS NOT SHOWN, OR WHERE SHOWN NOT CONFIRMED.

HOLDS:

1. PENDING VALVE TAG ON SITE.
2. CLIENT TO CONFIRM INSTRUMENT TYPE AND/OR TAG NUMBER.
3. VALVE SIZE AND/OR TYPE TBC AT SITE.
4. TUBING RUNS IN CABLE TRAY. UNIDENTIFIED USER. TBA/TBC BY CLIENT.