
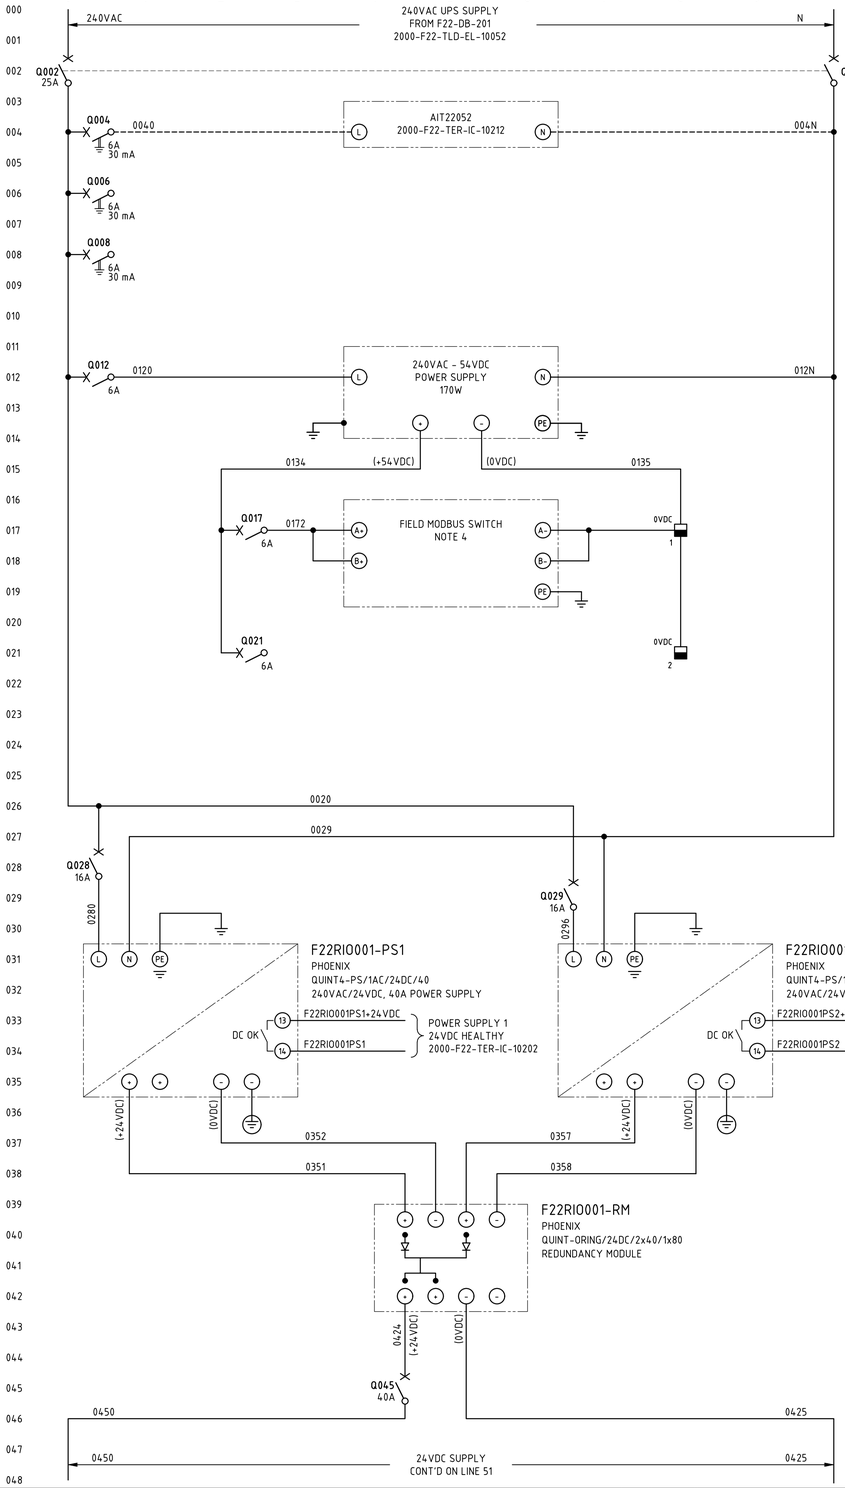


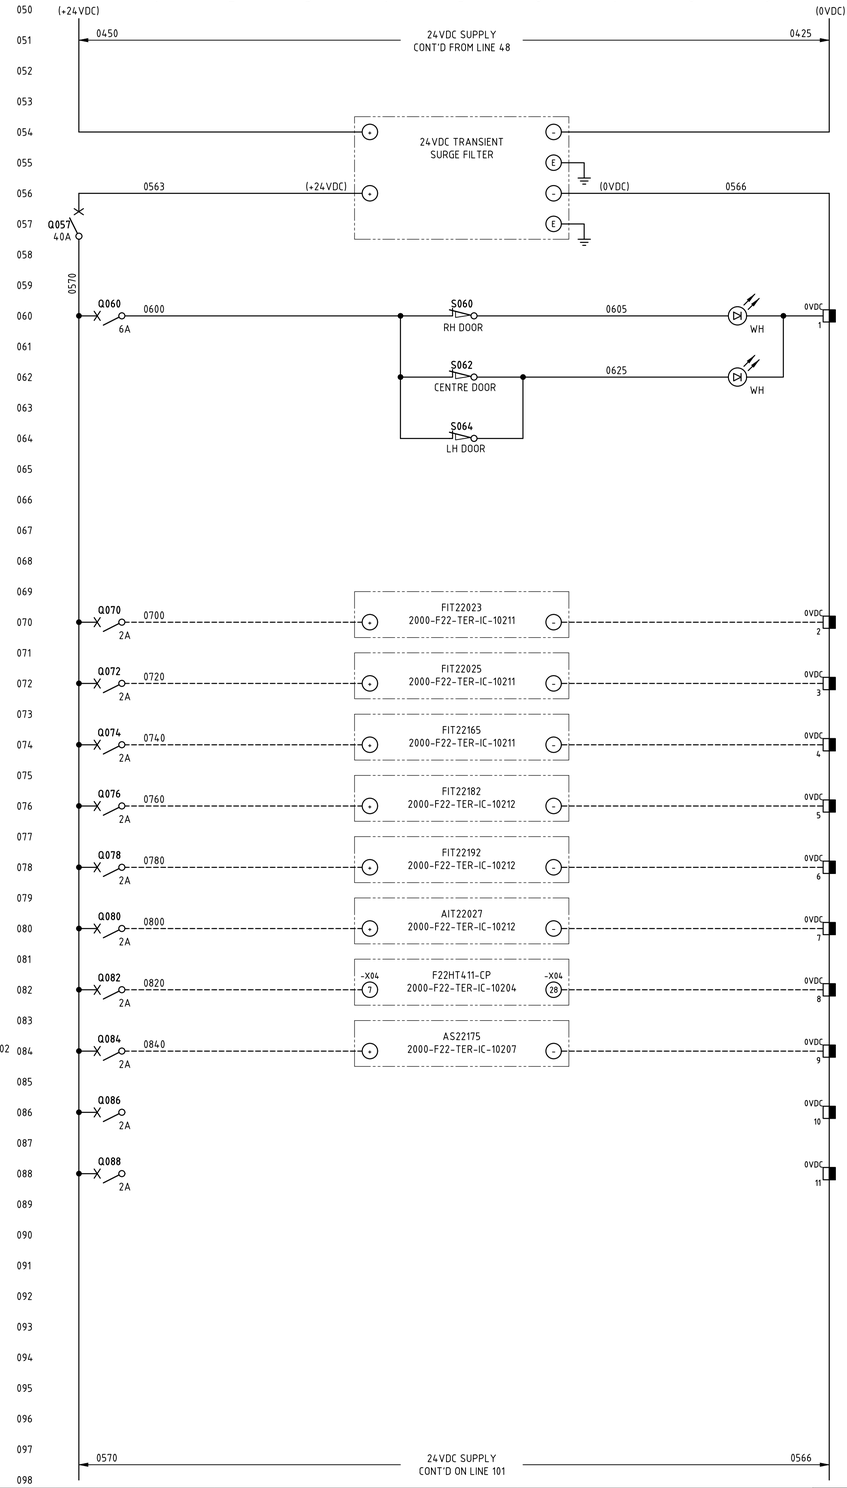

AIT22052
F22-KN-411 CIL4 CARBON REGENERATION KILN AREA MERCURY ANALYSER INDICATING TRANSMITTER 240VAC POWER SUPPLY

SPARE
240VAC POWER SUPPLY

SPARE
240VAC POWER SUPPLY

F22RIO0001-PS3
CISCO
PWR-IE170W-PC-AC
POWER SUPPLY

F22-ETH-041
CISCO
IE-3300-8T2S-E
FIELD MODBUS SWITCH

SPARE
54VDC POWER SUPPLY

F22RIO0001-SD
TRANSTECH
TLP-SF40-1P-24VDC
SURGE FILTER

PANEL LIGHTS

FIT22023
F22-PR-411 CIL4 ELUTION & ACID WASH COLUMN SCHEME WATER FLOW INDICATING TRANSMITTER 24VDC POWER SUPPLY

FIT22025
F22-PR-411 CIL4 ELUTION & ACID WASH COLUMN HYDROCHLORIC ACID FLOW INDICATING TRANSMITTER 24VDC POWER SUPPLY

FIT22165
CIL4 ELUTION WATER PUMPS DISCHARGE FLOW INDICATING TRANSMITTER 24VDC POWER SUPPLY

FIT22182
ELUTION CYANIDE FEED FLOW INDICATING TRANSMITTER 24VDC POWER SUPPLY

FIT22192
ELUTION CAUSTIC FEED FLOW INDICATING TRANSMITTER 24VDC POWER SUPPLY

AIT22027
F22-PR-411 CIL4 ELUTION & ACID WASH COLUMN AREA HCN ANALYSER INDICATING TRANSMITTER 24VDC POWER SUPPLY

F22HT411-CP
ELUTION HEATER CONTROL PANEL
24VDC POWER SUPPLY

AS22175
CIL4 ELUTION AREA OIL TRAP SUMP HYDROCARBON LEAK DETECTOR
24VDC POWER SUPPLY

SPARE
24VDC POWER SUPPLY

SPARE
24VDC POWER SUPPLY

NOTES

1. TERMINALS ON TERMINAL STRIPS ABOVE 50VAC SHALL HAVE A SEPARATE PERSPEX SHROUD AND SHALL BE LABELLED "DANGER xxxVAC".
2. WIRE NUMBER FERRULES ON TERMINAL STRIP SHALL BE PREFIXED WITH EQUIPMENT NUMBER e.g. F22RIO001-XXXX.
3. EACH WIRE SHALL BE IDENTIFIED AT BOTH ENDS WITH FERRULES.
4. FOR NETWORK CONNECTION & BUS CABLING DETAILS REFER TO RIO PANEL COMMUNICATIONS TERMINATION DIAGRAMS.
5. INSTRUMENT EARTH BAR TO BE BONDED TO MAIN EARTH BAR WITH SOLID COPPER LINK.

LEGEND

- FIELD TERMINAL
- DCS OR I/O TERMINAL
- 0VDC TERMINAL FOR 24VDC
- 0VDC TERMINAL FOR 54VDC
- DEVICE TERMINAL
- INDICATION LAMP (cc = COLOUR)
- EARTH BAR
- INSTRUMENT EARTH BAR

DRG No.	REFERENCES
2000-F22-TLD-EL-10052	F22-DB-201 LV SWITCHROOM 240V UPS DB THREE LINE DIAGRAM
2000-F22-DRG-IC-10201	F22-RIO-001 FIELD N-IO PANEL GENERAL ARRANGEMENT
2000-F22-SCM-IC-10202	F22-RIO-001 FIELD N-IO PANEL SCHEMATIC DIAGRAM SHEET 2
2000-F22-TER-IC-10200	F22-RIO-001 FIELD N-IO PANEL COMMUNICATIONS TERMINATION DIAGRAM SHEET 1 (TO SHEET 2 - 10201)
2000-F22-TER-IC-10202	F22-RIO-001 FIELD N-IO PANEL TERMINATION DIAGRAM SHEET 1 (TO SHEET 12 - 10213)
2000-F00-STD-EL-10001	GENERAL NOTES AND STANDARD DRAWINGS INDEX

REV	DATE	DESCRIPTION	DRAW	CHECK	DESIGN	TECH APP	PROJ APP
0	17APR25	APPROVED FOR CONSTRUCTION	[redacted]				

NORTHERN STAR RESOURCES LIMITED

PRIMERO
primero.com.au | DESIGN | CONSTRUCT | OPERATE

PRIMERO PROJECT NUMBER: 23517

INFORMATION AND REPRESENTATIONS ON THIS DRAWING ARE THE INTELLECTUAL PROPERTY OF PRIMERO UNLESS SPECIFICALLY IDENTIFIED OTHERWISE. ALL RIGHTS INCLUDING USE RESERVED

PROJECT: NORTHERN STAR RESOURCES LTD
KCGM GROWTH PROJECT

TITLE: CIL4 - CARBON TREATMENT & ELUTION
F22-RIO-001 ELUTION FIELD N-IO PANEL
SCHEMATIC DIAGRAM SHEET 1

SHEET	SCALE	DRG No.	REVISION
A1	NONE	2000-F22-SCM-IC-10201	0

O:\CAD PROJECTS\235 NORTHERN STAR RESOURCES LTD\23517 KCGM GROWTH PROJECT\03 DELIVERABLES\IC\F22 - CIL4 CARBON TREAMENT & ELUTION\2000-F22-SCM-IC-10201.DWG 17APR25 6:40AM SANDRA CULL