


Docusign Envelope ID: 8EFFCCD0-5FBC-4D60-9EC2-D85F36275E8D



F175UPS701-ISL
240VAC UPS
MAINTENANCE BYPASS SWITCH
10kW

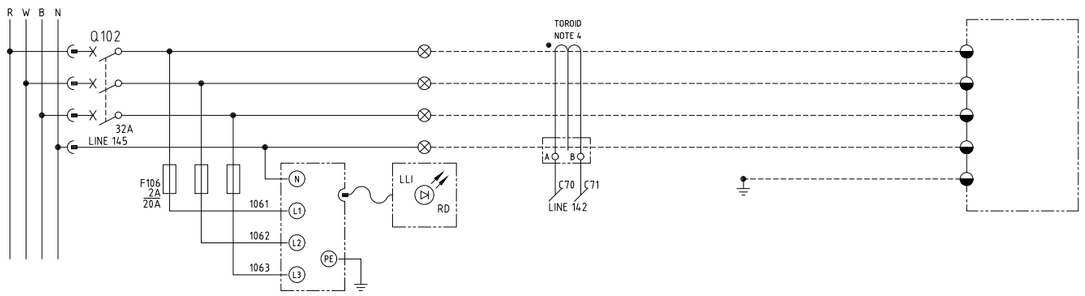



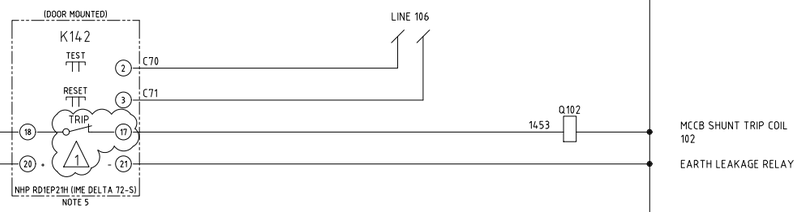

CABLE ZONE
24VDC TERMINALS
NOTE C.1

24VDC LOOPED POWER
NEXT MODULE
PREV MODULE

Q120	4A	F175SW701-2xxx
1		F175SW701-2xxx
2		F175SW701-2xxx
3		
4		
5		
6		
7		
8	⏚	EARTH

NOTE 2

NOTES

1. TERMINALS ON TERMINAL STRIPS ABOVE 50VAC SHALL HAVE A SEPARATE PERSPEX SHROUD AND SHALL BE LABELLED "DANGER xxxVAC".
2. WIRE NUMBER FERRULES ON TERMINAL STRIP SHALL BE PREFIXED WITH EQUIPMENT NUMBER e.g. F175UPS701-ISL.
3. EACH WIRE SHALL BE IDENTIFIED AT BOTH ENDS WITH FERRULES.
4. NHP TDG×2 TOROID TO SUIT CABLE DIAMETER (TOROID MIN. 30mA).
5. EARTH LEAKAGE RELAY USER INTERFACE TO BE MOUNTED ON MCC MODULE DOOR.
   RELAY SETTINGS SET TO:
   IΔn ="1A".
   DELAY = "100ms".
   RANGES = "x1".
   FAILSAFE MODE = "Ne".
   RESET = "MAN".
6. REFER TO CABLE SCHEDULE 2000-F175-LST-EL-40003.


LEGEND

- 00/01/00 — DCS DIGITAL INPUT
- 00/02/00 — DCS DIGITAL OUTPUT
- MCC TERMINAL
- VSD TERMINAL
- FIELD TERMINAL
- DCS OR I/O TERMINAL
- MARSHALLING TERMINAL
- DEVICE TERMINAL
- INDICATION LAMP (cc = cc) — cc = COLOUR

CONSTRUCTION NOTES

C.1 TO BE DETERMINED BY MCC VENDOR

TERMINATION LEGEND

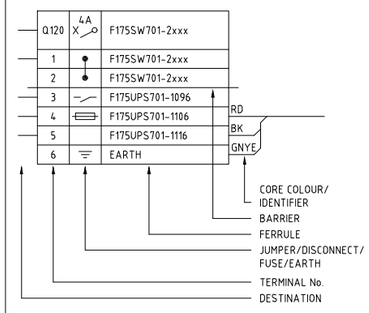

APPROVED FOR CONSTRUCTION

REFERENCES	DWG No	REV	DATE	REVISION	DRN	CHK	TECH APP	PROJ APP
F175-DB-702 SWITCHROOM 240VAC UPS DB THREE-LINE DIAGRAM	2000-F175-TLD-EL-40002							
F175-SW-701 LV MOTOR CONTROL CENTRE SINGLE LINE DIAGRAM	2000-F175-SLD-EL-40001	1	13.JUN.25	RE-APPROVED FOR CONSTRUCTION	TG Initial	KVN Initial	KVN Initial	TH DS
GENERAL NOTES AND STANDARD DRAWINGS INDEX	2000-F00-STD-EL-10001	0	21.MAY.25	APPROVED FOR CONSTRUCTION	TG	KVN	KVN	TH

NORTHERN STAR RESOURCES LIMITED

DRA PACIFIC (PTY) LIMITED

DRAWN	T. GROOM	13.MAR.2025
CHECKED		10.APR.2025
DESIGNED		10.APR.2025
TECH APP		10.APR.2025
PROJ APP	T. GROOM	21.MAY.2025
CLIENT APP	E820160BA17B4A9...	

PROJECT: KCGM
FIM TSF PROJECT

TITLE: SOUTHLAKES BOOSTER STATION
F175UPS701-ISL 240VAC UPS MAINT. BYPASS SWITCH
CONTROL SCHEMATIC DIAGRAM

A1 | SCALE NTS | DRG No. 2000-F175-SCM-EL-40014 | REV 1