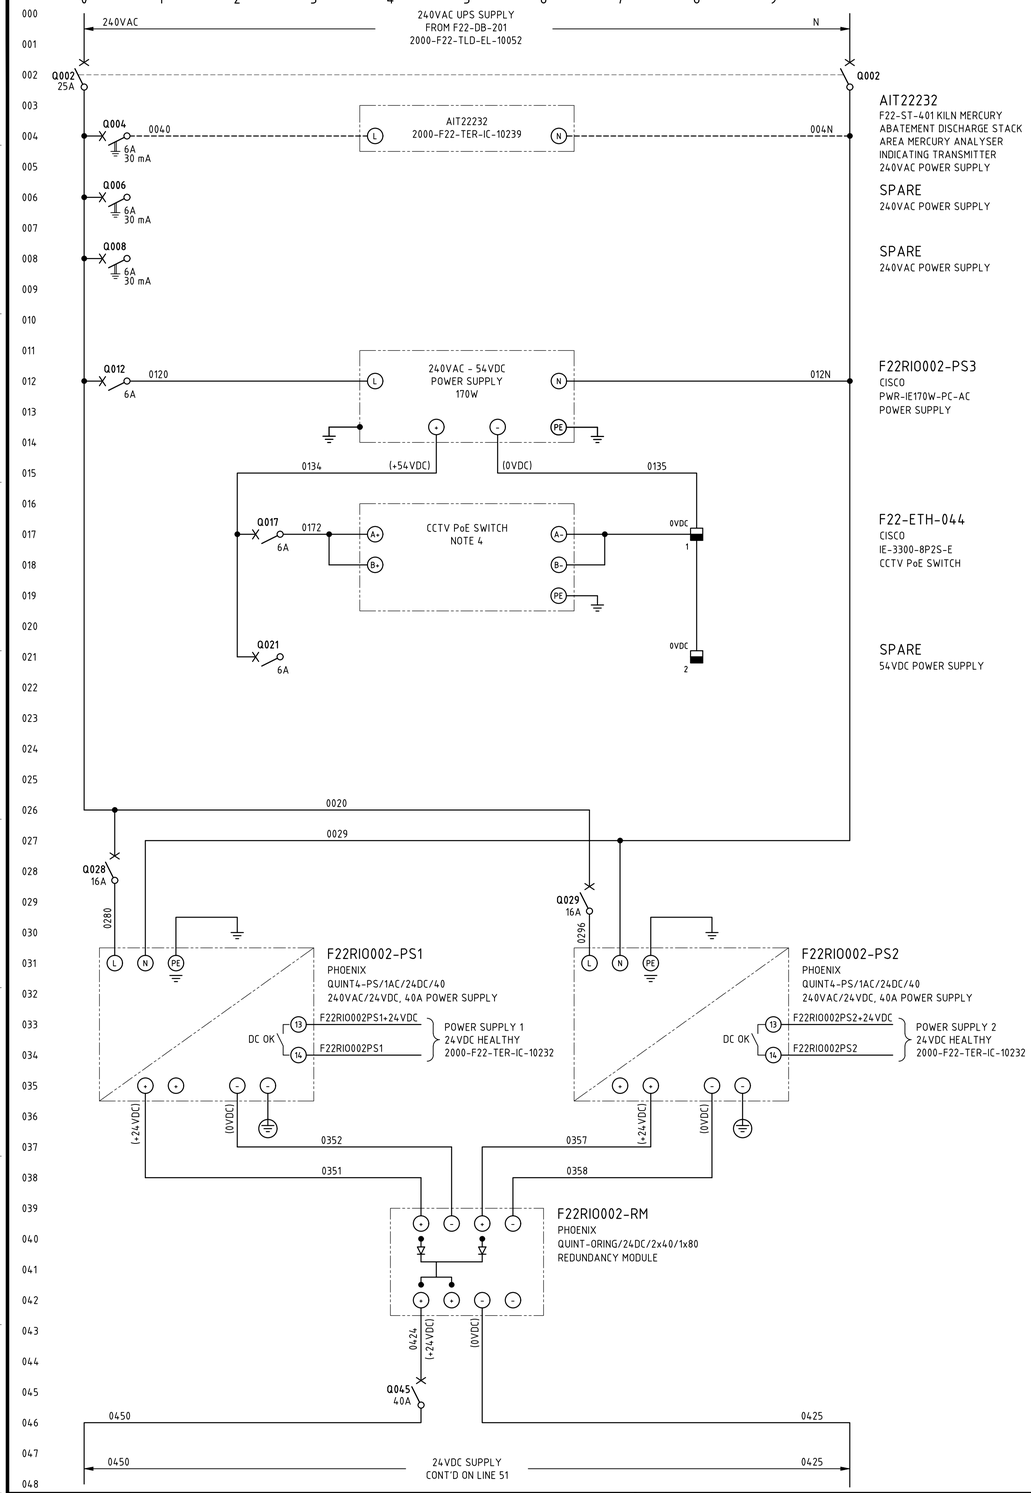


AIT22232
F22-ST-401 KILN MERCURY ABATEMENT DISCHARGE STACK AREA MERCURY ANALYSER INDICATING TRANSMITTER 240VAC POWER SUPPLY


SPARE
240VAC POWER SUPPLY

SPARE
240VAC POWER SUPPLY

F22RIO002-PS3
CISCO
PWR-IE170W-PC-AC
POWER SUPPLY

F22-ETH-044
CISCO
IE-3300-8P2S-E
CCTV PoE SWITCH

SPARE
54VDC POWER SUPPLY

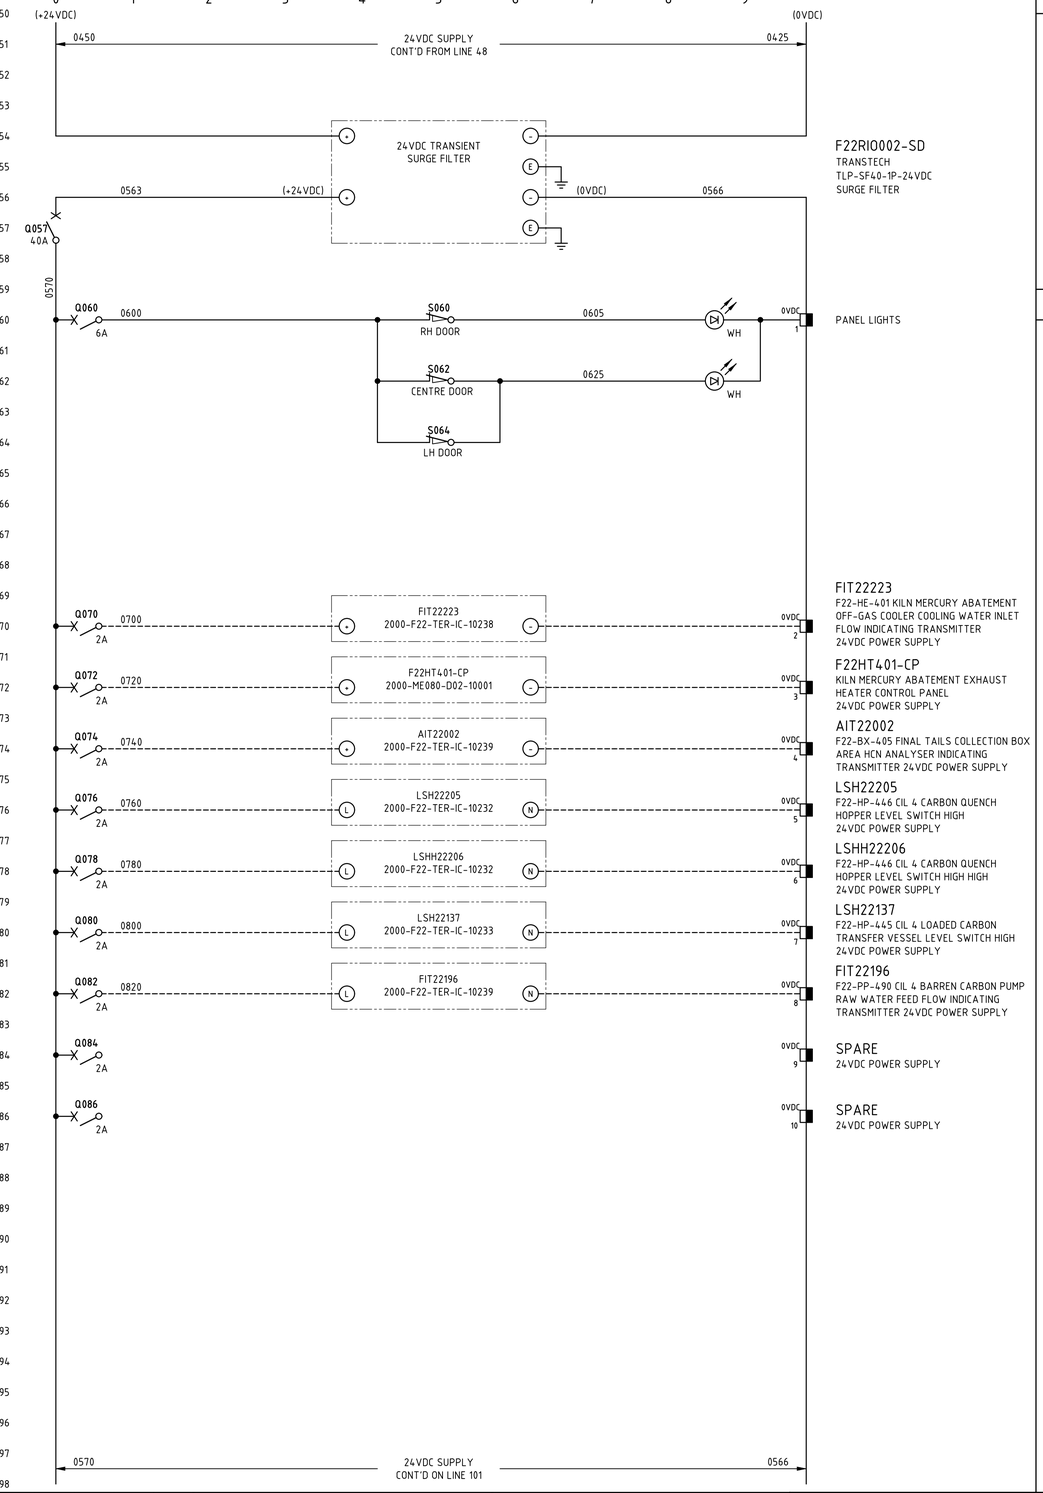

F22RIO002-SD
TRANSTECH
TLP-SF40-1P-24VDC
SURGE FILTER

PANEL LIGHTS

FIT22223
F22-HE-401 KILN MERCURY ABATEMENT OFF-GAS COOLER COOLING WATER INLET FLOW INDICATING TRANSMITTER 24VDC POWER SUPPLY

F22HT401-CP
KILN MERCURY ABATEMENT EXHAUST HEATER CONTROL PANEL
24VDC POWER SUPPLY

AIT22002
F22-BX-405 FINAL TAILS COLLECTION BOX AREA HCN ANALYSER INDICATING TRANSMITTER 24VDC POWER SUPPLY

LSH22205
F22-HP-446 CIL 4 CARBON QUENCH HOPPER LEVEL SWITCH HIGH
24VDC POWER SUPPLY

LSHH22206
F22-HP-446 CIL 4 CARBON QUENCH HOPPER LEVEL SWITCH HIGH HIGH
24VDC POWER SUPPLY

LSH22137
F22-HP-445 CIL 4 LOADED CARBON TRANSFER VESSEL LEVEL SWITCH HIGH
24VDC POWER SUPPLY

FIT22196
F22-PP-490 CIL 4 BARREN CARBON PUMP RAW WATER FEED FLOW INDICATING TRANSMITTER 24VDC POWER SUPPLY

SPARE
24VDC POWER SUPPLY

SPARE
24VDC POWER SUPPLY

NOTES

1. TERMINALS ON TERMINAL STRIPS ABOVE 50VAC SHALL HAVE A SEPARATE PERSPEX SHROUD AND SHALL BE LABELLED "DANGER xxxVAC".
2. WIRE NUMBER FERRULES ON TERMINAL STRIP SHALL BE PREFIXED WITH EQUIPMENT NUMBER e.g. F22RIO002-XXXX.
3. EACH WIRE SHALL BE IDENTIFIED AT BOTH ENDS WITH FERRULES.
4. FOR NETWORK CONNECTION & BUS CABLING DETAILS REFER TO RIO PANEL COMMUNICATIONS TERMINATION DIAGRAMS.
5. INSTRUMENT EARTH BAR TO BE BONDED TO MAIN EARTH BAR WITH SOLID COPPER LINK.

LEGEND

- FIELD TERMINAL
- DCS OR I/O TERMINAL
- 0VDC TERMINAL FOR 24VDC
- 0VDC TERMINAL FOR 54VDC
- DEVICE TERMINAL
- INDICATION LAMP (cc = COLOUR)
- EARTH BAR
- INSTRUMENT EARTH BAR

DRG No.	REFERENCES
2000-F22-TLD-EL-10052	F22-DB-201 LV SWITCHROOM 240V UPS DB THREE LINE DIAGRAM
2000-F22-DRG-IC-10231	F22-RIO-002 FIELD N-IO PANEL GENERAL ARRANGEMENT
2000-F22-SCM-IC-10232	F22-RIO-002 FIELD N-IO PANEL SCHEMATIC DIAGRAM SHEET 2
2000-F22-TER-IC-10230	F22-RIO-002 FIELD N-IO PANEL COMMUNICATIONS TERMINATION DIAGRAM SHEET 1 (TO SHEET 2 - 10231)
2000-F22-TER-IC-10232	F22-RIO-002 FIELD N-IO PANEL TERMINATION DIAGRAM SHEET 1 (TO SHEET 12 - 10243)
2000-F00-STD-EL-10001	GENERAL NOTES AND STANDARD DRAWINGS INDEX

REV	DATE	DESCRIPTION
0	17APR25	APPROVED FOR CONSTRUCTION

[redacted]

NORTHERN STAR RESOURCES LIMITED

PRIMERO
primero.com.au | DESIGN | CONSTRUCT | OPERATE

PRIMERO PROJECT NUMBER: 23517

INFORMATION AND REPRESENTATIONS ON THIS DRAWING ARE THE INTELLECTUAL PROPERTY OF PRIMERO UNLESS SPECIFICALLY IDENTIFIED OTHERWISE. ALL RIGHTS INCLUDING USE RESERVED

PROJECT: NORTHERN STAR RESOURCES LTD
KCGM GROWTH PROJECT

TITLE: CIL 4 - CARBON TREATMENT & ELUTION
F22-RIO-002 ELUTION FIELD N-IO PANEL
SCHEMATIC DIAGRAM SHEET 1

SHEET	SCALE	DRG No.	REVISION
A1	NONE	2000-F22-SCM-IC-10231	0

O:\CAD PROJECTS\235 NORTHERN STAR RESOURCES LTD\23517 KCGM GROWTH PROJECT\03 DELIVERABLES\IC\F22 - CIL4 CARBON TREAMENT & ELUTION\2000-F22-SCM-IC-10231.DWG 17APR25 7:31AM SANDRA.CULL