

Docusign Envelope ID: 8E76B63A-48AC-42D5-A478-EF0F2193FA0A

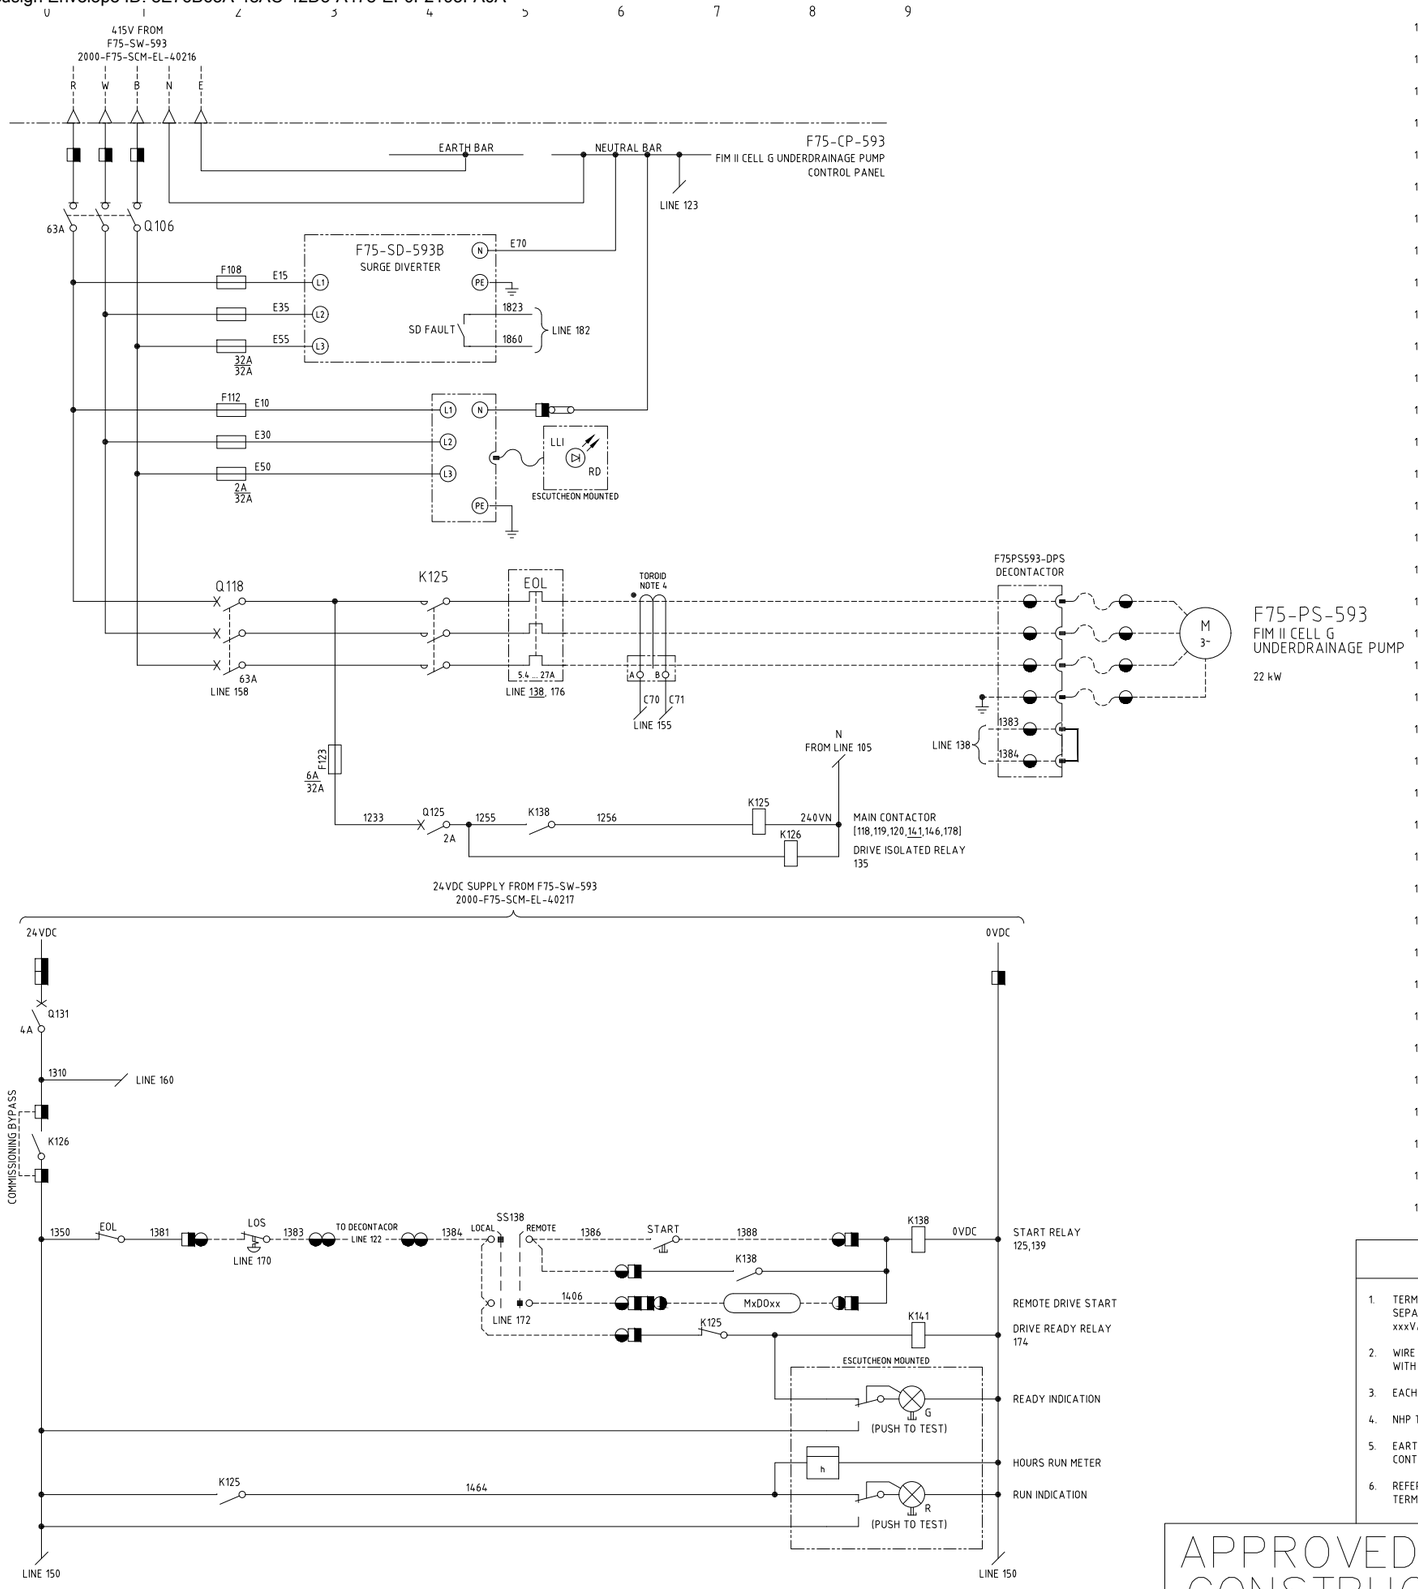

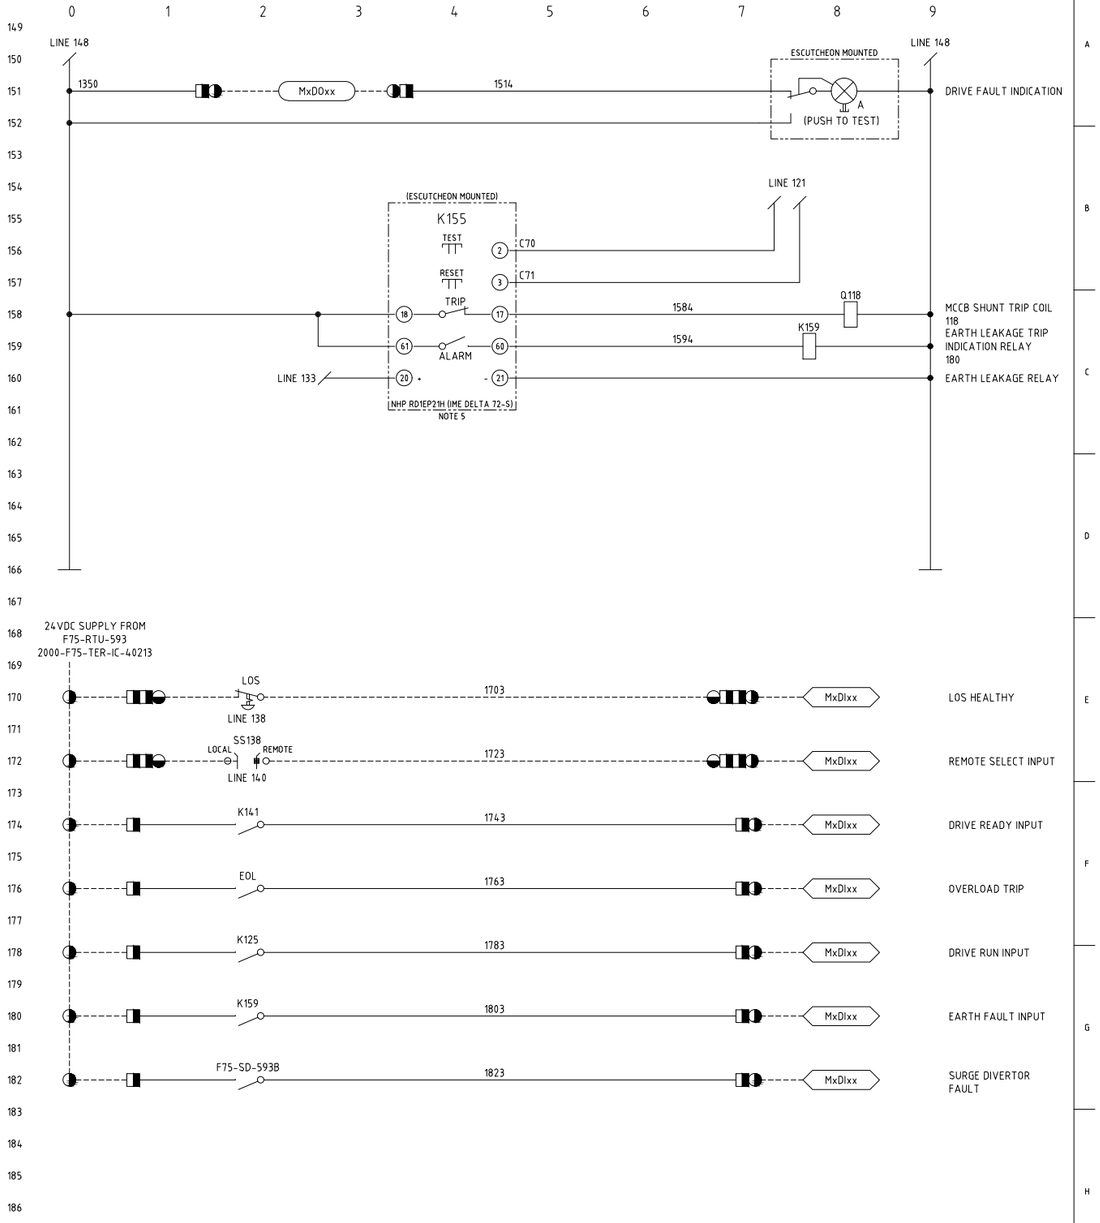


NOTES

1. TERMINALS ON TERMINAL STRIPS ABOVE 50VAC SHALL HAVE A SEPARATE PERSPEX SHROUD AND SHALL BE LABELLED "DANGER xxxVAC".
2. WIRE NUMBER FERRULES ON TERMINAL STRIP SHALL BE PREFIXED WITH EQUIPMENT NUMBER e.g. FxxPSxxx-1200.
3. EACH WIRE SHALL BE IDENTIFIED AT BOTH ENDS WITH FERRULES.
4. NHP TDGx2 TOROID TO SUIT CABLE DIAMETER.
5. EARTH LEAKAGE RELAY USER INTERFACE TO BE MOUNTED ON CONTROL PANEL ESCUTCHEON.
6. REFER 2000-F75-LST-IC-40004 FOR RTU I/O ADDRESSES AND TERMINATION DETAILS.

LEGEND

- MxDIxx — RTU DIGITAL INPUT
- MxDOxx — RTU DIGITAL OUTPUT
- SWITCHBOARD TERMINAL
- VSD TERMINAL
- FIELD TERMINAL
- RTU TERMINAL
- CONTROL PANEL TERMINAL
- DEVICE TERMINAL
- INDICATION LAMP (cc = COLOUR)

TERMINATION LEGEND

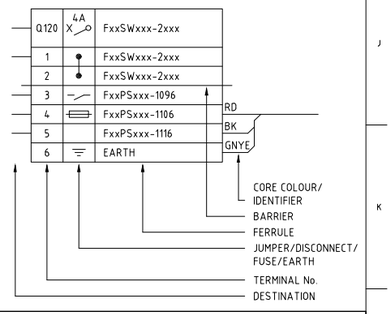

APPROVED FOR CONSTRUCTION

REFERENCES	DWG No	REV	DATE	REVISION
F75-RTU-593 FIM II TSF CELL G SWITCHBOARD 2 RTU TERMINATION DIAGRAM SHEET 1	2000-F75-TER-IC-40213			
F75-CP-593 FIM II CELL G UNDERDRAINAGE PUMP CONTROL PANEL GENERAL ARRANGEMENT SHEET 1	2000-F75-DRG-EL-40219			
F75-CP-593 FIM II CELL G UNDERDRAINAGE PUMP CONTROL PANEL TERMINATION DIAGRAM	2000-F75-TER-EL-40213			
F75-SW-593 FIM II TSF CELL G SWITCHBOARD 2 SCHEMATIC DIAGRAM SHEET 2	2000-F75-SCM-EL-40217			
F75-SW-593 FIM II TSF CELL G SWITCHBOARD 2 SCHEMATIC DIAGRAM SHEET 1	2000-F75-SCM-EL-40216			
GENERAL NOTES AND STANDARD DRAWINGS INDEX	2000-F00-STD-EL-10001	O	29.MAY.25	APPROVED FOR CONSTRUCTION

	Initial	Initial	Initial	DS
DRN	JT	KVN	KVN	TH
CHK		CVN	TECH APP	PROJ APP

NORTHERN STAR RESOURCES LIMITED

DRA PACIFIC (PTY) LIMITED

DRAWN	J.TORRALBA	03.APR.2025
CHECKED	C.YANG (WEI)	03.APR.2025
DESIGNED	J.TORRALBA	03.APR.2025
TECH APP	IK.VAN.NAMEN	29.APR.2025
PROJ APP	[redacted]	29.MAY.2025
CLIENT APP		

PROJECT: KCGM
FIM TSF PROJECT

TITLE: FIM II TAILINGS DAM
F75-CP-593 FIM II CELL G UNDERDRAINAGE PUMP CP SCHEMATIC DIAGRAM

A1	SCALE NTS	DRG No. 2000-F75-SCM-EL-40213	REV O