


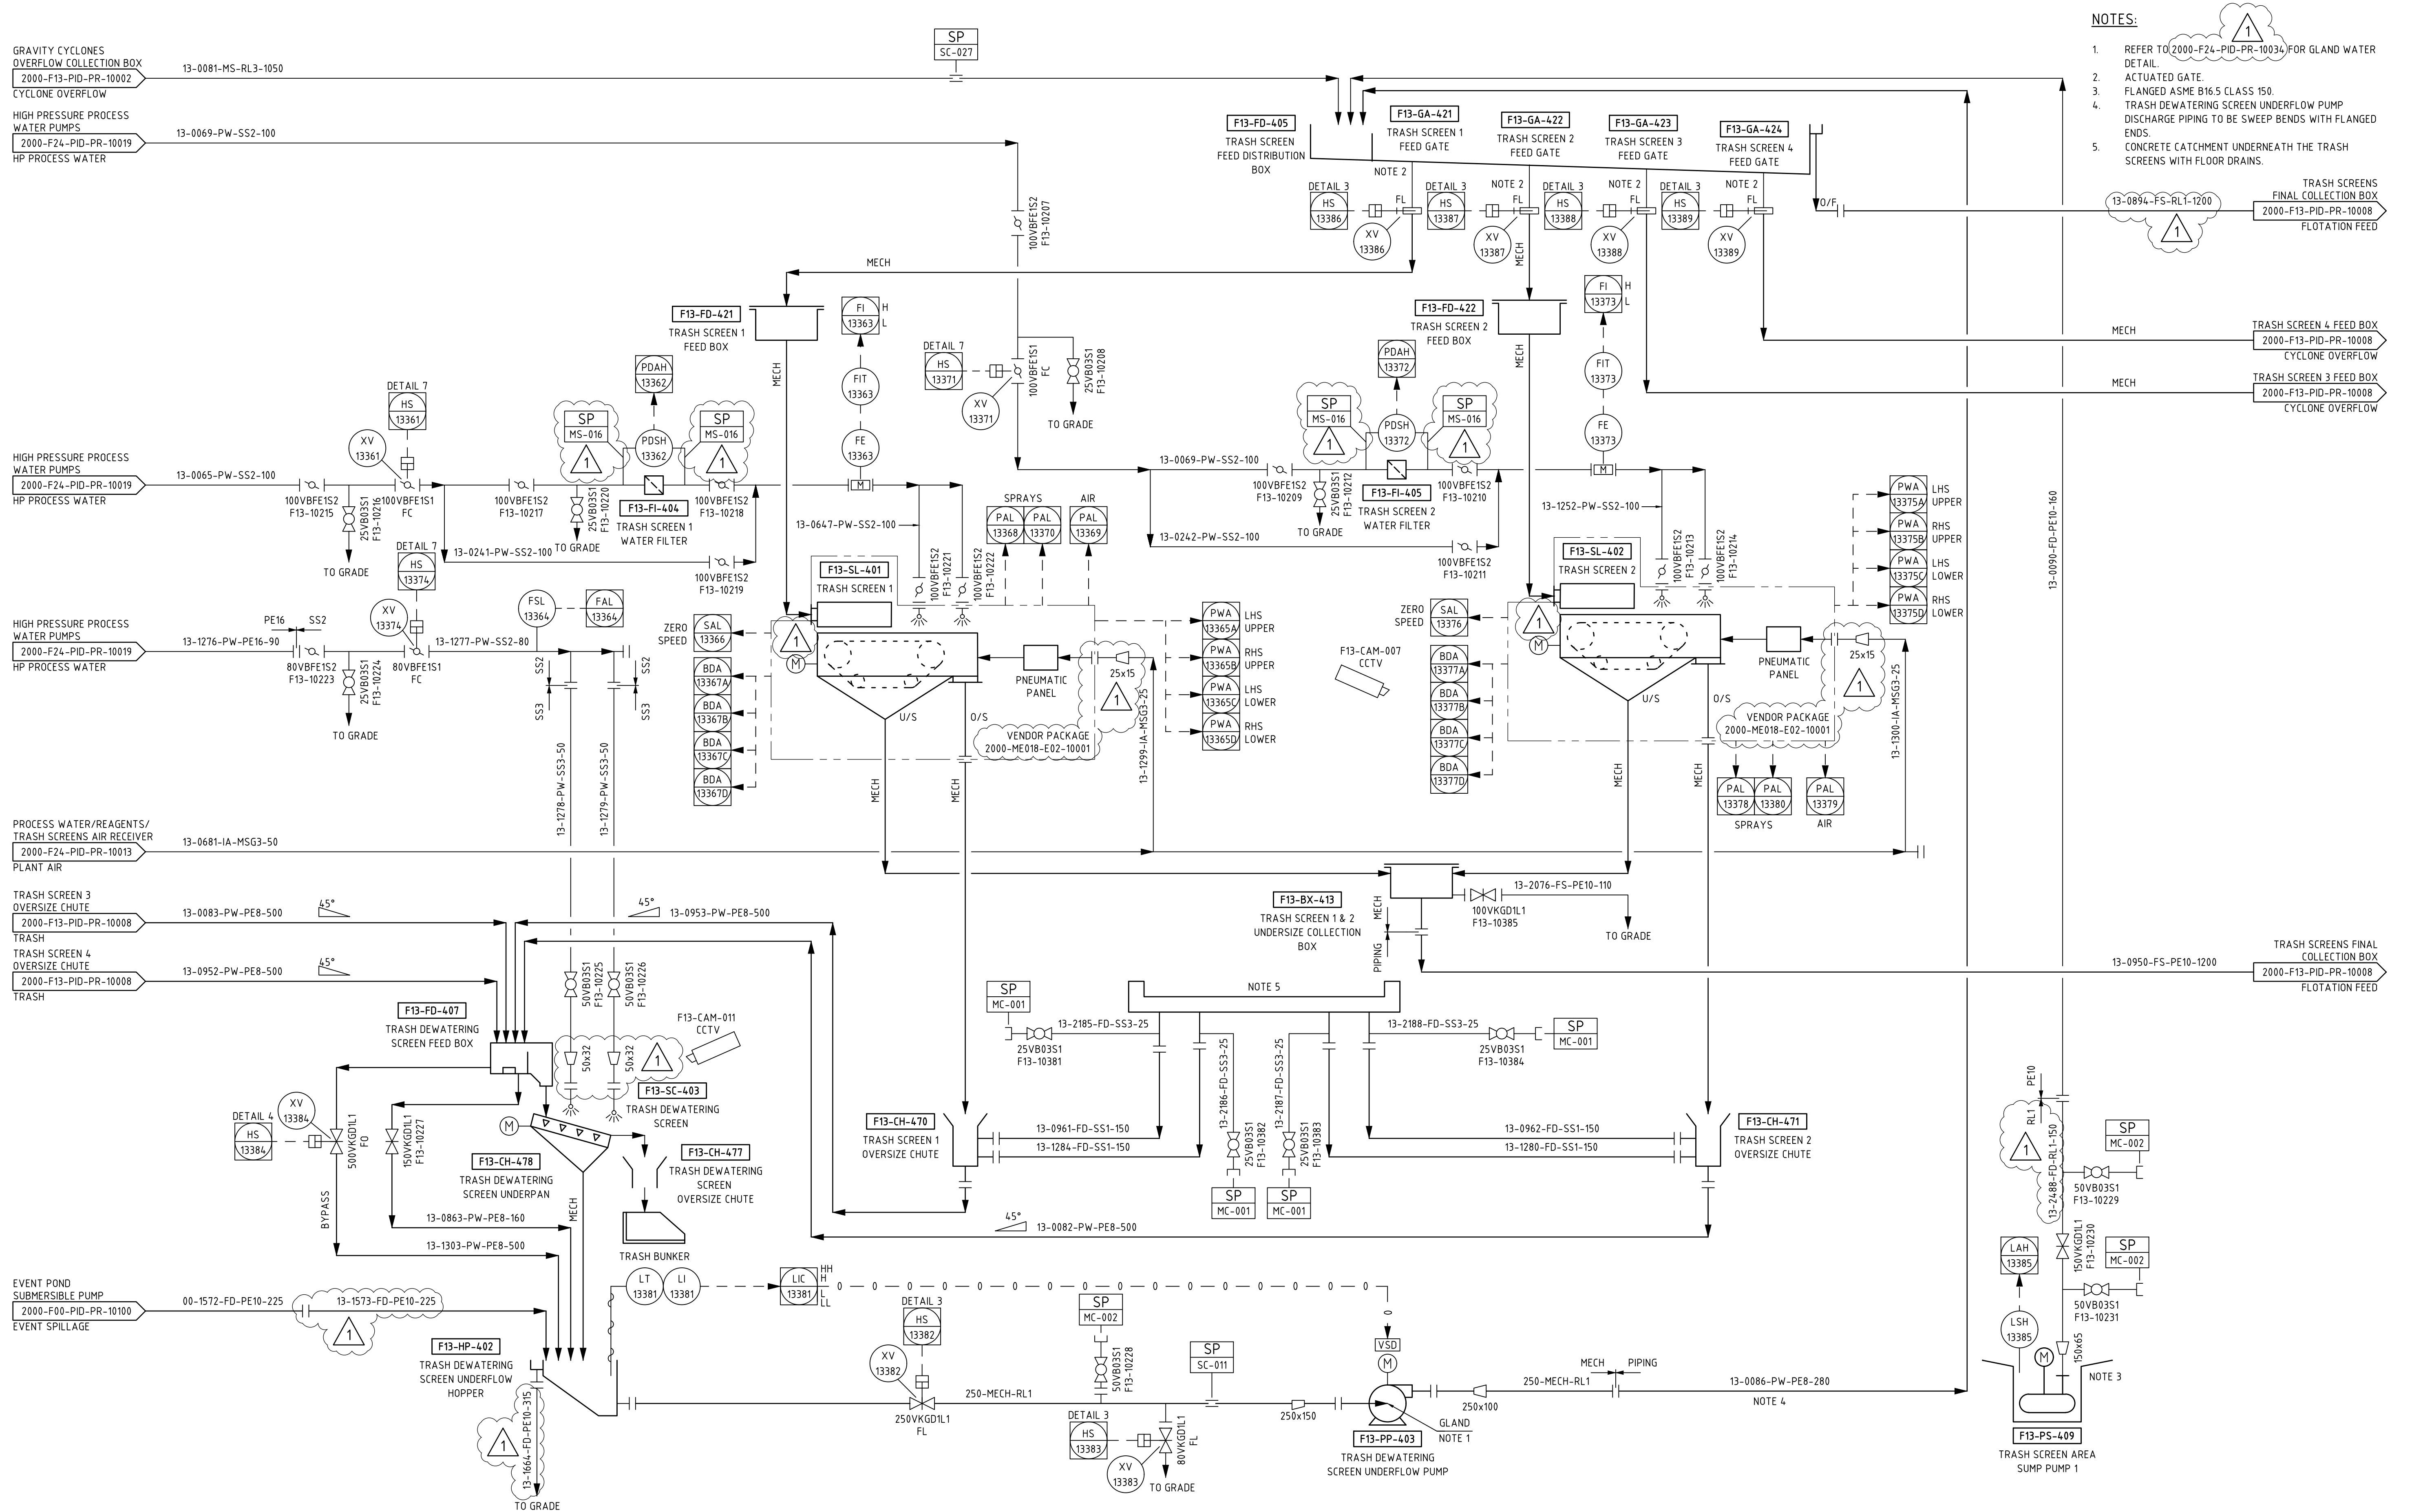

NOTES:

1. REFER TO 2000-F24-PID-PR-10034 FOR GLAND WATER DETAIL.
2. ACTUATED GATE.
3. FLANGED ASME B16.5 CLASS 150.
4. TRASH DEWATERING SCREEN UNDERFLOW PUMP DISCHARGE PIPING TO BE SWEEP BENDS WITH FLANGED ENDS.
5. CONCRETE CATCHMENT UNDERNEATH THE TRASH SCREENS WITH FLOOR DRAINS.