


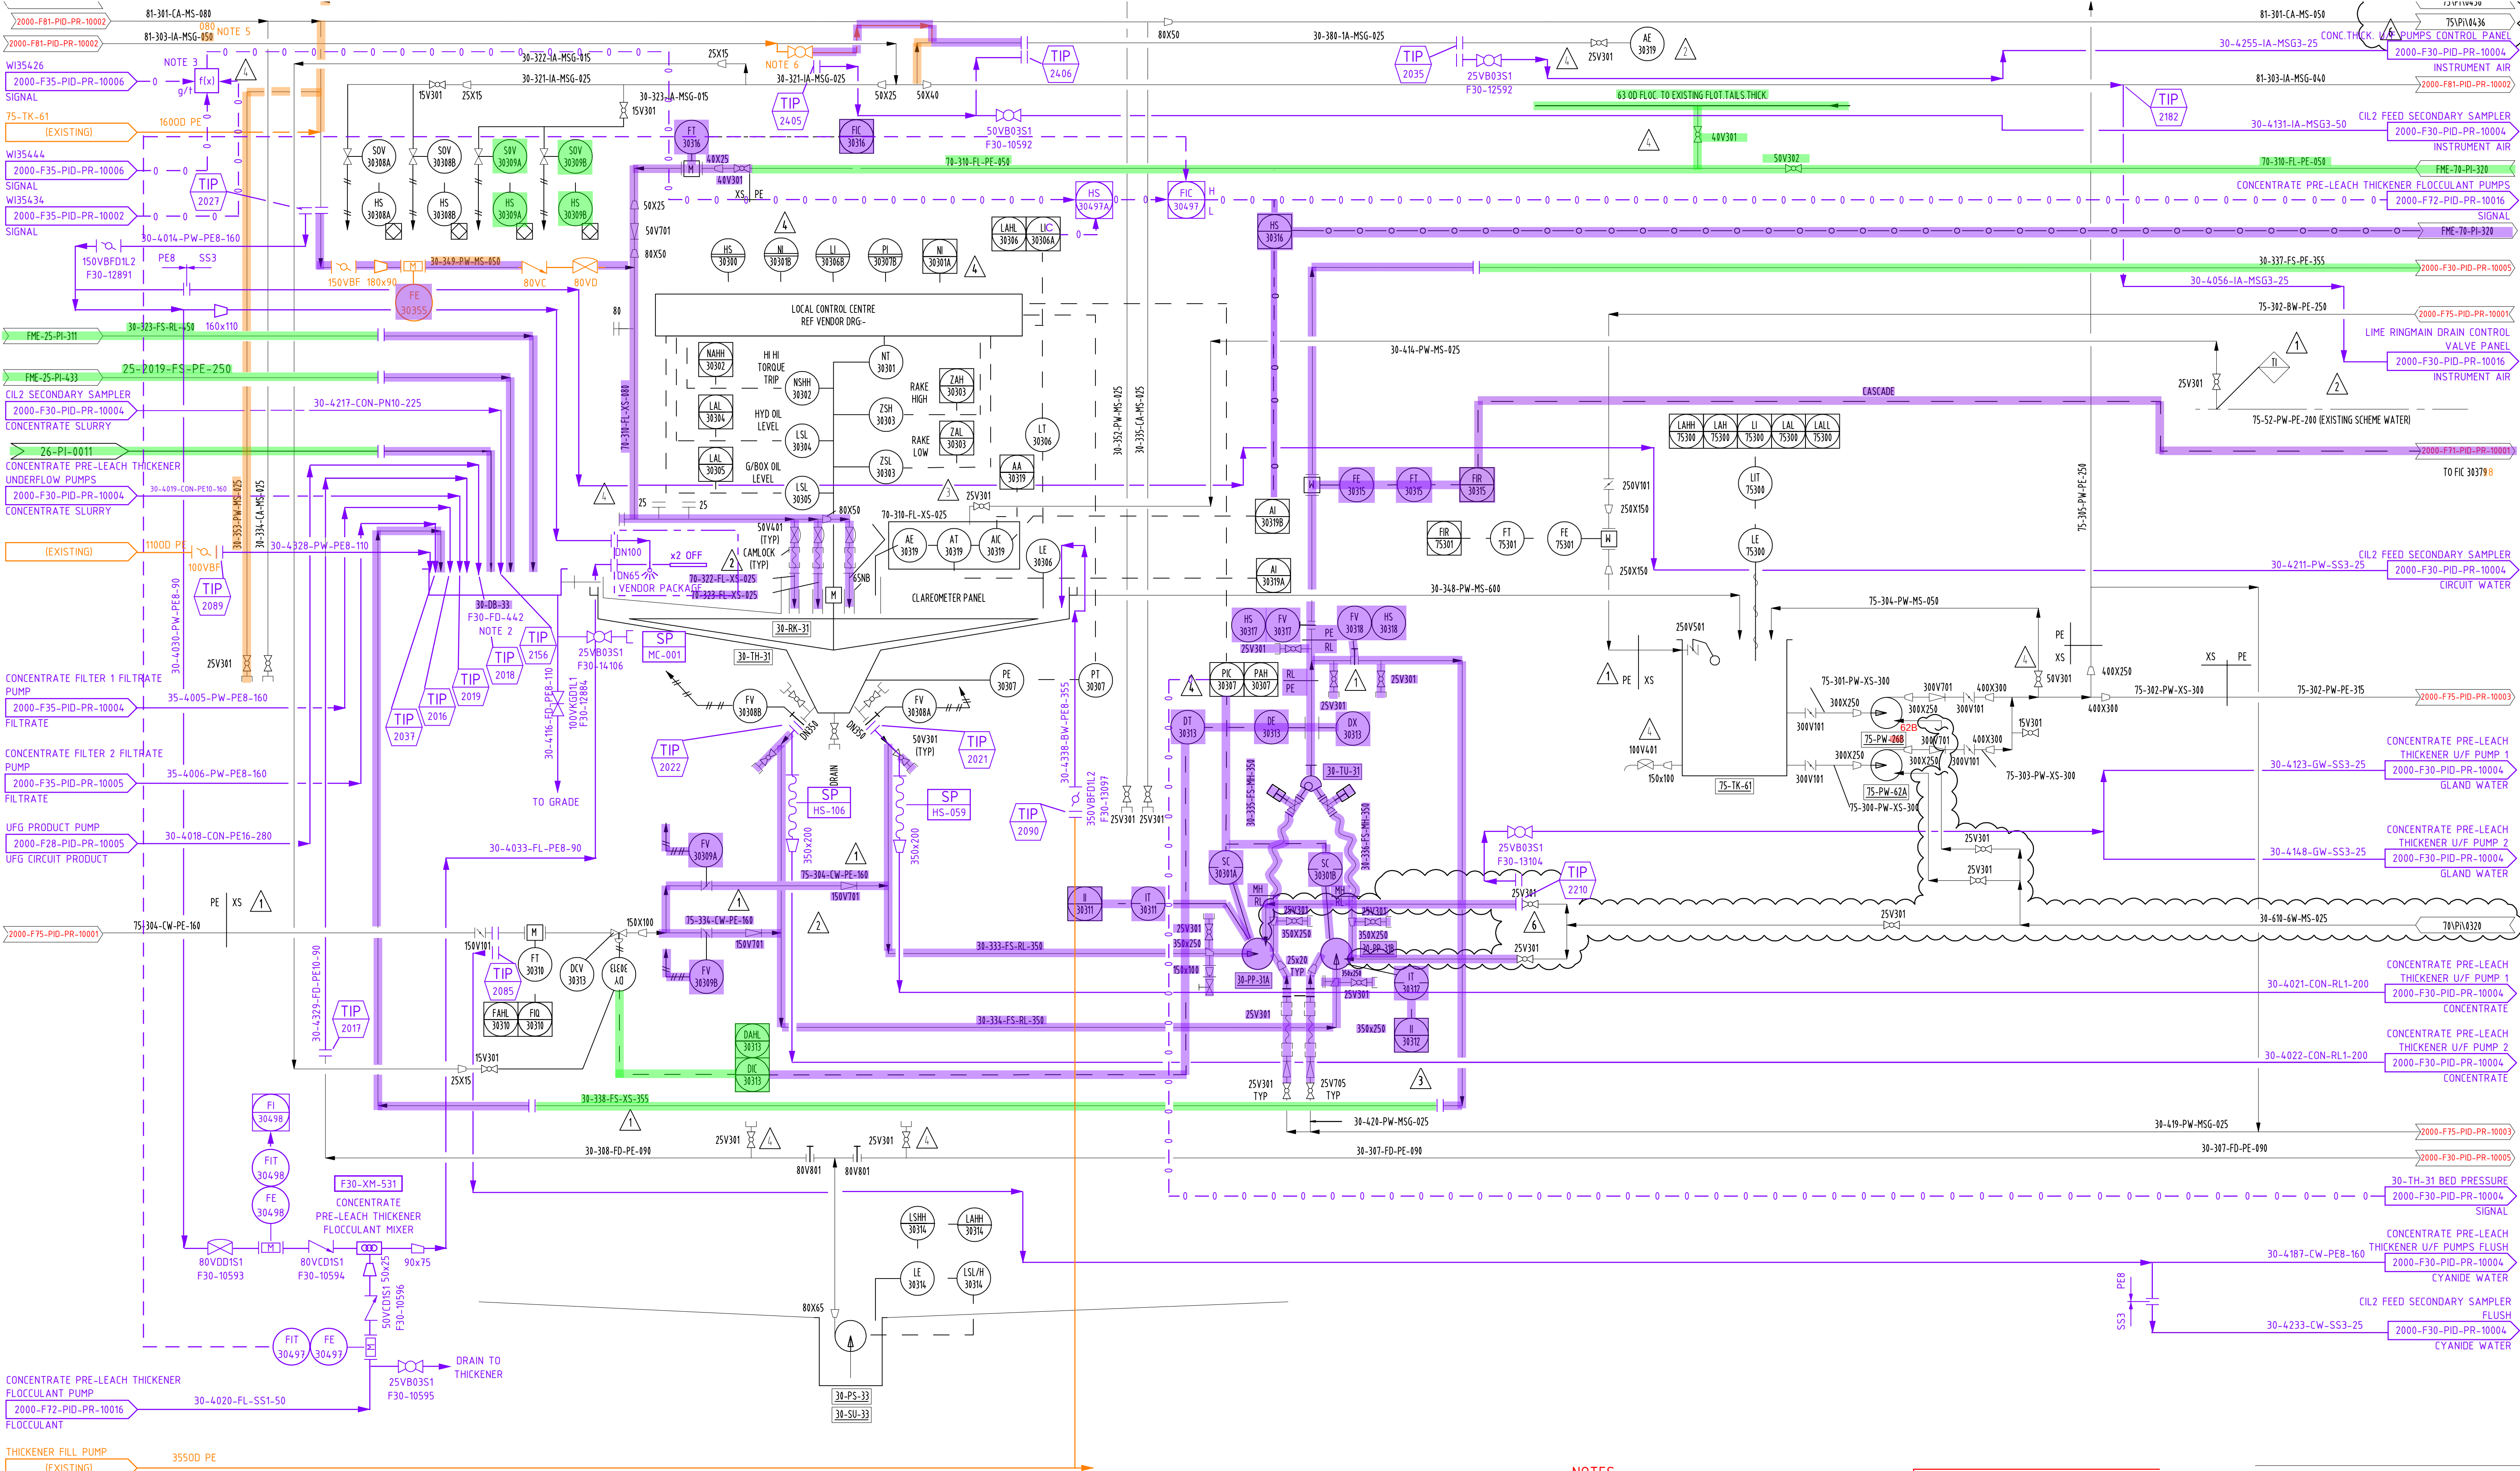

- F30-FD-442

CONCENTRATE PRE-LEACH THICKENER FEED BOX

NOTE 2

30-DB-33

FLOTATION TAILINGS THICK FEED BOX

30-PP-31A/B

FLOTATION TAILINGS THICKENER U/F PUMP

30-PS-33

FLOTATION TAILINGS WASHDOWN PUMP

30-RK-31

FLOTATION TAILINGS THICKENER RAKE MECHANISM

30-SU-33

FLOTATION TAILINGS WASHDOWN PUMP

30-TH-31

TECH TAYLOR VALVE

75-PW-18A/B

CIRCUIT WATER PUMP

75-TK-18

CIRCUIT WATER TANK

F30-PP-415

CONCENTRATE PRE-LEACH THICKENER UNDERFLOW PUMP 1

F30-PP-441

CONCENTRATE PRE-LEACH THICKENER UNDERFLOW PUMP 2

F30-SA-441

CONCENTRATE PRE-LEACH THICKENER UNDERFLOW PRIMARY SAMPLER

F30-SA-442

CONCENTRATE PRE-LEACH THICKENER UNDERFLOW SECONDARY SAMPLER

F30-HP-441

CONCENTRATE PRE-LEACH THICKENER UNDERFLOW SAMPLE RETURN HOPPER

F30-PP-441

CONCENTRATE PRE-LEACH THICKENER UNDERFLOW SAMPLE RETURN PUMP

F30-XM-531

CONCENTRATE PRE-LEACH THICKENER FLOCULLANT INLINE MIXER
- NOTES:

1. REFER TO 2000-F24-PR-10003 FOR GLAND DETAIL

2. EXISTING FEEDBOX REMOVED AND REPLACED WITH FEEDBOX

3. CASCADE MODE INPUT FOR FIC30497 USING MANUALLY INPUT FLOCULLANT DOSAGE IN G/T

4. RUBBER LINED PREFORMED SLURRY HOSE 350x200

5. EXISTING INSTRUMENT AIR LINE IS DN80 IN PIPERACK WITH VALVE TO TIE INTO VALVE AND RECONNECTING LINE 30-380.

6. TIE INTO VALVE AND RECONNECTING LINE 30-380.
- LEGEND

EXISTING

NON-EXISTENT

STAGE 1 - NEW

STAGE 1 - REMOVE

STAGE 1 - DECOMMISSIONED (OTHERS)

STAGE 2 - NEW

STAGE 2 - REMOVE

STAGE 2 - DECOMMISSIONED (OTHERS)