


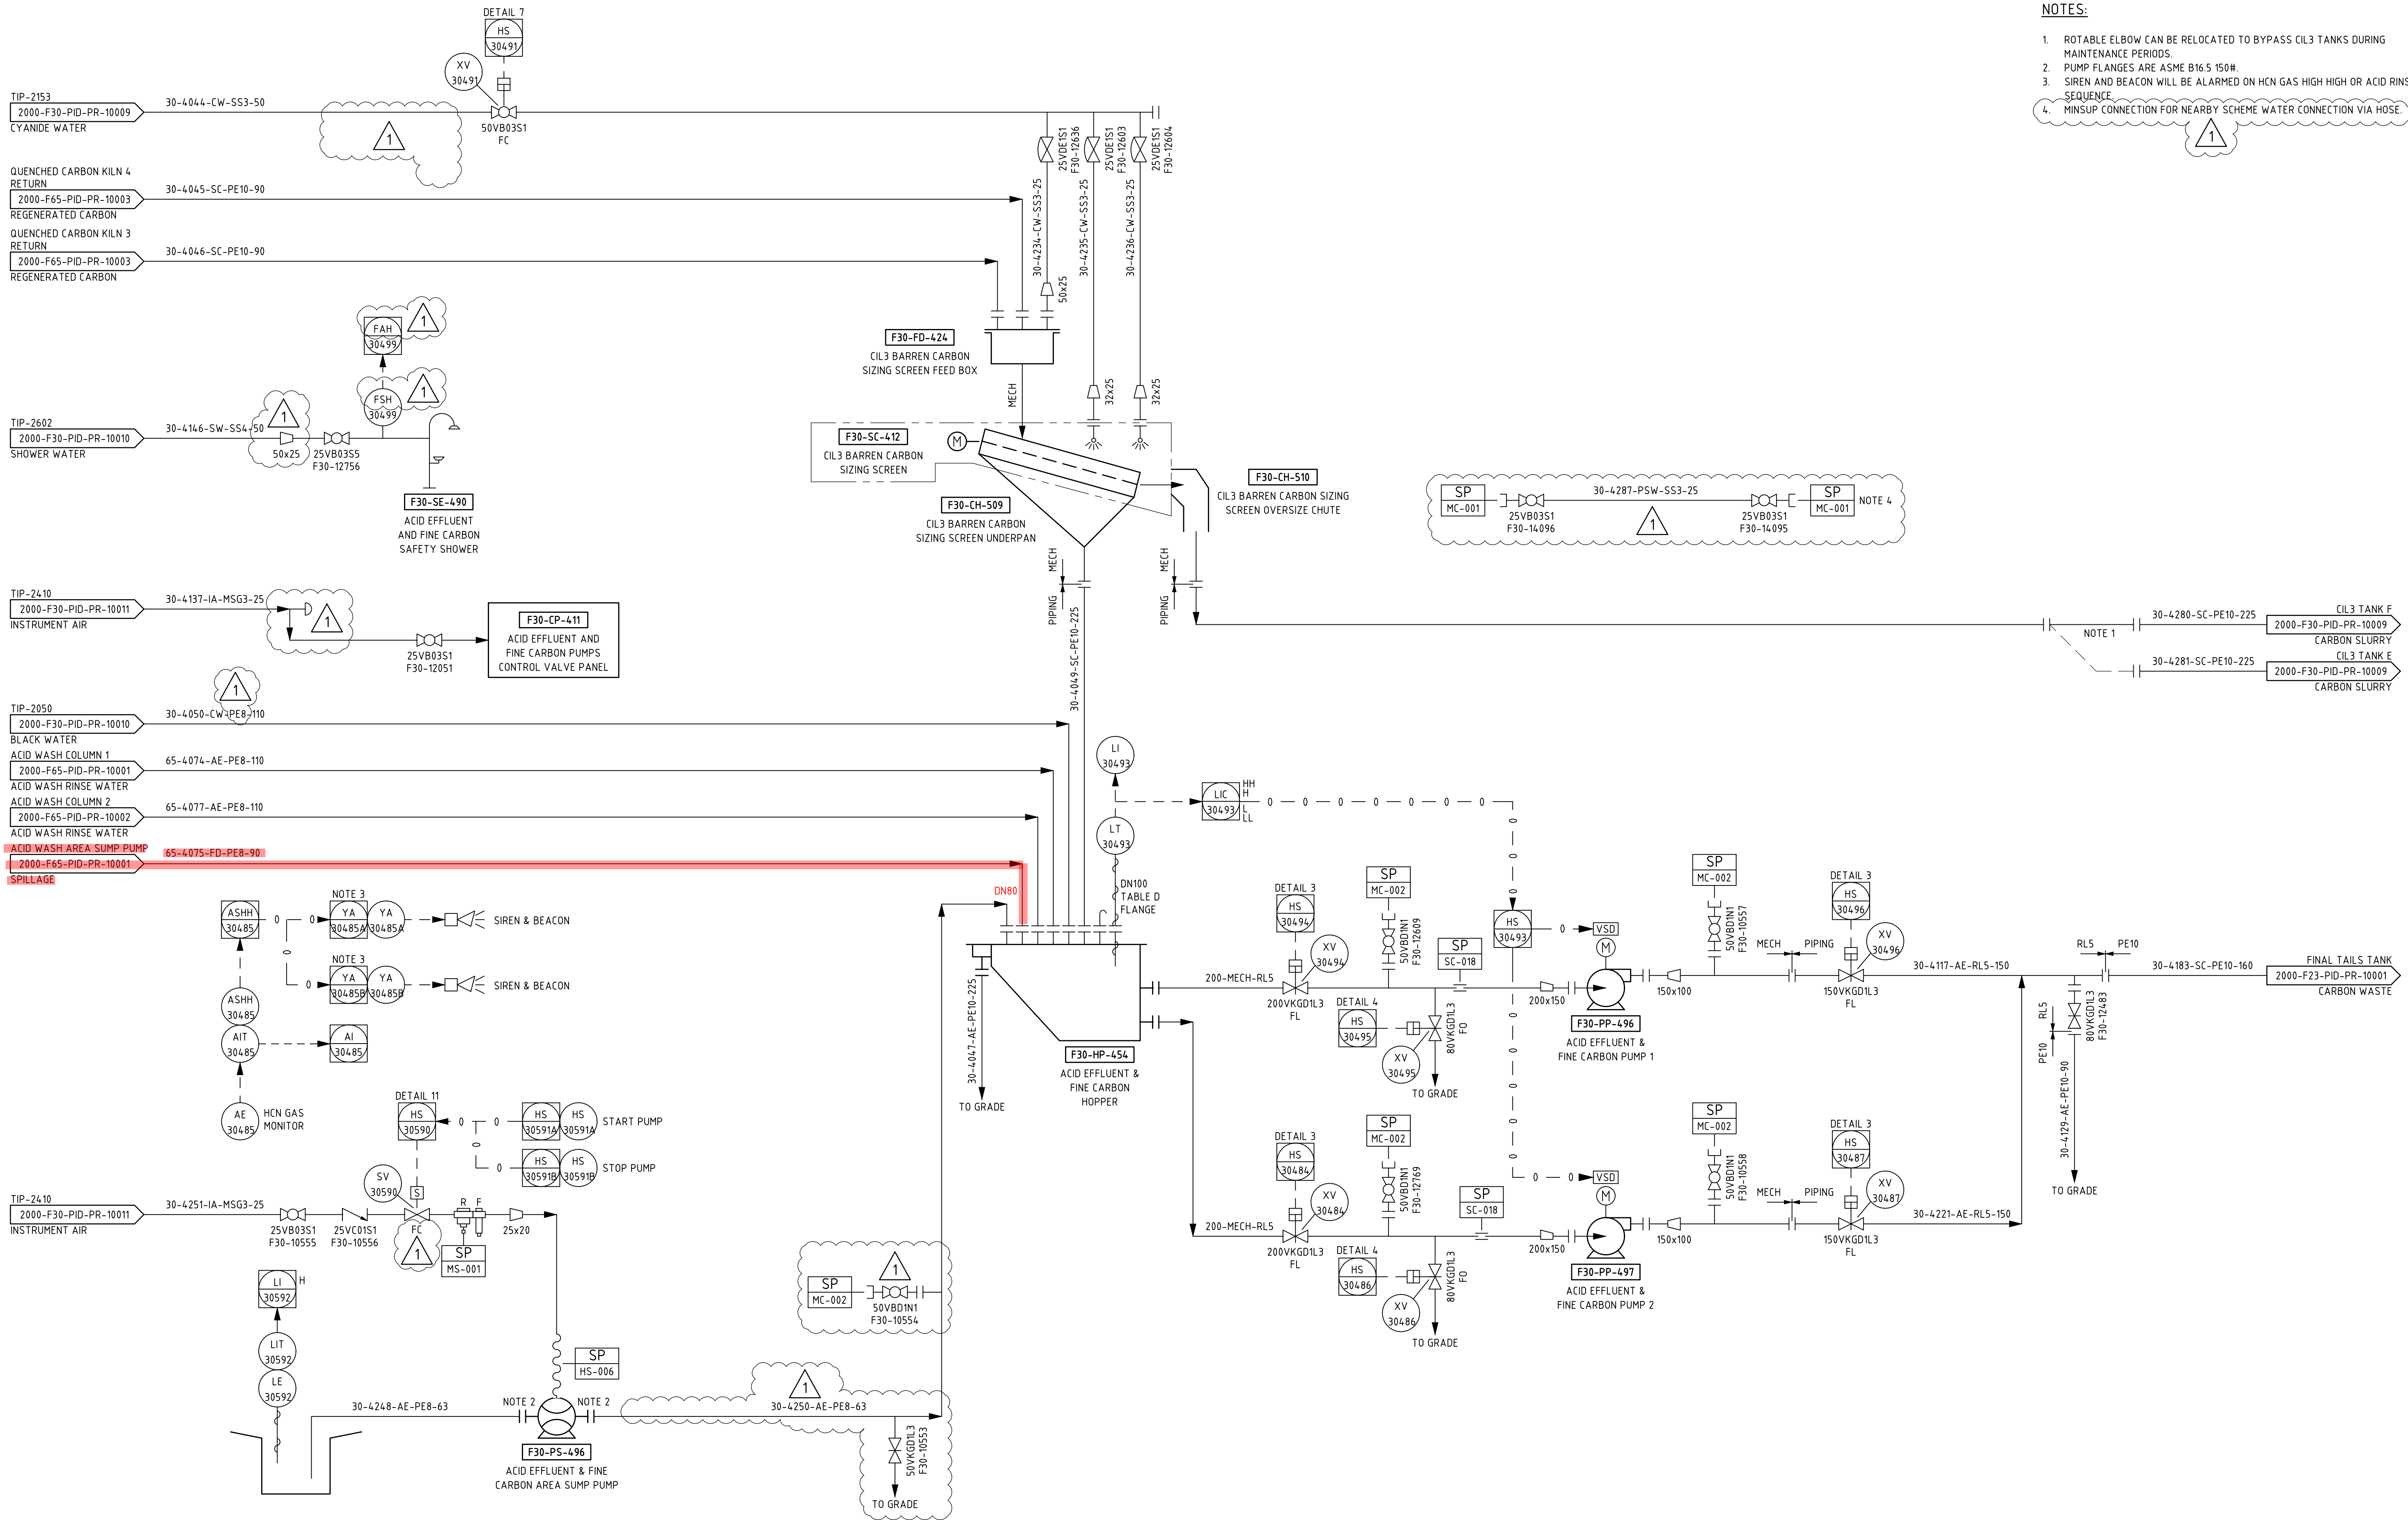

- NOTES:
1. ROTABLE ELBOW CAN BE RELOCATED TO BYPASS CIL3 TANKS DURING MAINTENANCE PERIODS.
 2. PUMP FLANGES ARE ASME B16.5 150#.
 3. SIREN AND BEACON WILL BE ALARMED ON HCN GAS HIGH OR ACID RINSE SEQUENCE.
 4. MINSUP CONNECTION FOR NEARBY SCHEME WATER CONNECTION VIA HOSE.