


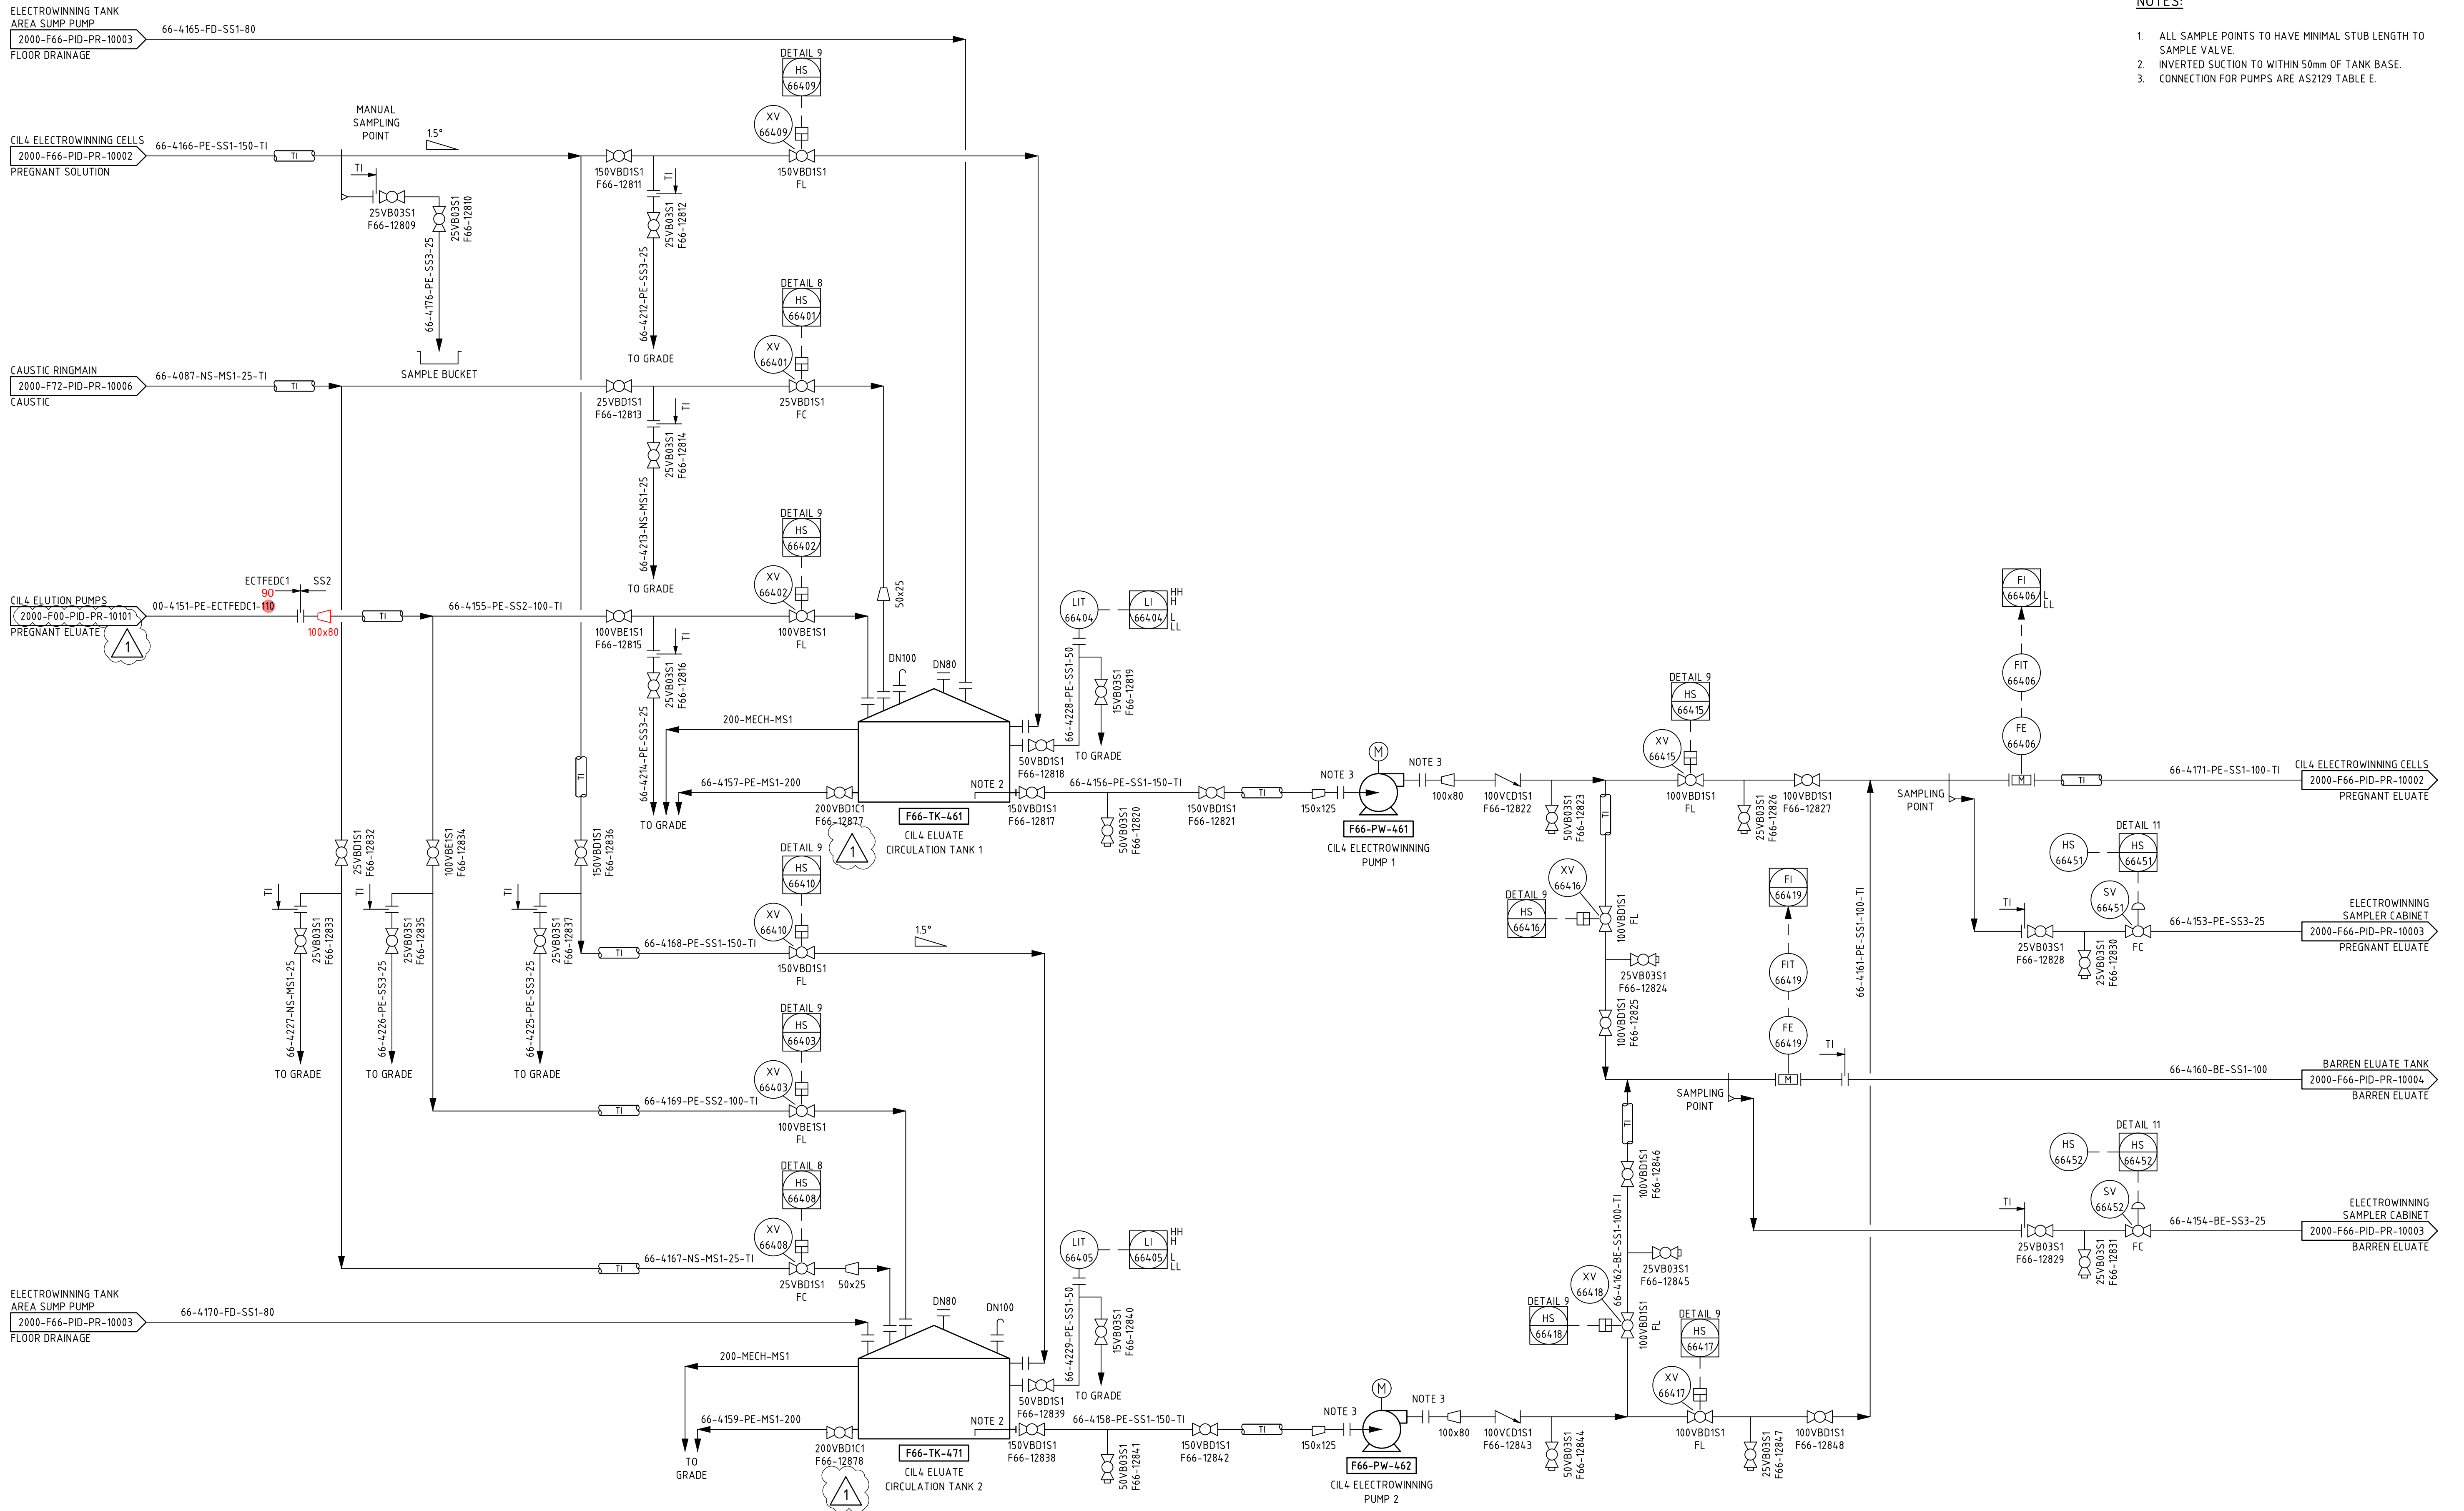

NOTES:

1. ALL SAMPLE POINTS TO HAVE MINIMAL STUB LENGTH TO SAMPLE VALVE.
2. INVERTED SUCTION TO WITHIN 50mm OF TANK BASE.
3. CONNECTION FOR PUMPS ARE AS2129 TABLE E.