


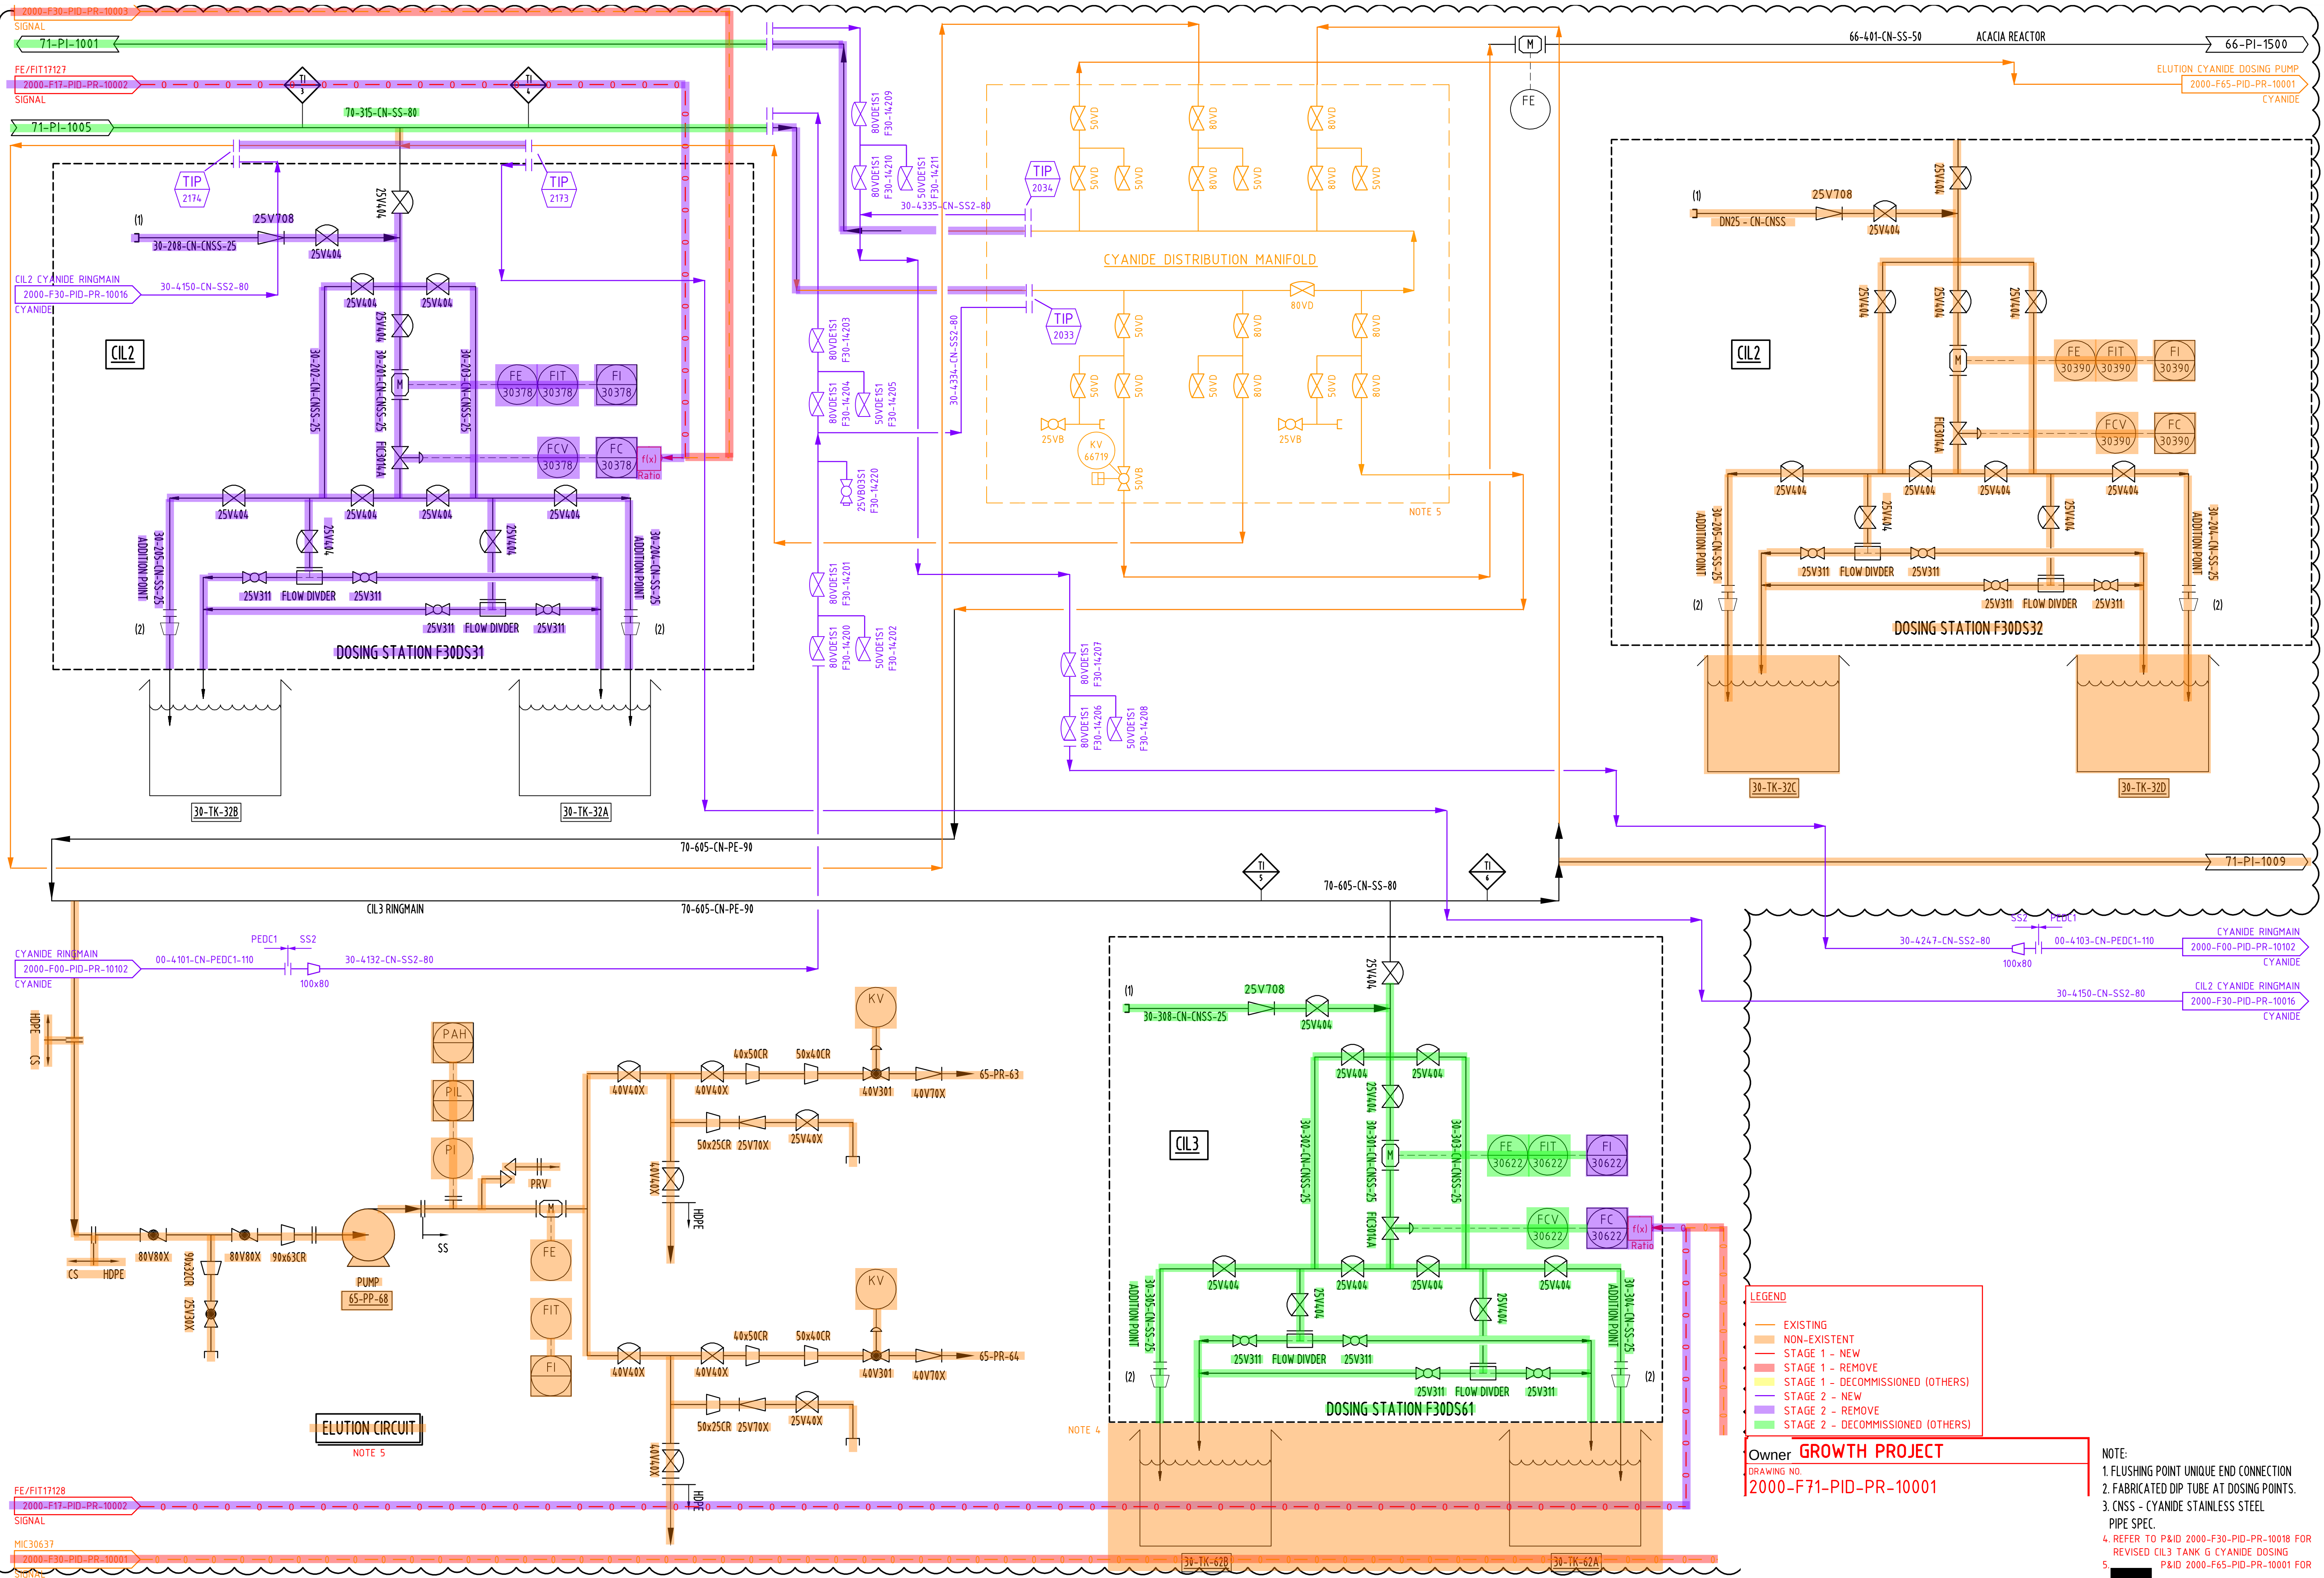

NOTE:

1. FLUSHING POINT UNIQUE END CONNECTION
2. FABRICATED DIP TUBE AT DOSING POINTS.
3. CNSS - CYANIDE STAINLESS STEEL
PIPE SPEC.
4. REFER TO P&ID 2000-F30-PID-PR-10018 FOR
REVISED CIL3 TANK G CYANIDE DOSING
5. P&ID 2000-F65-PID-PR-10001 FOR